

February 11, 2019

# **SMOKE TREE RESORT**

Town of Paradise Valley, AZ

Prepared for:

**Gentree, LLC**

3620 E Campbell Ave, Suite B  
Phoenix, AZ 85018  
(602) 952-8811

Prepared by:

**CVL Consultants, Inc.**

4550 N 12th Street  
Phoenix, AZ 85014  
(602) 264-6831



Job #:1-01-03153-01



**Preliminary Drainage Report**  
**For**  
**Smoke Tree Resort**  
**Paradise Valley, Arizona**

**February 11, 2019**

*Prepared for:*

**Gentree, LLC**

**3620 E Campbell Ave, Suite B**

**Phoenix, AZ 85018**

**(602) 952-8811**

*Prepared by:*

**Coe & Van Loo Consultants, Inc.**

**4550 N. 12th Street**

**Phoenix, AZ 85014**

**(602) 264-6831**



CVL Job Number: 1-01-03153-01

Preliminary Drainage Report for  
Smoke Tree Resort

TABLE OF CONTENTS

1.0 INTRODUCTION..... 2
1.1 Scope ..... 2
1.2 Regulatory Jurisdiction..... 2
2.0 SITE CONDITIONS..... 3
2.1 Location ..... 3
2.2 Existing Conditions ..... 3
2.3 Proposed Conditions ..... 3
3.0 FLOOD ZONE INFORMATION..... 4
4.0 OFFSITE AND ONSITE RUNOFF ..... 5
4.1 Offsite Runoff Management Plan ..... 5
4.2 Onsite Runoff Management Plan ..... 5
5.0 STORM WATER POLLUTION PREVENTION PLAN ..... 6
6.0 SUMMARY AND CONCLUSIONS..... 7
7.0 REFERENCES ..... 8

APPENDICES

- Appendix A NOAA Rainfall Data
Appendix B Runoff Coefficients, Retention and Drywell Calculations

FIGURES

- Figure 1 Location & Vicinity Map
Figure 2 FIRM Map



## **1.0 INTRODUCTION**

### **1.1 SCOPE**

Coe & Van Loo Consultants, Inc. (CVL) has been contracted by Gentree, LLC to provide engineering services in support of the proposed improvements to Smoke Tree Resort, herein referred to as the site. The purpose of this report is to provide on-site and off-site hydrologic and hydraulic analysis for the proposed development.

This report is focused on providing design information, evaluation, and analysis for statistical flood events up to and including the 100-year storm. The scope of this assessment does not include, neither did CVL's client request that, evaluation of storm-water runoff resulting from storm events exceeding the 100-year frequency event. Hence, it should be noted that a storm event exceeding the 100-year frequency may cause or create the risk of greater flood impact than is addressed and presented in this assessment.

The procedures used herein are derived from, and performed with, currently accepted engineering methodologies and practices.

### **1.2 REGULATORY JURISDICTION**

The development is designed to meet the drainage requirements as stated in the Town of Paradise Valley's *Storm Drain Design Manual (1987)* [1] and Flood Control District of Maricopa County (FCDMC), *Drainage Design Manuals for Maricopa County, Arizona, Volume I, Hydrology* [2], *Volume II, Hydraulics* [3], and *Drainage Policies and Standards Manual for Maricopa County, Arizona* [4].

## **2.0 SITE CONDITIONS**

### **2.1 LOCATION**

The site is located within the Town of Paradise Valley, Maricopa County, Arizona. The site is bordered on the north by Lincoln Drive, on the east by commercial property, on the south by the Andaz Resort Hotel and on the west by Quail Run Road and custom residences. Furthermore, the site is located within Section 10, Township 2 North, Range 4 East of the Gila and Salt River Base and Meridian, Arizona.

### **2.2 EXISTING CONDITIONS**

A field reconnaissance of the 5.3-acre resort and its surroundings was performed on February 5<sup>th</sup>, 2019. It was observed that the site and surrounding properties are flat and generally drain to east then to the north towards Lincoln Drive. The resort's landscaping is characterized by hedges around all but the north perimeter, mature trees throughout the site and open space consisting of lawn and dirt drive lanes and parking.

### **2.3 PROPOSED CONDITIONS**

The resort was originally opened in 1966 and has yet to undergo any significant renovations beyond general maintenance measures. The resort is notably dated and in need of renovations and refurbishment of amenities. The vision for the transformation of the Smoke Tree Resort is to welcome guests to a four-star "local-centric" hospitality experience in both form and substance. This is to be achieved through active forward-facing components and lifestyle programmatic aspects. The existing resort often goes unnoticed in its unassuming character along Lincoln Drive, with only 23 of its 32 guest rooms currently in use. The revitalization of the site will retain its charming essence while providing the scale and quality of amenities sought by today's traveler; the specifics of which include 150 guest rooms, 30 resort dwelling units, special event venues, and a neighborhood local-centric fresh market & eatery concept. The relaxed, pedestrian friendly environment will not include the typical resort perimeter walls or gates; instead, setbacks that align with existing buildings are desired, including a bicycle/pedestrian path that shall weave the resort into the local tapestry.

### **3.0 FLOOD ZONE INFORMATION**

The Maricopa County, Arizona and Incorporated Areas Flood Insurance Rate Map (FIRM), panel numbers 04013C1770L, Map Revised October 16, 2013 [5], indicates the site falls within Zone "D."

Zone "D" is defined by FEMA as:

"The Zone D designation is used for areas where there are possible but undetermined flood hazards, as no analysis of flood hazards has been conducted. The Zone D designation is also used when a community incorporates portions of another community's area where no map has been prepared."

Refer to Figure 2 for a copy of the Flood Insurance Rate Map (FIRM).

## **4.0 OFFSITE AND ONSITE RUNOFF**

### **4.1 OFFSITE RUNOFF MANAGEMENT PLAN**

The offsite watershed affecting the site is urbanized by mainly low density custom residential lots to the west. These residential lots are flat with no concentrated flow paths. During the field reconnaissance, it was observed that some of the custom residences with perimeter block walls have weepholes in order to keep flow moving through their sites while others do not. At a meeting with the Paradise Valley Town Engineer on January 30<sup>th</sup>, 2019, it was agreed that the proposed site would handle offsite runoff similarly by allowing it to move through the site. The proposed site will consist of small drainage swales and/or weepholes along the west and east perimeter walls to ensure offsite flows are safely conveyed through the site. Additionally, Quail Run Road will be fully improved with curb and gutter from Lincoln Drive to the south boundary of the site. These additional improvements will further reduce the amount of offsite runoff impacting the site from the west.

### **4.2 ONSITE RUNOFF MANAGEMENT PLAN**

The resort was developed in 1966 when drainage regulations were non-existent. The site has a single small drain/drywell located just south of the abandoned restaurant building for localized flow. The remainder of the site is graded to drain to the east. The site currently provides no onsite retention. The proposed improvements to the resort will utilize parking and drive corridors as drainage pathways to drain flow to the east and north where runoff will be captured by grated catch basins. These catch basins will drain to underground retention basins in the form of 12-ft diameter pipes. Onsite retention will be provided for the pre vs. post condition. Basins will be designed to dispose of the storm water within 36 hours through drywells. Rainfall data was taken from NOAA Atlas 14 (see Appendix A). Retention and drywell calculations can be found in Appendix B. Runoff coefficients based on land use [1] for pre-development and post-development condition (see Appendix B).

## **5.0 STORM WATER POLLUTION PREVENTION PLAN**

During final engineering design, the Storm Water Pollution Prevention Plan (SWPPP) will be prepared and submitted for approval.



## **6.0 SUMMARY AND CONCLUSIONS**



1. Retention will be provided for pre-development versus post-development conditions.
2. Underground retention basins will be designed to drain within 36 hours.
3. According to the FIRM panel number 04013C1770L, Map Revised: October 16, 2013, the site is located in Zone "D."
4. All finished floor elevations (FFE) will be at least 14 inches above the lowest drainage outfall for the site.

## **7.0 REFERENCES**

- [1] Town of Paradise Valley, "Storm Drain Design Manual," March 12, 1987.
- [2] Flood Control District of Maricopa County, "Drainage Design Manual for Maricopa County, Arizona, Volume I, Hydrology," December 14, 2018.
- [3] Flood Control District of Maricopa County, Arizona, "Drainage Design Manual for Maricopa County, Volume II, Hydraulics," December 14, 2018.
- [4] Flood Control District of Maricopa County, "Drainage Policies and Standards," Revised August 22, 2018.
- [5] Federal Emergency Management Agency (FEMA), "National Flood Insurance Program, Flood Insurance Rate Map, Maricopa County, Arizona and Incorporated Areas, Panel Number 04013C1770L," Revised October 16, 2013.

# FIGURES

CVL

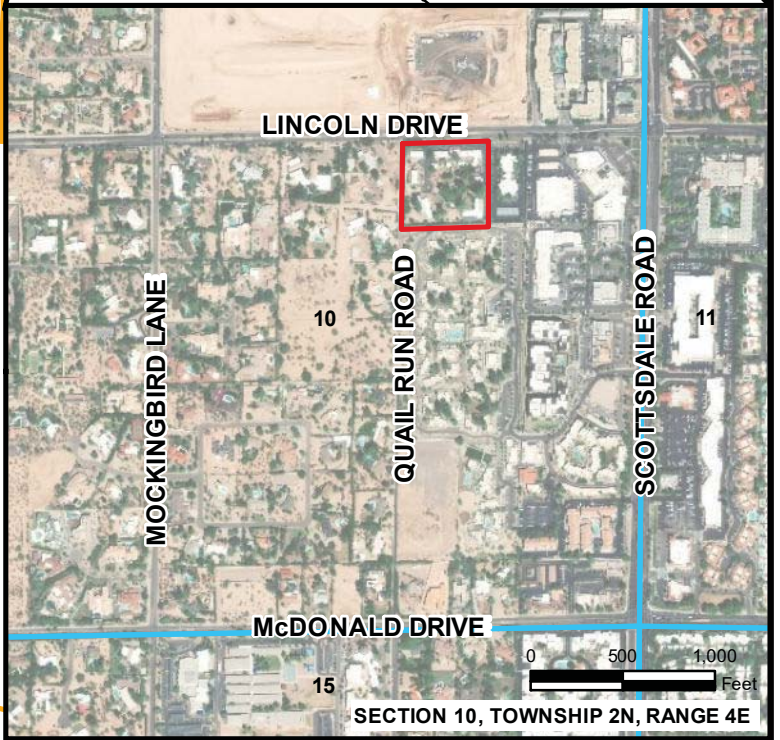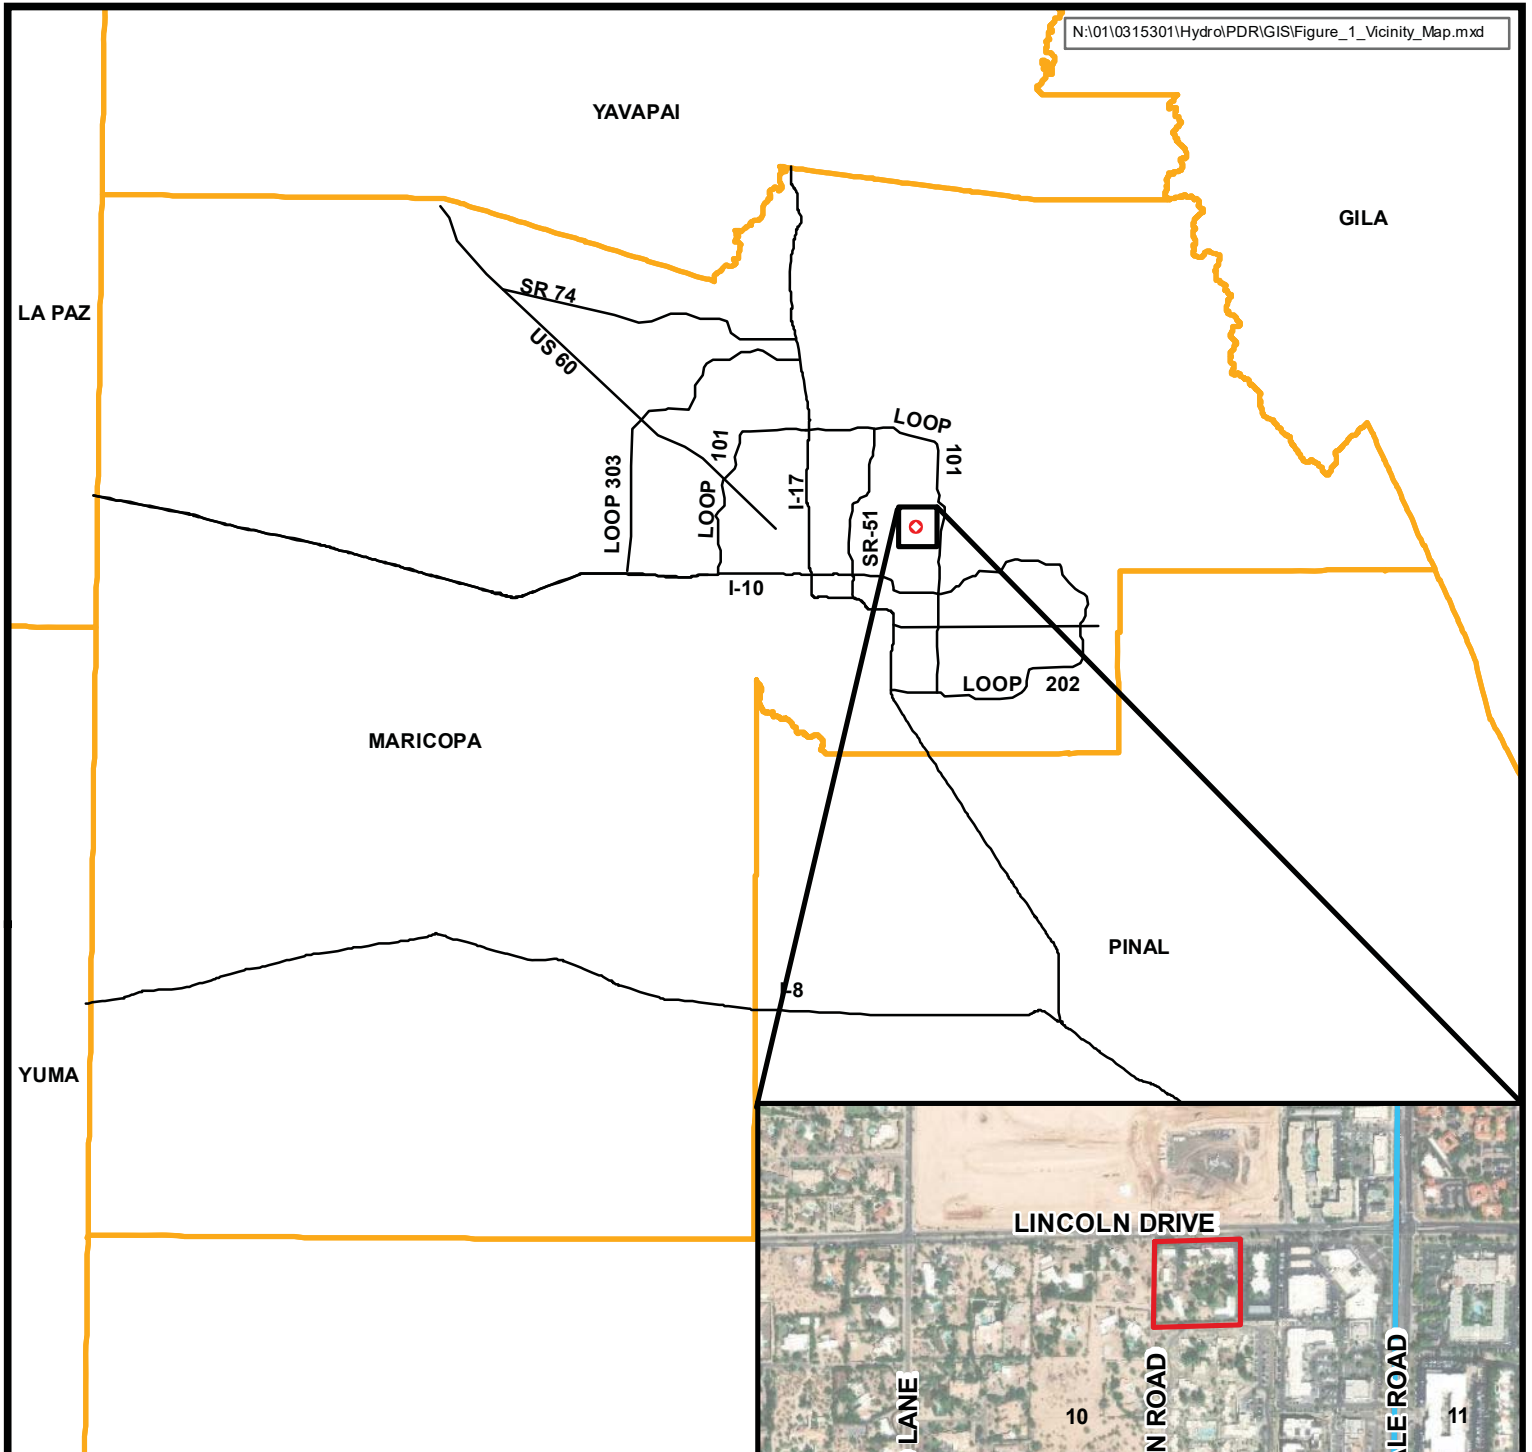

**Legend**

- SITE
- FREEWAY/MAJOR ROADS
- COUNTY BOUNDARY
- 10 SECTION ID

N

0 10 20 Miles



4550 NORTH 12TH STREET  
PHOENIX, ARIZONA 85014  
TELEPHONE (602) 264-6831


**SMOKE TREE RESORT**

**VICINITY & LOCATION MAP**

JOB NO.  
01-03153-01

FIGURE 1

### Legend

 SMOKE TREE RESORT

ORSESHOE LN

# 10

LINCOLN DRIVE E

LINCOLN DR

24536-1

SCOTTS DALE ROAD

ROSE LN

E QUAIL RUN RD

MALCOMB DR

MOCKINGBIRD LANE (64TH ST)

E QUAIL RUN RD

## ZONE D

QUAIL RUN ROAD

E VALLEY VISTA LN

# TOWN OF PARADISE VALLEY 040049

24547-1

McDONALD DRIVE

DU1341

N KIVA LN

64TH ST

N 68TH PL

70TH ST

PL

PANEL 1770L

**FIRM**  
FLOOD INSURANCE RATE MAP  
MARICOPA COUNTY,  
ARIZONA  
AND INCORPORATED AREAS

PANEL 1770 OF 4425  
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

COMMUNITY	FIRM	PANEL	S.F.-X
MARICOPA COUNTY	04002	1770	L
PARADISE VALLEY TOWN OF	04004E	1770	L
250788A CITY OF	04002	1770	I

Refer to Use: The Map Number shown here should be used after 2/23/10 12:00:00 AM. The Community Number shown above should be used on insurance addresses for the other date only.



MAP NUMBER  
04013C1770L

MAP REVISED  
OCTOBER 16, 2013

Federal Emergency Management Agency

NATIONAL FLOOD INSURANCE PROGRAM



4550 NORTH 12TH STREET  
PHOENIX, ARIZONA 85014  
TELEPHONE (602) 264-6831

## SMOKE TREE RESORT

JOB NO.

1.01.03153.01

## FLOOD INSURANCE RATE MAP

FIGURE 2

# **APPENDICES**

**CVL**

**APPENDIX A**  
**NOAA Atlas 14 Rainfall Data**



**NOAA Atlas 14, Volume 1, Version 5**  
**Location name: Paradise Valley, Arizona, USA\***  
**Latitude: 33.5306°, Longitude: -111.9293°**  
**Elevation: 1310.38 ft\*\***



\* source: ESRI Maps  
 \*\* source: USGS

**POINT PRECIPITATION FREQUENCY ESTIMATES**

Sanja Perica, Sarah Dietz, Sarah Heim, Lillian Hiner, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Carl Trypaluk, Dale Unruh, Fenglin Yan, Michael Yekta, Tan Zhao, Geoffrey Bonnin, Daniel Brewer, Li-Chuan Chen, Tye Parzybok, John Yarchoan

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aeriels](#)

**PF tabular**

<b>PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)<sup>1</sup></b>										
<b>Duration</b>	<b>Average recurrence interval (years)</b>									
	<b>1</b>	<b>2</b>	<b>5</b>	<b>10</b>	<b>25</b>	<b>50</b>	<b>100</b>	<b>200</b>	<b>500</b>	<b>1000</b>
<b>5-min</b>	<b>0.186</b> (0.156-0.228)	<b>0.243</b> (0.204-0.298)	<b>0.331</b> (0.275-0.403)	<b>0.397</b> (0.329-0.482)	<b>0.487</b> (0.397-0.589)	<b>0.556</b> (0.447-0.668)	<b>0.627</b> (0.495-0.752)	<b>0.700</b> (0.543-0.837)	<b>0.796</b> (0.602-0.954)	<b>0.870</b> (0.645-1.04)
<b>10-min</b>	<b>0.284</b> (0.237-0.347)	<b>0.371</b> (0.311-0.454)	<b>0.503</b> (0.419-0.613)	<b>0.605</b> (0.500-0.734)	<b>0.742</b> (0.604-0.896)	<b>0.847</b> (0.681-1.02)	<b>0.955</b> (0.754-1.15)	<b>1.07</b> (0.827-1.27)	<b>1.21</b> (0.916-1.45)	<b>1.32</b> (0.981-1.59)
<b>15-min</b>	<b>0.352</b> (0.294-0.430)	<b>0.459</b> (0.386-0.562)	<b>0.624</b> (0.519-0.760)	<b>0.750</b> (0.620-0.910)	<b>0.919</b> (0.749-1.11)	<b>1.05</b> (0.844-1.26)	<b>1.18</b> (0.935-1.42)	<b>1.32</b> (1.02-1.58)	<b>1.50</b> (1.14-1.80)	<b>1.64</b> (1.22-1.97)
<b>30-min</b>	<b>0.473</b> (0.396-0.579)	<b>0.619</b> (0.520-0.757)	<b>0.840</b> (0.699-1.02)	<b>1.01</b> (0.835-1.23)	<b>1.24</b> (1.01-1.50)	<b>1.41</b> (1.14-1.70)	<b>1.60</b> (1.26-1.91)	<b>1.78</b> (1.38-2.13)	<b>2.02</b> (1.53-2.42)	<b>2.21</b> (1.64-2.65)
<b>60-min</b>	<b>0.586</b> (0.490-0.717)	<b>0.766</b> (0.643-0.937)	<b>1.04</b> (0.865-1.27)	<b>1.25</b> (1.03-1.52)	<b>1.53</b> (1.25-1.85)	<b>1.75</b> (1.41-2.10)	<b>1.97</b> (1.56-2.37)	<b>2.20</b> (1.71-2.63)	<b>2.50</b> (1.89-3.00)	<b>2.74</b> (2.03-3.29)
<b>2-hr</b>	<b>0.680</b> (0.577-0.814)	<b>0.881</b> (0.748-1.06)	<b>1.18</b> (0.995-1.41)	<b>1.40</b> (1.17-1.67)	<b>1.71</b> (1.42-2.03)	<b>1.95</b> (1.59-2.30)	<b>2.19</b> (1.76-2.59)	<b>2.44</b> (1.92-2.88)	<b>2.77</b> (2.13-3.27)	<b>3.03</b> (2.28-3.60)
<b>3-hr</b>	<b>0.748</b> (0.632-0.906)	<b>0.959</b> (0.814-1.17)	<b>1.26</b> (1.06-1.52)	<b>1.49</b> (1.25-1.80)	<b>1.83</b> (1.50-2.18)	<b>2.09</b> (1.70-2.49)	<b>2.37</b> (1.89-2.82)	<b>2.65</b> (2.08-3.15)	<b>3.05</b> (2.32-3.62)	<b>3.37</b> (2.50-4.01)
<b>6-hr</b>	<b>0.900</b> (0.777-1.07)	<b>1.14</b> (0.985-1.35)	<b>1.46</b> (1.25-1.72)	<b>1.71</b> (1.46-2.01)	<b>2.06</b> (1.73-2.40)	<b>2.33</b> (1.93-2.71)	<b>2.62</b> (2.13-3.04)	<b>2.91</b> (2.33-3.38)	<b>3.30</b> (2.58-3.84)	<b>3.61</b> (2.75-4.21)
<b>12-hr</b>	<b>1.00</b> (0.875-1.17)	<b>1.27</b> (1.10-1.48)	<b>1.61</b> (1.39-1.87)	<b>1.87</b> (1.61-2.17)	<b>2.23</b> (1.90-2.58)	<b>2.50</b> (2.10-2.89)	<b>2.78</b> (2.31-3.21)	<b>3.07</b> (2.51-3.54)	<b>3.45</b> (2.75-4.01)	<b>3.75</b> (2.94-4.38)
<b>24-hr</b>	<b>1.19</b> (1.05-1.38)	<b>1.52</b> (1.33-1.75)	<b>1.96</b> (1.72-2.27)	<b>2.32</b> (2.02-2.68)	<b>2.81</b> (2.44-3.24)	<b>3.20</b> (2.75-3.68)	<b>3.60</b> (3.08-4.15)	<b>4.02</b> (3.41-4.63)	<b>4.60</b> (3.85-5.30)	<b>5.06</b> (4.20-5.84)
<b>2-day</b>	<b>1.29</b> (1.13-1.48)	<b>1.65</b> (1.45-1.90)	<b>2.16</b> (1.90-2.49)	<b>2.58</b> (2.25-2.96)	<b>3.15</b> (2.74-3.62)	<b>3.61</b> (3.11-4.14)	<b>4.10</b> (3.51-4.70)	<b>4.60</b> (3.91-5.28)	<b>5.31</b> (4.46-6.10)	<b>5.87</b> (4.88-6.77)
<b>3-day</b>	<b>1.37</b> (1.20-1.57)	<b>1.75</b> (1.54-2.01)	<b>2.31</b> (2.02-2.65)	<b>2.76</b> (2.40-3.16)	<b>3.38</b> (2.94-3.87)	<b>3.89</b> (3.35-4.45)	<b>4.43</b> (3.79-5.07)	<b>4.99</b> (4.24-5.72)	<b>5.79</b> (4.86-6.63)	<b>6.43</b> (5.34-7.39)
<b>4-day</b>	<b>1.45</b> (1.27-1.66)	<b>1.86</b> (1.63-2.13)	<b>2.45</b> (2.15-2.80)	<b>2.93</b> (2.56-3.35)	<b>3.62</b> (3.14-4.13)	<b>4.17</b> (3.59-4.76)	<b>4.76</b> (4.07-5.43)	<b>5.39</b> (4.57-6.16)	<b>6.27</b> (5.26-7.16)	<b>6.99</b> (5.80-8.01)
<b>7-day</b>	<b>1.63</b> (1.43-1.87)	<b>2.08</b> (1.82-2.39)	<b>2.76</b> (2.40-3.17)	<b>3.30</b> (2.87-3.79)	<b>4.08</b> (3.52-4.67)	<b>4.70</b> (4.04-5.37)	<b>5.36</b> (4.57-6.14)	<b>6.07</b> (5.13-6.96)	<b>7.07</b> (5.90-8.10)	<b>7.87</b> (6.51-9.04)
<b>10-day</b>	<b>1.76</b> (1.54-2.02)	<b>2.25</b> (1.98-2.58)	<b>2.98</b> (2.60-3.40)	<b>3.56</b> (3.10-4.07)	<b>4.38</b> (3.80-4.99)	<b>5.04</b> (4.34-5.72)	<b>5.74</b> (4.91-6.53)	<b>6.47</b> (5.50-7.37)	<b>7.50</b> (6.29-8.54)	<b>8.33</b> (6.92-9.50)
<b>20-day</b>	<b>2.17</b> (1.91-2.47)	<b>2.79</b> (2.46-3.18)	<b>3.69</b> (3.25-4.20)	<b>4.37</b> (3.83-4.96)	<b>5.29</b> (4.62-6.00)	<b>6.00</b> (5.21-6.80)	<b>6.72</b> (5.81-7.63)	<b>7.45</b> (6.41-8.47)	<b>8.44</b> (7.20-9.61)	<b>9.20</b> (7.79-10.5)
<b>30-day</b>	<b>2.54</b> (2.23-2.89)	<b>3.27</b> (2.87-3.72)	<b>4.31</b> (3.78-4.90)	<b>5.11</b> (4.47-5.79)	<b>6.17</b> (5.37-7.00)	<b>7.00</b> (6.07-7.92)	<b>7.84</b> (6.77-8.87)	<b>8.70</b> (7.47-9.83)	<b>9.86</b> (8.40-11.2)	<b>10.7</b> (9.10-12.2)
<b>45-day</b>	<b>2.93</b> (2.59-3.32)	<b>3.78</b> (3.33-4.28)	<b>4.98</b> (4.39-5.64)	<b>5.87</b> (5.17-6.64)	<b>7.05</b> (6.18-7.97)	<b>7.94</b> (6.93-8.98)	<b>8.84</b> (7.68-10.00)	<b>9.74</b> (8.43-11.0)	<b>10.9</b> (9.39-12.4)	<b>11.8</b> (10.1-13.5)
<b>60-day</b>	<b>3.23</b> (2.86-3.64)	<b>4.17</b> (3.70-4.71)	<b>5.49</b> (4.86-6.19)	<b>6.45</b> (5.70-7.28)	<b>7.71</b> (6.79-8.68)	<b>8.64</b> (7.57-9.73)	<b>9.57</b> (8.36-10.8)	<b>10.5</b> (9.12-11.8)	<b>11.7</b> (10.1-13.2)	<b>12.6</b> (10.8-14.3)

<sup>1</sup> Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.





[Back to Top](#)

**PF graphical**



PDS-based depth-duration-frequency (DDF) curves


Latitude: 33.5306°, Longitude: -111.9293°

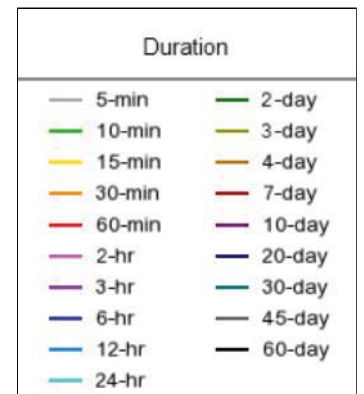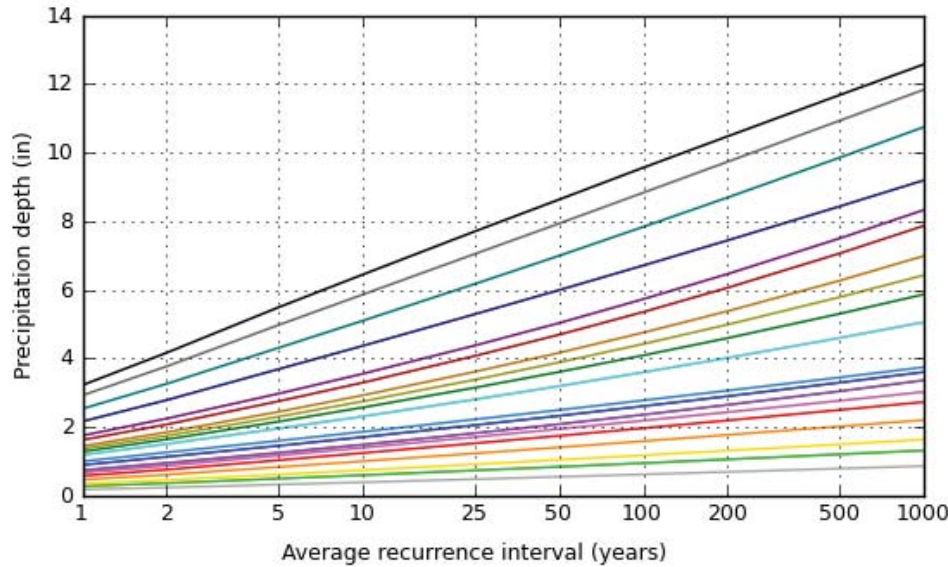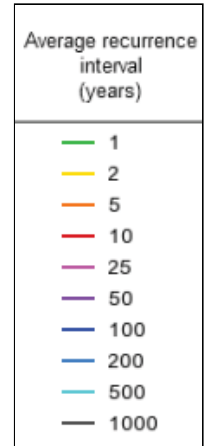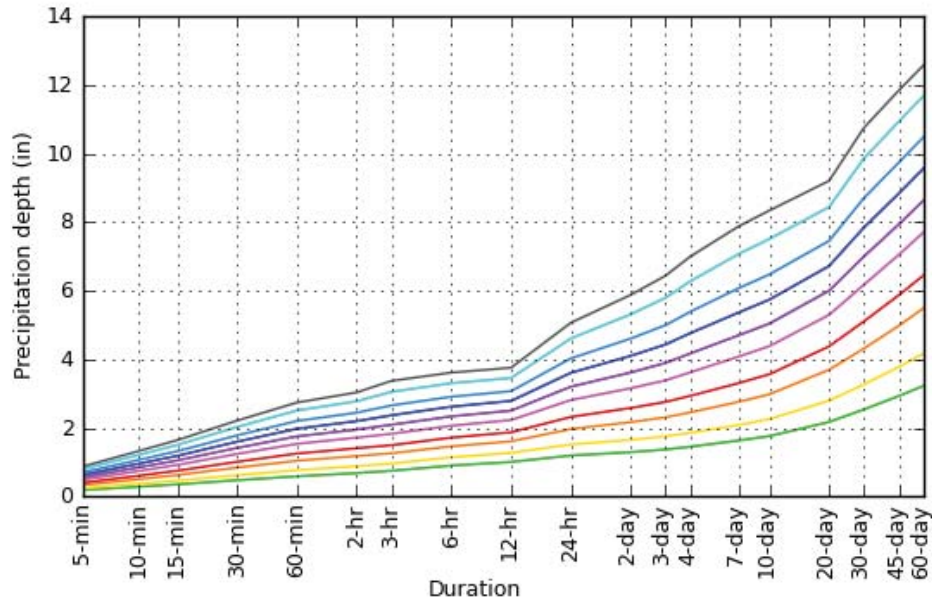

[Back to Top](#)

**Maps & aerials**

**Small scale terrain**

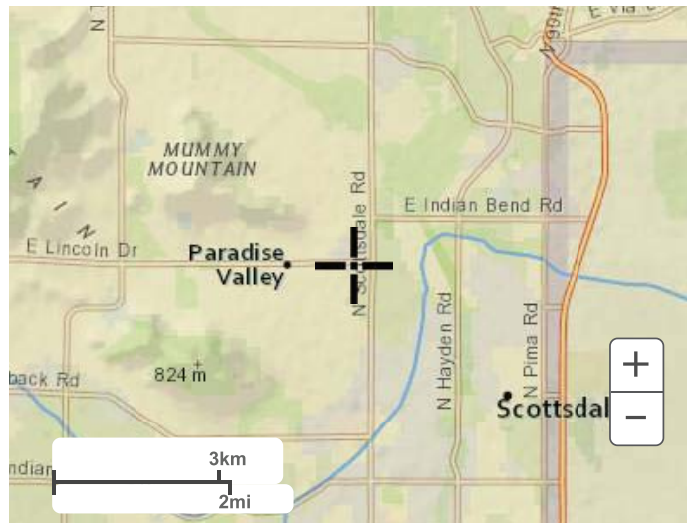

Large scale terrain



Large scale map



Large scale aerial

# **APPENDIX B**

## **Runoff Coefficients, Retention and Drywell Calculations**

Used for Post-Development Conditions

**RUNOFF CO-EFFICIENTS FOR USE WITH THE RATIONAL FORMULA  $Q = CIA$**

<u>Land Use</u>	<u>"C" Value</u>
Paved Street or Parking Lot	0.95
Commercial Areas	0.90
Residential Areas (Average lot zoning)	0.45
Townhouses	0.55
Apartments and Condominiums	0.65
Parks and Grassed Areas (no irrigation)	0.20
Railroad Yards	0.25
Undeveloped Desert	0.35
Mountain Terrain — slopes greater than 10%	0.70
Industrial Areas	0.90
Agricultural Areas	0.20

Used for Pre-Development Conditions

## SMOKE TREE RESORT Retention Volume Calculations

Pre vs. Post										
Development Condition	Drainage <sup>(1)</sup> Area A (acres)	Drainage <sup>(1)</sup> Area A (feet <sup>2</sup> )	Runoff <sup>(2)</sup> Coefficient C	Precipitation <sup>(3)</sup> Depth P (inches)	Volume <sup>(4)</sup> Required V <sub>req</sub> (acre-ft)	Volume <sup>(4)</sup> Required V <sub>req</sub> (cubic feet)	Retention Basin/Tank ID	12' Dia. Underground Tank (LF)	Volume <sup>(5)</sup> Provided V <sub>prov</sub> (acre-ft)	Volume <sup>(5)</sup> Provided V <sub>prov</sub> (cubic feet)
<b>PRE</b>	4.89	212,908	0.90	2.19	0.80	<b>34,970</b>				
<b>POST</b>			0.55	2.19	0.49	<b>21,371</b>	<b>RET</b>	121	0.31	<b>13,685</b>
<b>DIFFERENCE</b>					<b>0.31</b>	<b>13,600</b>			<b>0.31</b>	<b>13,685</b>

**Reference:** [1] Storm Drain Design Manual for Town of Paradise Valley (1987)

**Notes:**

1. Drainage sub-basin delineated per Drainage Map (Plate 1).
2. Runoff coefficient values of 0.55 for Townhomes and 0.90 for Commercial per Town of Paradise Valley Storm Drain Design Manual (see Appendix B).
3. Precipitation depth per NOAA Atlas 14 rainfall data (see Appendix A).
4.  $V_{req} = A \times C \times (P/12) =$  Volume required
5.  $V_{prov} = 12' \text{ Diameter Pipe LF} \times \pi (6')^2$

## SMOKE TREE RESORT Drywell Calculations

Retention Basin ID	Volume Required to Drain <sup>(2)</sup> (ft <sup>3</sup> )	Soil Infiltration Rate <sup>(3)</sup> (ft <sup>3</sup> /hr/ft <sup>2</sup> )	Flowrate Required to Drain Within 36 hrs <sup>(4)</sup> (cfs)	Drywell Flow Rate <sup>(5)</sup> (cfs)	Number Of Drywells Required <sup>(6)</sup>	Number Of Drywells Provided*
RET	13,685	0.00	0.11	0.10	2	1
				<b>TOTAL</b>	<b>2</b>	<b>1</b>

**Notes:**


- (1) Bottom area per preliminary grading and drainage plans prepared by CVL Consultants, Inc.
- (2) Volume required to drain = Volume provided for retention basins.
- (3) Soil infiltration rate at the bottom of a compacted basin is below the minimum requirement of 0.5in/hr per DPSM Std 6.10.12, Hence, no infiltration was assumed.
- (4) Flowrate Required to Drain Basin Within 36 hrs = (Volume Required to Drain)/(36 x 3600)
- (5) Drywell flow rate assumed to be minimum required per DPSM Std 6.10.13. Field test should be performed to calculate actual dry well flow rate.
- (6) (Number Of Dry Well(s) Required)=(Flowrate Required to Drain Basin Within 36 hrs)/(Dry Well Flowrate Capacity)

**Note to contractor:**

\*Initially one drywell will be installed and field tests performed per the DPSM Standard 6.10.12 to check the actual flow rate of drywell.  
 Drywells will be provided and tested until the percolation requirement is achieved per DPSM Standard 6.10.12.  
 The amount of drywells needed shall be changed in accordance to the newly calculated flow rate.

**PLATE**

**CVL**

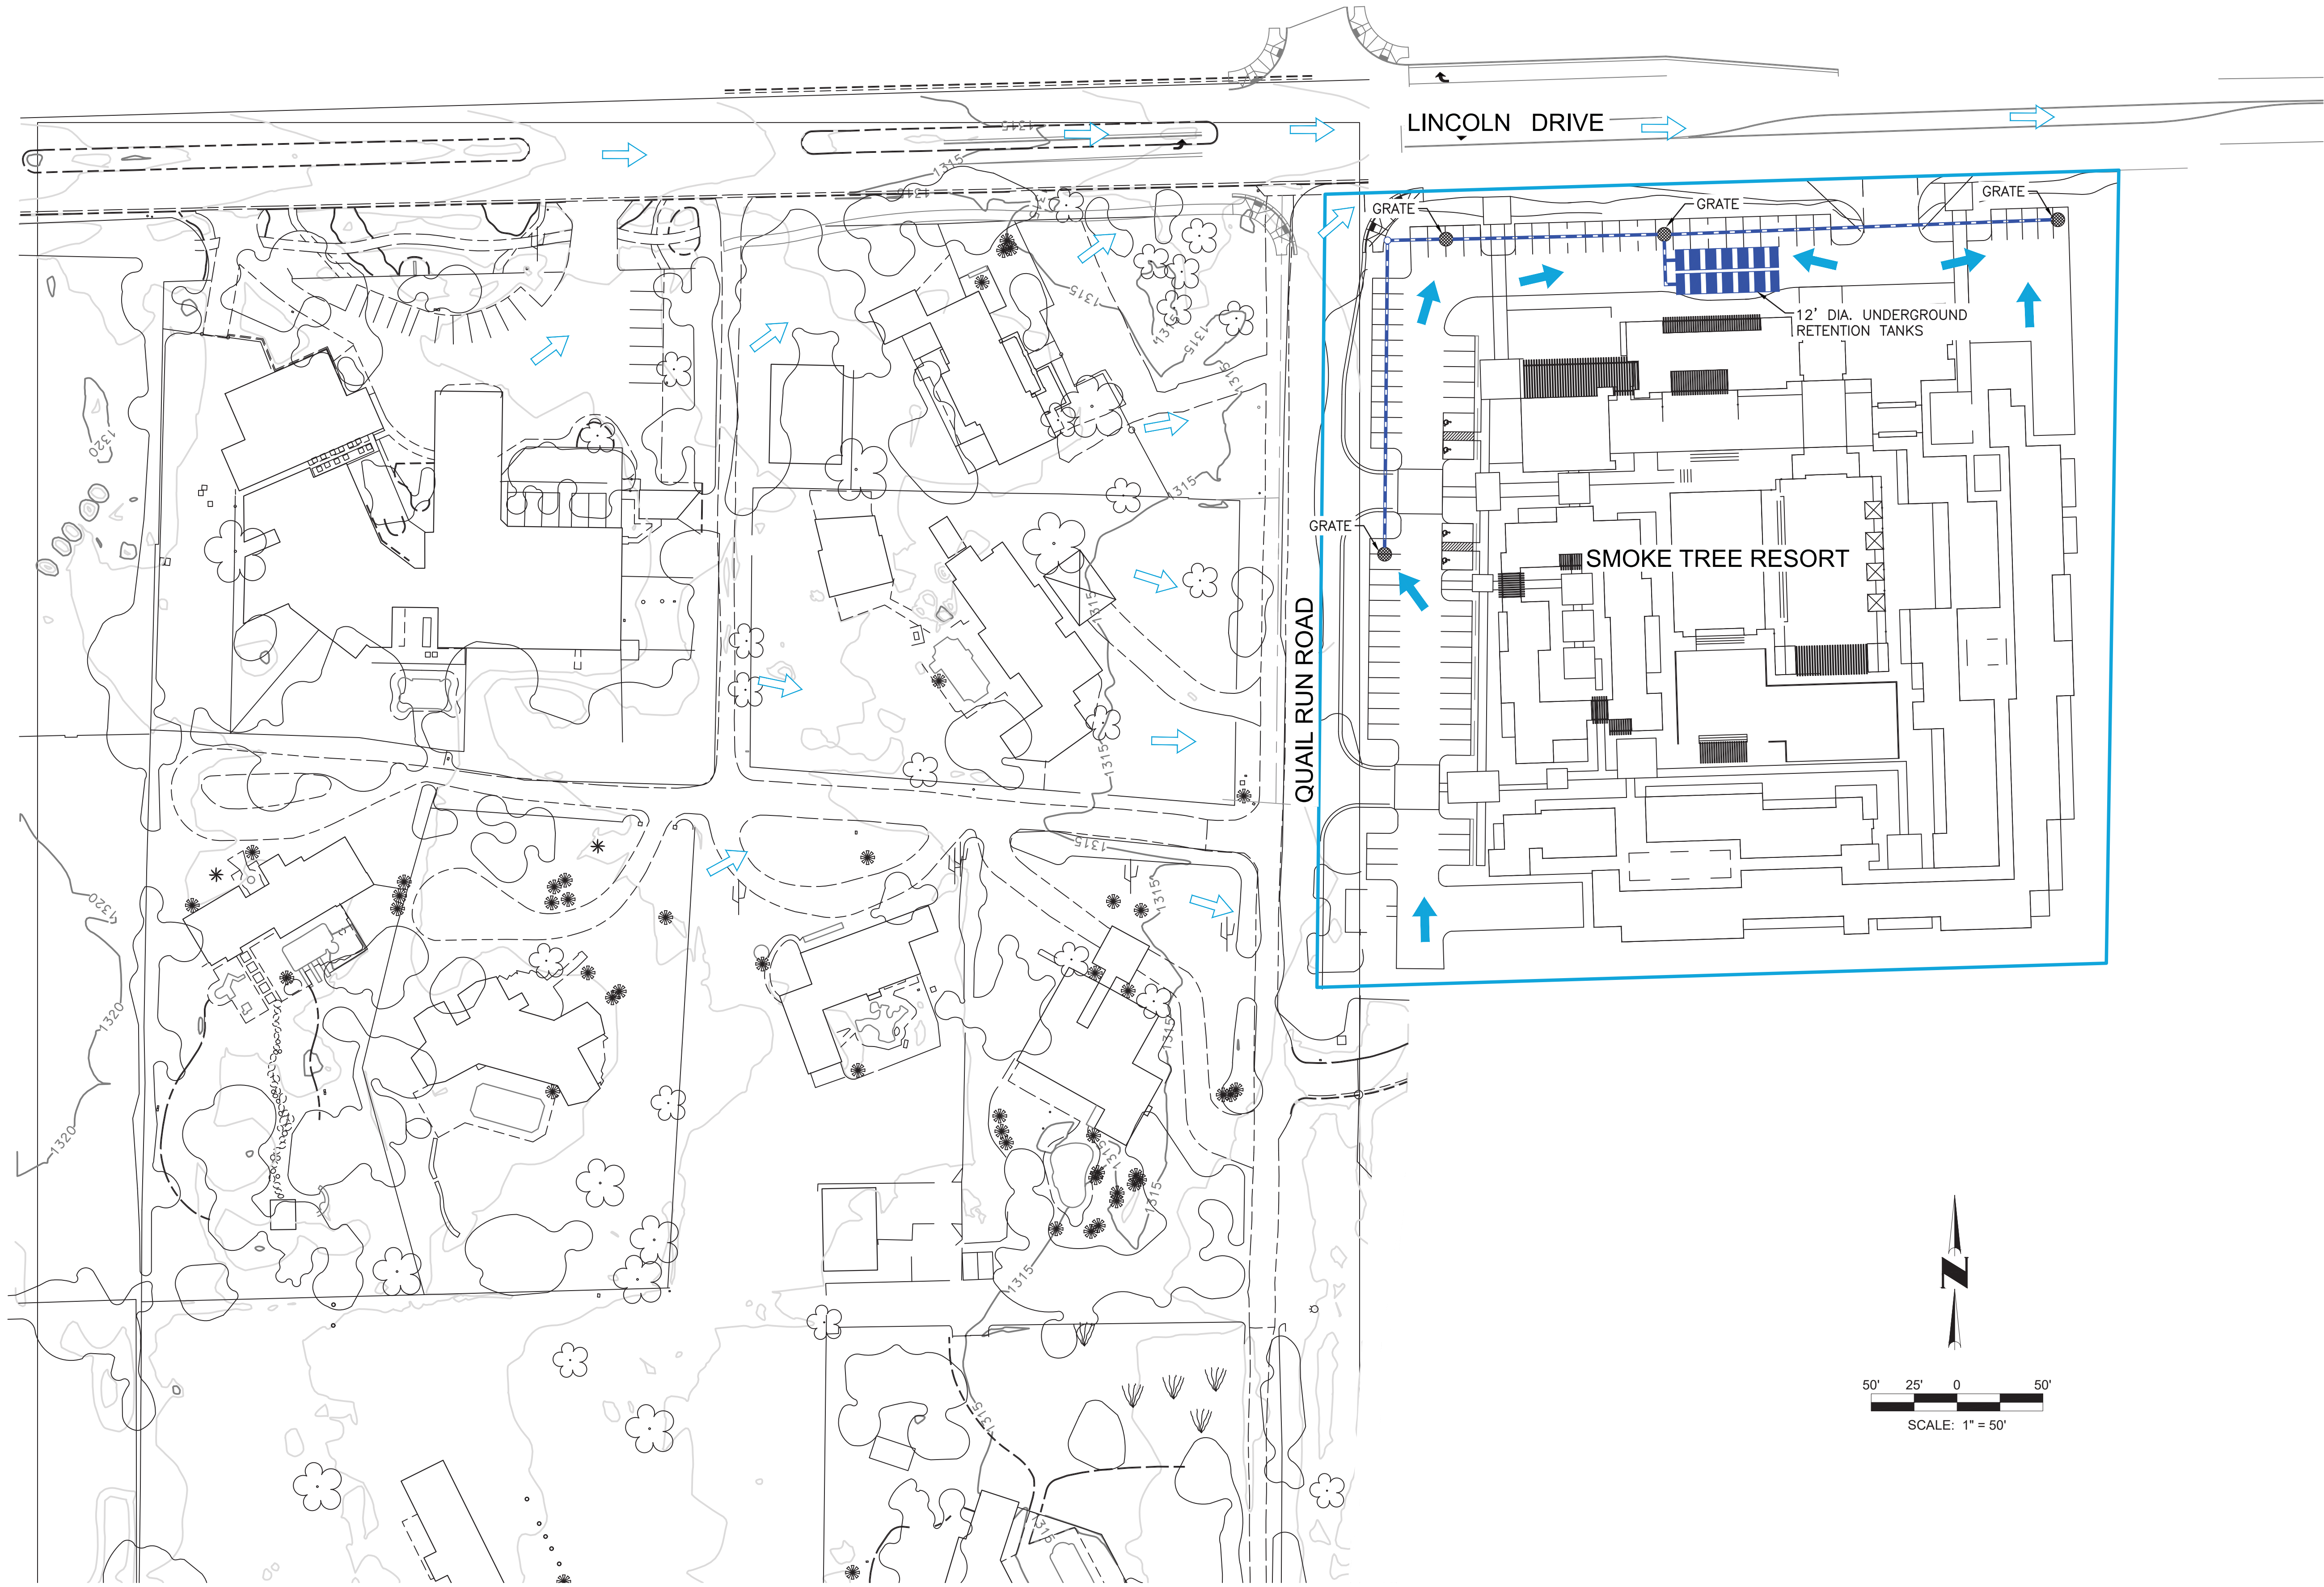

1 SHEET OF 1	PLATE		DRAINAGE MAP	NO.	REVISION	DATE
	SMOKE TREE RESORT TOWN OF PARADISE VALLEY, ARIZONA					