Water Flow Test Record

Input information in non-shaded areas only.

Test Hydrant Number

Location

NW Corner of Jack Rabbit and Casa Blanca Rd, Paradise Valley

Flow Hydrant #1		Flow Hydrant #4	
Flow Hydrant #2		Flow Hydrant #5	
Flow Hydrant #3		Flow Hydrant #6	

Test Data Information

Date	29-Apr-16					
Static Pressure (psig)	76					
Residual Pressure (psig)	70					
Outlet Size (inches)	2.5					
Coefficient	0.9					
Pitot Pressure	65					A
Test Flow (gpm)	**1353**	0	0	0		#VALUE!
Flow (gpm) available @ 20 psi	**4519**	0	0	0		0
Flow (gpm) available @ 10 psi	**4938**	0	0	0		0

Column heading color correlates to line color on the chart

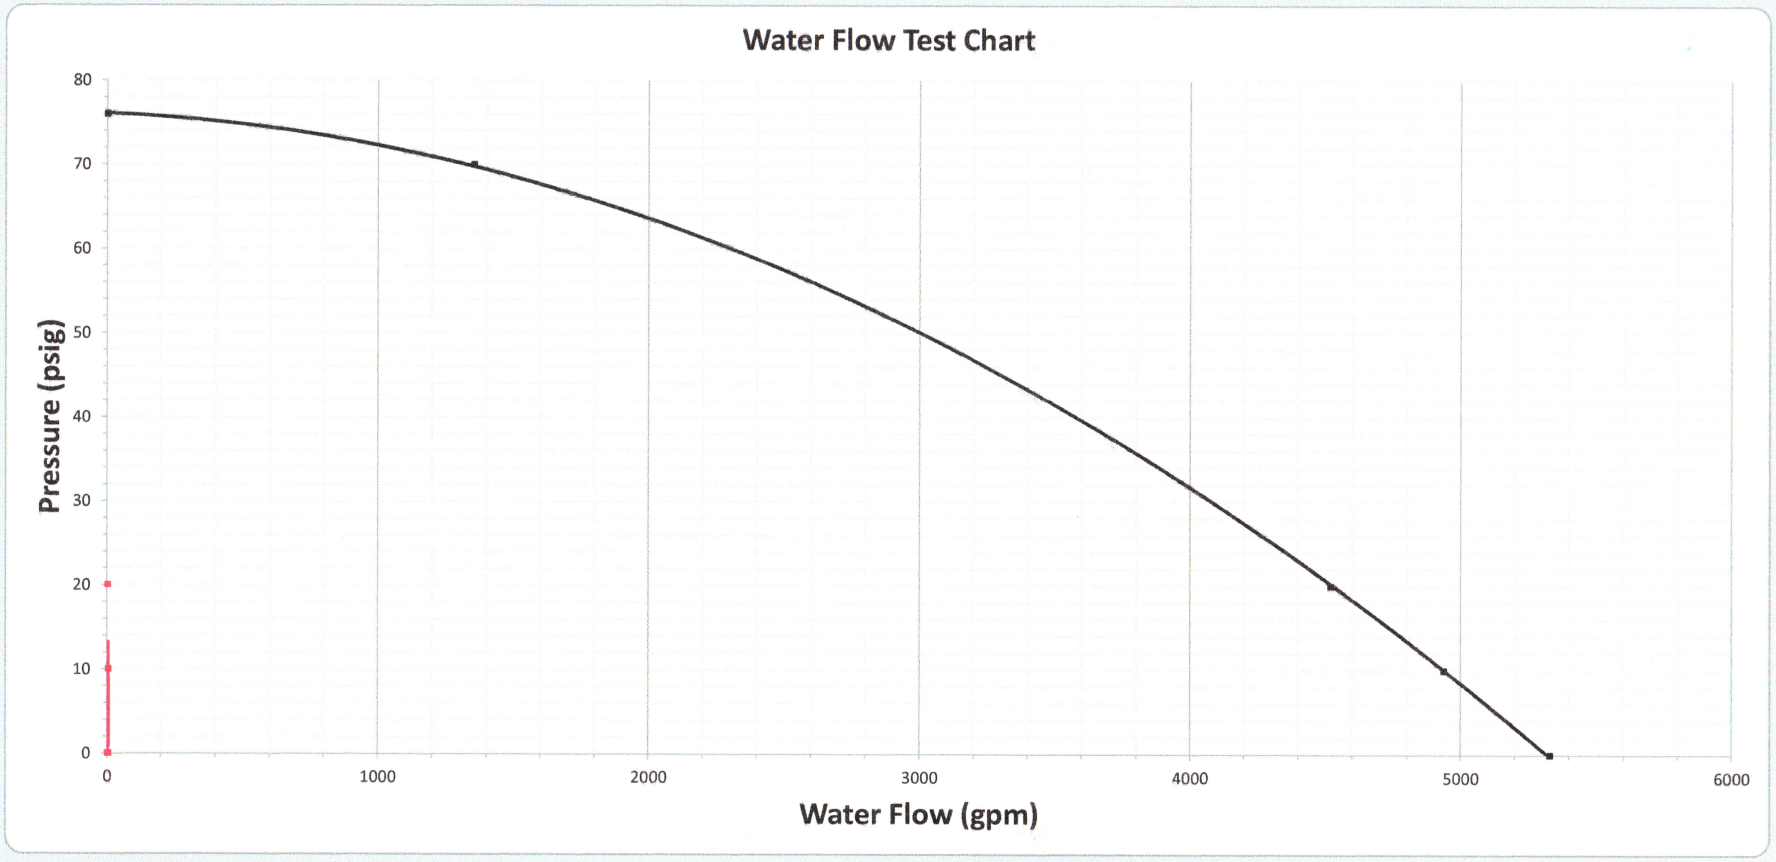

(For multiple test information printed on one chart, color printer required)