

# Water Flow Test Record

Input information in non-shaded areas only.

## Test Hydrant Number

Location

NW Corner of Jack Rabbit and Casa Blanca Rd, Paradise Valley

Flow Hydrant #1

Flow Hydrant #2

Flow Hydrant #3

Flow Hydrant #4

Flow Hydrant #5


Flow Hydrant #6

## Test Data Information

Date	29-Apr-16		
Static Pressure (psig)	76		
Residual Pressure (psig)	70		
Outlet Size (inches)	2.5		
Coefficient	0.9		
Pitot Pressure	65		
Test Flow (gpm)	1353	0	0
Flow (gpm) available @ 20 psi	4519	0	0
Flow (gpm) available @ 10 psi	4938	0	0
			A
			#VALUE!
			0
			0

Column heading color correlates to line color on the chart

## Water Flow Test Chart

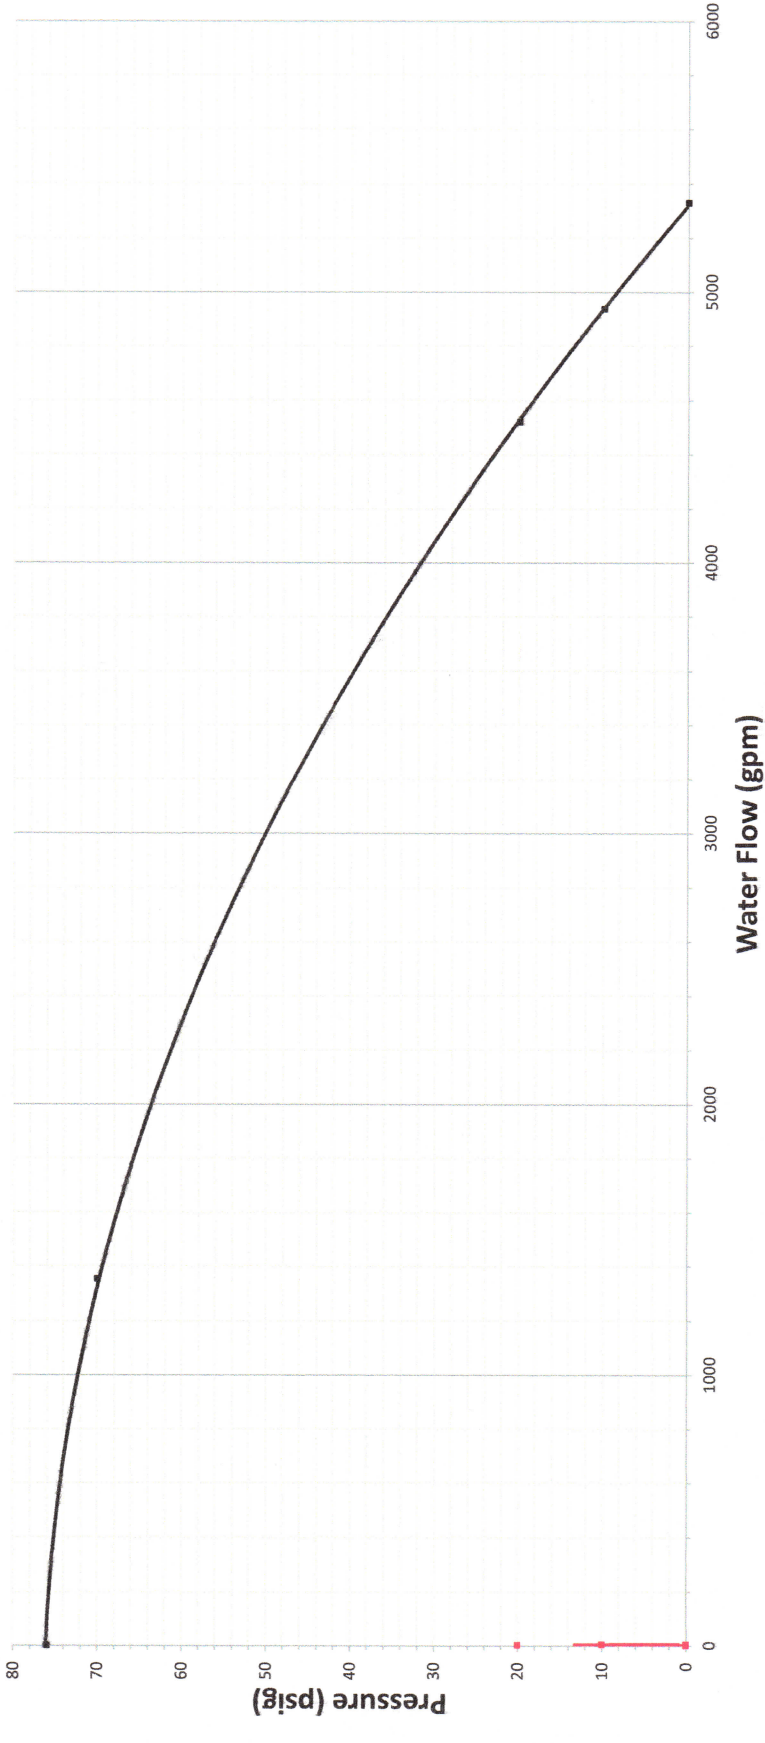

(For multiple test information printed on one chart, color printer required)