

Water Flow Test Record

Input information in non-shaded areas only.

Test Hydrant Number

Location

NW Corner of Jack Rabbit and Casa Blanca Rd, Paradise Valley

Flow Hydrant #1

Flow Hydrant #4

Flow Hydrant #2

Flow Hydrant #5

Flow Hydrant #3


Flow Hydrant #6

Test Data Information

Date	29-Apr-16
Static Pressure (psig)	76
Residual Pressure (psig)	70
Outlet Size (inches)	2.5
Coefficient	0.9
Pitot Pressure	65
Test Flow (gpm)	1353
Flow (gpm) available @ 20 psi	4519
Flow (gpm) available @ 10 psi	4938
	0
	0
	0
	0
	0
	A
	#VALUE!
	0
	0

Column heading color correlates to line color on the chart

Water Flow Test Chart

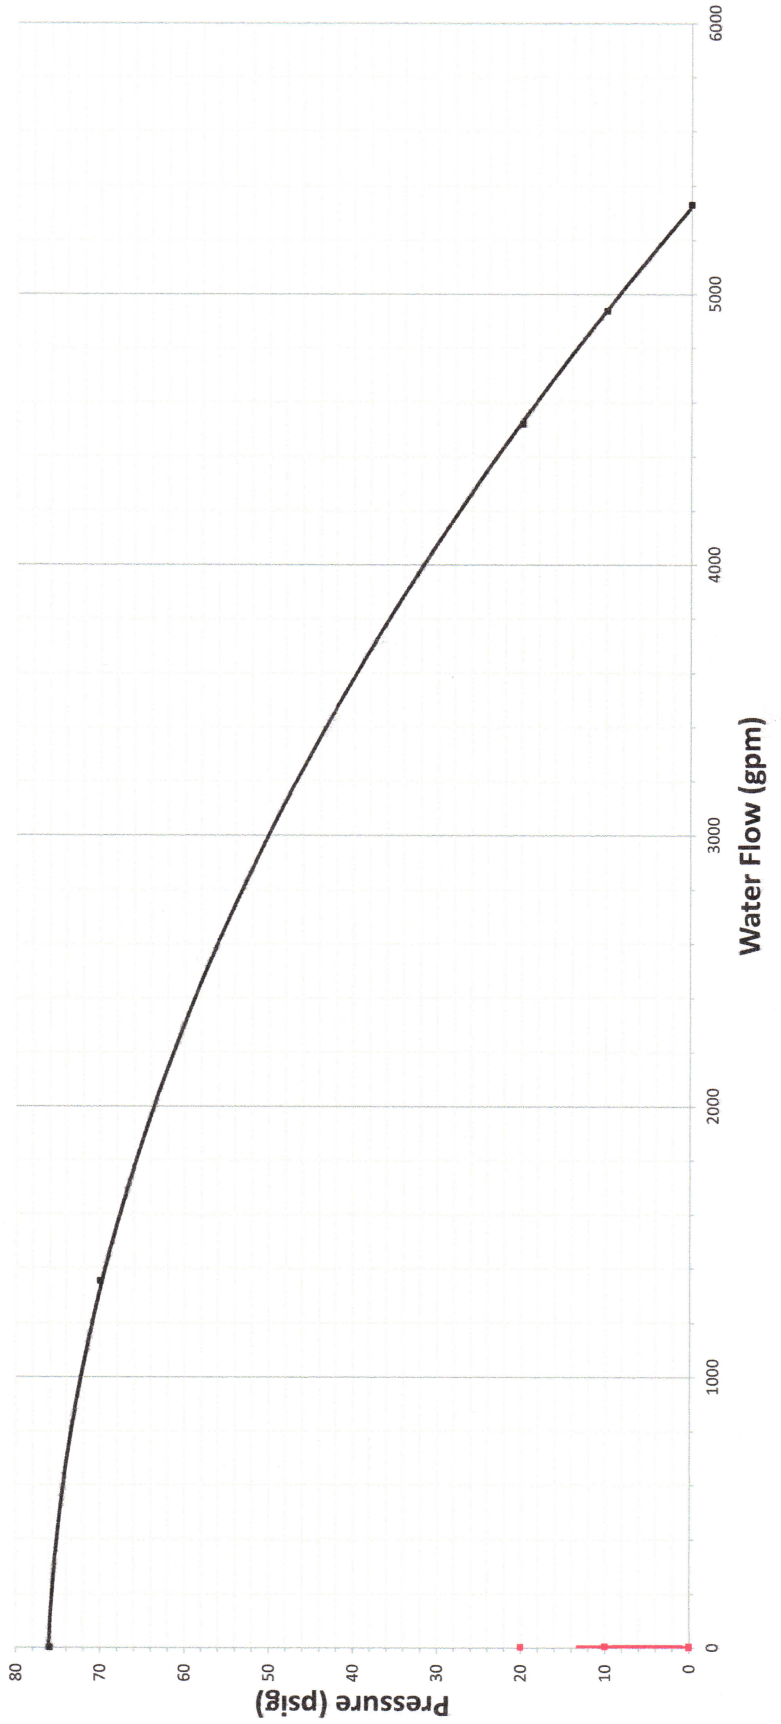

(For multiple test information printed on one chart, color printer required)