



*RENDERING REPRESENTS AN ARCHITECTURAL CONCEPT AND IS INTENDED AS AN ILLUSTRATIVE EXAMPLE ONLY. FINAL DESIGN, CONSTRUCTION AND MATERIALS, INCLUDING LANDSCAPE, MAY VARY.

ROAD RUNNER RESIDENCE - FINAL HILLSIDE REVIEW

5611 E ROAD RUNNER LN
PARADISE VALLEY 85253
Project No. 25-16

SHEET INDEX


HS-0 COVER SHEET	HS-17 SITE PHOTOS	L3.3 ENLARGED PLANTING PLAN
C-1 GRADING & DRAINAGE PLAN COVER SHEET	HS-18 MATERIALS BOARD	L4.1 IRRIGATION PLAN
C-2 GRADING & DRAINAGE IMPROVEMENT PLAN	HS-19 LOWER LEVEL CUT/FILL	L5.1 LIGHTING PLAN
	HS-20 MAIN LEVEL CUT/FILL	L7.1 PLANTING DETAILS
	HS-21 3D TOPO OFFSET	L8.1 PLANTING SPECIFICATIONS
		L8.2 IRRIGATION SPECIFICATIONS
S0.0 HILLSIDE GENERAL STRUCTURAL NOTES AND DETAILS		
HS-1 AERIAL OVERLAY - EXISTING SITE CONDITIONS	EL 1 LIGHTING MAIN FLOOR PLAN (OVERALL)	
HS-2 AERIAL OVERLAY	EL 2 LIGHTING MAIN FLOOR PLAN (CONTD)	
HS-3 AERIAL OVERLAY	EL 3 LIGHTING MAIN FLOOR PLAN (CONTD)	
HS-4 ARCHITECTURAL SITE PLAN	EL 4 LIGHTING MAIN FLOOR PLAN (CONTD)	
HS-5 ELEVATIONS	EL 5 LIGHTING MAIN FLOOR PLAN (CONTD)	
HS-6 LOWER LEVEL FLOOR PLAN	EL 6 LIGHTING LOWER AND GUEST FLOOR PLAN	
HS-7 MAIN LEVEL FLOOR PLAN	EL 7 LIGHTING FIXTURES SCHEDULES	
HS-8 SITE SECTIONS	EL 8 LIGHTING FIXTURES SCHEDULES	
HS-9 SITE SECTIONS		
HS-10 EXTERIOR RENDERING	L0.0 LANDSCAPE COVER	
HS-11 EXTERIOR RENDERING	L2.0A NATIVE PLANT INVENTORY	
HS-12 EXTERIOR RENDERING	L2.0B NATIVE PLANT INVENTORY	
HS-13 EXTERIOR RENDERING	L2.1 OVERALL LAYOUT PLAN	
HS-14 EXTERIOR RENDERING	L2.2 ENLARGED LAYOUT PLAN	
HS-15 EXTERIOR RENDERING	L2.3 ENLARGED LAYOUT PLAN	
HS-16 EXTERIOR RENDERING	L3.1 OVERALL PLANTING PLAN	
	L3.2 ENLARGED PLANTING PLAN	

NEW HILLSIDE CUSTOM
HOME & CASITA FOR FAMILY

DISTURBANCE CALCS

LOT SIZE:	=221,685 SF
ALLOWABLE FAR -25%	=55,421 SF
PROPOSED FAR	=28,882 SF
BUILDING PAD SLOPE	=18.6%
EXISTING DISTURBED	=86,658 SF
PROPOSED DISTURBANCE AREA	=80,342 SF

VICINITY MAP

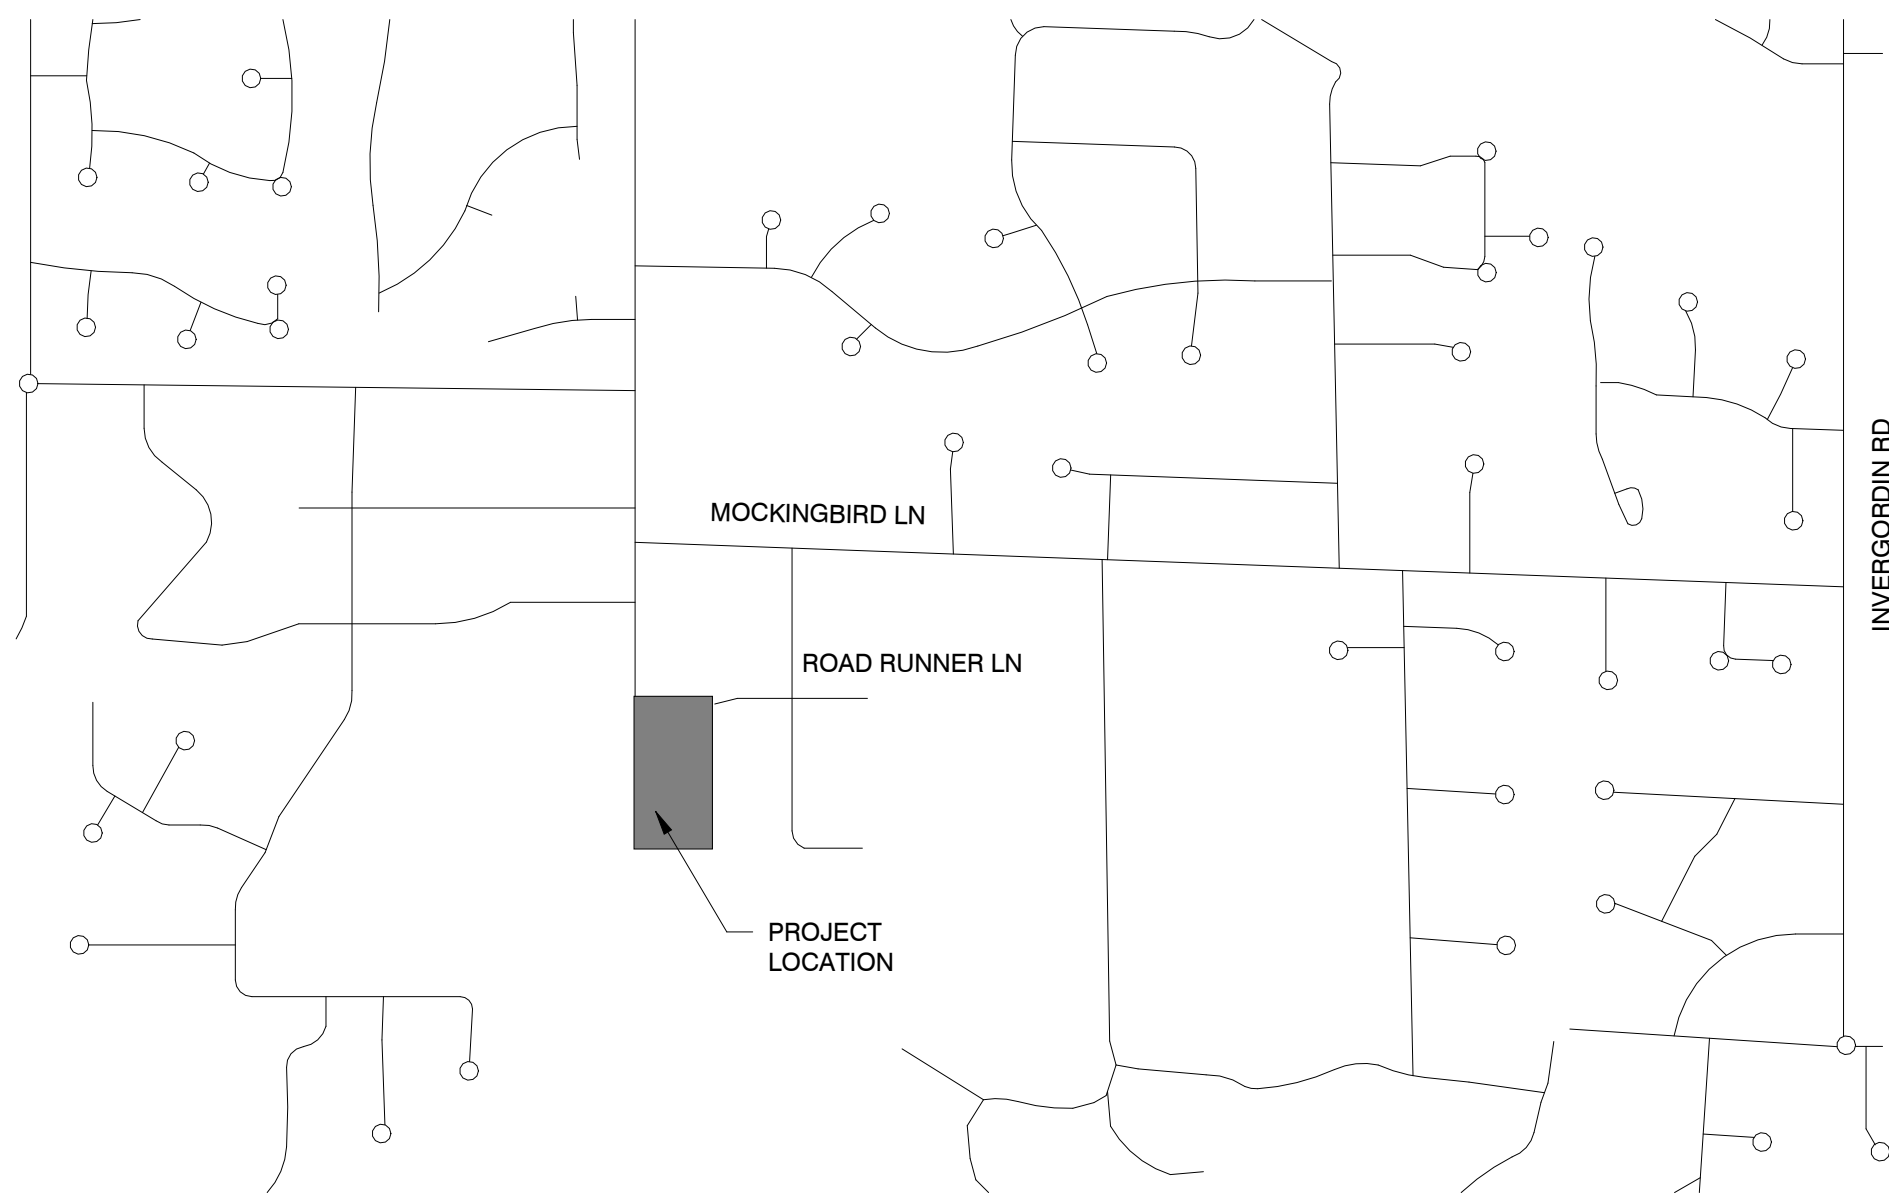

FDR	FINAL HILLSIDE
DATE	4.21.2026
REV.	

COVER SHEET

HS-0

OF SHEETS

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

TOWN OF PARADISE VALLEY NOTES

1. GRADING SHALL BE IN CONFORMANCE WITH 2018 IBC.
2. PRIOR TO FIRST FOOTING INSPECTION OF ANY TYPE, ALL PROPERTY PINS SHALL BE PLACED BY A REGISTERED LAND SURVEYOR OF THE STATE OF ARIZONA, AND PROPERTY LINES MUST BE PHYSICALLY IDENTIFIED PRIOR TO INSPECTION.
3. WHERE EXCAVATION IS TO OCCUR THE TOP 4" OF EXCAVATED NATIVE SOIL SHALL REMAIN ON THE SITE AND SHALL BE REUSED IN A MANNER THAT TAKES ADVANTAGE OF THE NATURAL SOIL. SEED BANK IT CONTAINS.
4. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST MARICOPA ASSOCIATION OF GOVERNMENTS (M.A.G.) SPECIFICATIONS AND STANDARD DETAILS.
5. ALL EXTERIOR SITE LIGHTING SHALL COMPLY WITH REQUIREMENTS OF SECTION 2208 OF THE TOWN OF PARADISE VALLEY ZONING ORDINANCES FOR FUTURE TYPE, LOCATION, HEIGHT, WATTAGE BASED UPON FIXTURES INSTALLED.
6. A DUST CONTROL PLAN MEETING THE REQUIREMENTS OF RULE 310 OF THE MARICOPA COUNTY AIR POLLUTION CONTROL REGULATIONS, AS AMENDED, IS REQUIRED.
7. A SEPARATE PERMIT IS NECESSARY FOR ANY OFFSITE CONSTRUCTION.
8. AN APPROVED GRADING AND DRAINAGE PLAN SHALL BE ON THE JOB SITE AT ALL TIMES. DEVIATIONS FROM THE PLAN MUST BE PRECEDED BY AN APPROVED PLAN REVISION.
9. EAVE PROJECTIONS INTO REQUIRED SETBACKS ARE LIMITED TO A MAXIMUM OF 24" PURSUANT TO SECTION 100B OF THE TOWN OF PARADISE VALLEY ZONING ORDINANCES.
10. ALL STRUCTURES AND LANDSCAPING WITHIN THE SIGHT VISIBILITY TRIANGLE SHALL HAVE A 2 FOOT MAXIMUM HEIGHT.
11. ALL NEW AND EXISTING ELECTRICAL SERVICE TO BE BURIED UNDERGROUND PER THE TOWN OF PARADISE VALLEY STANDARDS.
12. POOL, SPA, BARBECUE AND ANY PROPOSED STRUCTURES OVER 8 INCHES ABOVE GRADE REQUIRE SEPARATE PERMIT APPLICATIONS.
13. POOLS SHALL BE CONSTRUCTED BY SEPARATE PERMIT AND SECURED FROM UNWANTED ACCESS PER SECTION 5-2-2 OF THE TOWN OF PARADISE VALLEY STANDARDS.
14. A SETBACK CERTIFICATION IS REQUIRED AND MUST BE GIVEN TO TOWN INSPECTOR AT STEM WALL INSPECTION.
15. MAIL BOX TO COMPLY WITH THE TOWN OF PARADISE VALLEY STANDARDS FOR MAIL BOXES IN THE R.O.W. FOR HEIGHT, WIDTH AND BREAK AWAY FEATURES.
16. ALL PATIOS, WALKS, AND DRIVES TO SLOPE AWAY FROM BUILDING AND GARAGES AT A MINIMUM SLOPE OF 1/4" PER FOOT UNLESS SPECIFIED OTHERWISE. ALL LAWN AREAS ADJOINING WALKS OR SLABS WILL BE GRADED TO 2" BELOW THE TOP OF SLAB. TYPICAL FINISHED GRADE AROUND PERIMETER OF BUILDING IS MINUS 6" BELOW FINISHED FLOOR UNLESS SPECIFIED OTHERWISE.
17. ALL MATERIAL TO BE UNDER SLABS AND WALKS SHALL BE COMPACTED TO NOT LESS THAN 95% PER ASTM D698.
18. SOILS COMPACTION TEST RESULTS MUST BE SUBMITTED TO THE TOWN ENGINEER'S OFFICE FOR BUILDING PADS THAT HAVE ONE (1) FOOT OR MORE OF FILL MATERIAL INDICATED. THIS INFORMATION MUST BE SUPPLIED PRIOR TO REQUEST FOR FINAL INSPECTION.
19. TRENCH BED SHALL BE FREE OF ROCKS AND DEBRIS.
20. LOWEST FLOOR ELEVATION CERTIFICATE (LFE) IS REQUIRED AND SHALL BE UPLOADED TO YOUR PERMIT DOCUMENTS PRIOR TO SCHEDULING OF STRAP SHEAR INSPECTION.
21. REGULATION II RULE 20-3 OF THE MARICOPA COUNTY HEALTH DEPARTMENT, BUREAU OF AIR POLLUTION CONTROL SHALL BE OBSERVED AND ENFORCED.
22. ALL WORK REQUIRED TO COMPLETE THE CONSTRUCTION COVERED BY THIS PLAN SHALL BE IN ACCORDANCE WITH THE M.A.G. STANDARD SPECIFICATIONS AND DETAILS AND CURRENT SUPPLEMENTS THEREOF PER THE LOCAL CITY OR TOWN UNLESS SPECIFIED OTHERWISE IN THESE PLANS OR ELSEWHERE IN THE CONTRACT DOCUMENTS. CONTRACTORS SHALL FAMILIARIZE THEMSELVES WITH ALL REQUIRED STANDARD SPECIFICATIONS, DETAILS AND SUPPLEMENTS PRIOR TO BIDDING THE WORK FOR THE CONSTRUCTION COVERED BY THIS PLAN.
23. THE CONTRACTOR IS TO COMPLY WITH ALL LOCAL STATE, AND FEDERAL LAWS AND REGULATIONS APPLICABLE TO THE CONSTRUCTION COVERED BY THIS PLAN.
24. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND COMPLYING WITH ALL PERMITS REQUIRED TO COMPLETE ALL WORK COVERED BY THIS PLAN.
25. ALL CONSTRUCTION IN THE PUBLIC RIGHTS-OF-WAY OR IN EASEMENTS GRANTED FOR PUBLIC USE MUST CONFORM TO THE LATEST MARICOPA ASSOCIATION OF GOVERNMENTS (MAG) UNIFORM STANDARD SPECIFICATIONS AND UNIFORM STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION.
26. THE TOWN ONLY APPROVES THE SCOPE, NOT THE DETAIL, OF ENGINEERING DESIGNS; THEREFORE, IF CONSTRUCTION QUANTITIES ARE SHOWN ON THESE PLANS, THEY ARE NOT VERIFIED BY THE TOWN.
27. THE APPROVAL OF PLANS IS VALID FOR SIX (6) MONTHS. IF AN ENCROACHMENT PERMIT FOR THE CONSTRUCTION HAS NOT BEEN ISSUED WITHIN SIX MONTHS, THE PLANS MUST BE RESUBMITTED TO THE TOWN FOR RE-APPROVAL.
28. A PUBLIC WORKS INSPECTOR WILL INSPECT ALL WORKS WITHIN THE TOWN OF PARADISE VALLEY RIGHTS-OF-WAY AND IN EASEMENTS. INSPECTOR INSPECTION SERVICES 24 HOURS PRIOR TO BEGINNING CONSTRUCTION BY CALLING 480-312-5750.
29. WHENEVER EXCAVATION IS NECESSARY, CALL THE BLUE STAKE CENTER, 602-263-1100, TWO WORKING DAYS BEFORE EXCAVATION BEGINS. THE CENTER WILL SEE THAT THE LOCATION OF THE UNDERGROUND UTILITY LINES IS IDENTIFIED FOR THE PROJECT. CALL "COLLECT" IF NECESSARY.
30. ENCROACHMENT PERMITS ARE REQUIRED FOR ALL WORK IN PUBLIC RIGHTS-OF-WAY AND EASEMENTS GRANTED FOR PUBLIC PURPOSES. AN ENCROACHMENT PERMIT WILL BE ISSUED BY THE TOWN ONLY AFTER THE REGISTRANT HAS PAID A BASE FEE PLUS A FEE FOR INSPECTION SERVICES. COPIES OF ALL PERMITS MUST BE RETAINED ON-SITE AND BE AVAILABLE FOR INSPECTION AT ALL TIMES. FAILURE TO PROVIDE THE REQUIRED PERMITS WILL RESULT IN IMMEDIATE SUSPENSION OF ALL WORK UNTIL THE PROPER PERMIT DOCUMENTATION IS OBTAINED.
31. ALL EXCAVATION AND GRADING THAT IS NOT IN THE PUBLIC RIGHTS-OF-WAY OR NOT IN EASEMENTS GRANTED FOR PUBLIC USE MUST CONFORM TO CHAPTER 70, EXCAVATION AND GRADING, OF THE LATEST EDITION OF THE IBC BY THE ICC. A PERMIT FOR THIS GRADING MUST BE SECURED FROM THE TOWN FOR A FEE ESTABLISHED BY THE UNIFORM BUILDING CODE.
32. EXCAVATIONS SHALL COMPLY WITH REQUIREMENTS OF OSHA EXCAVATION STANDARDS (29 CFR, PART 1926, SUBPART P). UNDER NO CIRCUMSTANCES WILL THE CONTRACTORS BE ALLOWED TO WORK IN A TRENCH LOCATED WITHIN THE TOWN'S RIGHT-OF-WAY WITHOUT PROPER SHORING OR EXCAVATION METHODS.
33. ON DEMOLITION, GRADING, REMODELING AND NEW CONSTRUCTION PROJECTS, PERMITTEE MUST NOTIFY ADJACENT PROPERTY OWNERS REGARDING THE NATURE OF THE PROJECT, THE TIME PERIOD FOR CONSTRUCTION, AND ANY UNUSUAL ACTIVITIES THAT MAY CAUSE DISRUPTION OF THE NORMAL COURSE OF TRAFFIC DURING CONSTRUCTION.
34. ALL PERMITTEES MUST POST A 6 SQUARE FOOT (2'x3') IDENTIFICATION SIGN, MADE OF DURABLE MATERIAL, IN THE FRONT YARD OF SUBJECT PROPERTY AND NOT IN THE TOWN RIGHT-OF-WAY. THE SIGN MAY NOT EXCEED A MAXIMUM OF 6 FEET IN HEIGHT FROM GRADE TO TOP OF THE SIGN. THE SIGN MUST INCLUDE THE PERMITTEE OR COMPANY NAME, PHONE NUMBER, TYPE OF WORK, AND ADDRESS OF PROJECT.
35. WHEN DEEMED NECESSARY, A 6-FOOT HIGH CHAIN LINK FENCE MUST BE INSTALLED AROUND THE CONSTRUCTION AREA TO PREVENT ANY POTENTIAL SAFETY HAZARD FOR THE PUBLIC. THE FENCE SHALL BE SETBACK AT LEAST 10 FEET FROM ALL RIGHTS-OF-WAY AND HAVE A 50-FOOT STREET CORNER SITE TRIANGLE WHERE APPLICABLE.
36. CLEAR ACCESS FOR NEIGHBORING PROPERTIES AND EMERGENCY VEHICLES MUST BE MAINTAINED AT ALL TIMES. CONSTRUCTION RELATED VEHICLES MUST BE LEGALLY PARKED ONLY ON ONE SIDE OF THE STREET OR JOB SITE PROPERTY. IF A STAGING AREA IS NEEDED ON A PROPERTY OTHER THAN THE CONSTRUCTION SITE FOR CONSTRUCTION SUPPLIES AND EQUIPMENT, THE PERMITTEE MUST OBTAIN PROPERTY OWNER AND TOWN APPROVAL FIRST AND MUST INFORM THE ADJACENT PROPERTY OWNERS OF THE LOCATION OF STAGING AREA, AND TIME AND HOURS DURING THE DAY THE AREA WILL BE USED.
37. EXCEPT AS OUTLINED IN ITEM 4, ALL CONSTRUCTION DEBRIS AND EQUIPMENT MUST BE CONTAINED ON SITE AT ALL TIMES. CONTRACTOR AND PROPERTY OWNER MUST MAINTAIN THE JOB SITE FREE OF LITTER AND UNSIGHTLY MATERIALS AT ALL TIMES. CONSTRUCTION MATERIALS ARE PROHIBITED IN THE TOWN RIGHT-OF-WAY OR NEAR ADJACENT PROPERTIES.
38. BUILDING CONSTRUCTION MUST NOT START SOONER THAN SUNRISE AND MUST STOP NO LATER THAN SUNSET. ALSO, ORDINANCE #661 IMPOSES RESTRICTIONS ON CONSTRUCTION WORK ON SATURDAYS, SUNDAYS AND MAJOR BUSINESS HOLIDAYS. HILLSIDE PROJECTS MAY HAVE ADDITIONAL RESTRICTIONS. EQUIPMENT WITH AUDIBLE REVERSE DIRECTION WARNINGS MUST NOT BE OPERATED PRIOR TO 7:00 A.M.
39. THE USE AND OPERATION OF FUEL-FIRED GENERATORS ON ANY CONSTRUCTION SITE, NEW, EXISTING OR REMODELING, IS PROHIBITED UNLESS DUE TO A HARSHIP TOWN APPROVAL IS OBTAINED.
40. THE CONTRACTOR AND PROPERTY OWNER WILL BE LIABLE FOR ANY DAMAGE DONE TO ANY PUBLIC PROPERTY AS A RESULT OF ANY CONSTRUCTION OR CONSTRUCTION RELATED ACTIVITIES. NO CERTIFICATE OF OCCUPANCY WILL BE ISSUED UNTIL ALL AFFECTED RIGHTS-OF-WAY ARE CLEANED AND/OR REPAIRED TO THEIR ORIGINAL CONDITION AND UNTIL ANY AND ALL DAMAGES TO AFFECTED PROPERTIES ARE RESTORED TO ORIGINAL CONDITION, OR UNTIL SUCH TIME THAT A WRITTEN, SIGNED AND LEGALLY BINDING AGREEMENT HAS BEEN REACHED BY THE PARTIES INVOLVED TO REMEDY ANY VIOLATION WITHIN A REASONABLE TIME PERIOD, AND UNTIL ALL REQUIRED FEES ARE PAID IN FULL.
41. THE NATURAL FLOW OF RAINWATER AND OTHER SURFACE DRAINAGE FROM THE PROPERTY MAY NOT BE ALTERED IN ANY WAY.
42. A KEY SWITCH SHALL BE REQUIRED ON ALL NEW AND EXISTING ELECTRIC ENTRY CONTROL GATES. THE KEY SWITCH SHALL BE INSTALLED IN A LOCATION ON THE GATE CONTROL PANEL THAT IS READILY VISIBLE AND ACCESSIBLE. KNOX BOX ORDER FORMS ARE AVAILABLE AT THE PARADISE VALLEY BUILDING DEPARTMENT.
43. ALL EQUIPMENT OF ALL TRADES ON OR AFFECTING THE JOB MUST BE CLEANED ONLY IN A PRE-DETERMINED AND DESIGNATED AREA. DEBRIS AND RUNOFF FROM SAID AREA MAY NOT EXTEND BEYOND THE BUILDING AREA.
44. PROPERTY OWNER, BUILDER, OR GENERAL CONTRACTOR WILL BE RESPONSIBLE FOR CONTROLLING DUST FROM THE SITE AT ALL TIMES. ALL MEANS NECESSARY SHALL BE USED BY THE BUILDER OR GENERAL CONTRACTOR TO CONTROL THE EXISTENCE OF DUST CAUSED BY ANY EARTHWORK, SPRAY APPLICATION OF MATERIALS, OR OTHER DUST-CAUSING PRACTICES REQUIRED BY THE CONSTRUCTION PROCESS.
45. AN INSPECTION FEE WILL BE CHARGED IF THE INSPECTION IS REQUIRED AS A RESULT OF A CODE VIOLATION.
46. FOR DEMOLITION INSPECTION OWNER OR PERMITTEE SHALL NOTIFY OSHA FOR ASBESTOS INSPECTION. ALL DEMOLITIONS AND ALL RENOVATION ACTIVITIES THAT WILL DISTURB FRIBLE ASBESTOS CONTAINING MATERIALS MUST BE REPORTED TO THE MARICOPA COUNTY ENVIRONMENTAL SERVICES DEPARTMENT.

ENGINEERS NOTES

1. MARICOPA ASSOCIATION OF GOVERNMENTS (M.A.G.) UNIFORM STANDARD SPECIFICATIONS AND DETAILS FOR PUBLIC WORKS CONSTRUCTION (LATEST EDITION INCLUDING LATEST REVISION AND CURRENT SUPPLEMENTS THEREOF PER THE LOCAL TOWN OR CITY) ARE INCORPORATED INTO THIS PLAN IN THEIR ENTIRETY.
2. ALL WORK REQUIRED TO COMPLETE THE CONSTRUCTION COVERED BY THIS PLAN SHALL BE IN ACCORDANCE WITH THE M.A.G. STANDARD SPECIFICATIONS AND DETAILS AND CURRENT SUPPLEMENTS THEREOF PER THE LOCAL CITY OR TOWN UNLESS SPECIFIED OTHERWISE IN THESE PLANS OR ELSEWHERE IN THE CONTRACT DOCUMENTS. CONTRACTORS SHALL FAMILIARIZE THEMSELVES WITH ALL REQUIRED STANDARD SPECIFICATIONS, DETAILS AND SUPPLEMENTS PRIOR TO BIDDING THE WORK FOR THE CONSTRUCTION COVERED BY THIS PLAN.
3. GRADING SHALL BE IN CONFORMANCE WITH 2018 IBC SEC. 1803 AND APPENDIX J.
4. 5% MINIMUM SLOPE AWAY FROM BUILDING FOR A MINIMUM 10', U.N.O.
5. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST MARICOPA ASSOCIATION OF GOVERNMENTS (M.A.G.) SPECIFICATIONS AND STANDARD DETAILS.
6. A DUST CONTROL PLAN MEETING THE REQUIREMENTS OF RULE 310 OF THE MARICOPA COUNTY AIR POLLUTION CONTROL REGULATIONS, AS AMENDED, IS REQUIRED.
7. A SEPARATE PERMIT IS NECESSARY FOR ANY OFFSITE CONSTRUCTION.
8. AN APPROVED GRADING AND DRAINAGE PLAN SHALL BE ON THE JOB SITE AT ALL TIMES. DEVIATIONS FROM THE PLAN MUST BE PRECEDED BY AN APPROVED PLAN REVISION.
9. ALL DRAINAGE PROTECTIVE DEVICES SUCH AS SWALES, INTERCEPTOR DITCHES, PIPES, PROTECTIVE BERMS, BARRIER WALLS, CONCRETE CHANNELS OR OTHER MEASURES DESIGNED TO PROTECT ADJACENT BUILDINGS OR PROPERTY FROM STORM RUNOFF MUST BE COMPLETED PRIOR TO BUILDING CONSTRUCTION.
10. ALL STRUCTURES AND LANDSCAPING WITHIN THE SIGHT VISIBILITY TRIANGLE SHALL HAVE A 2 FOOT MAXIMUM HEIGHT.
11. ALL PATIOS, WALKS, AND DRIVES TO SLOPE AWAY FROM BUILDING AND GARAGES AT A MINIMUM SLOPE OF 1/4" PER FOOT UNLESS SPECIFIED OTHERWISE. ALL LAWN AREAS ADJOINING WALKS OR SLABS WILL BE GRADED TO 2" BELOW THE TOP OF SLAB. TYPICAL FINISHED GRADE AROUND PERIMETER OF BUILDING IS MINUS 6" BELOW FINISHED FLOOR UNLESS SPECIFIED OTHERWISE.
12. ALL MATERIAL TO BE UNDER SLABS AND WALKS SHALL BE COMPACTED TO NOT LESS THAN 95% PER ASTM D698. THE QUANTITIES AND SITE CONDITIONS DEPICTED IN THESE PLANS ARE FOR INFORMATIONAL PURPOSES ONLY AND ARE SUBJECT TO ERROR AND OMISSION. CONTRACTORS SHALL SATISFY THEMSELVES AS TO ACTUAL QUANTITIES AND SITE CONDITIONS PRIOR TO BIDDING THE WORK FOR THE CONSTRUCTION COVERED BY THIS PLAN.
14. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND COMPLYING WITH ALL PERMITS REQUIRED TO COMPLETE ALL WORK COVERED BY THIS PLAN.
15. THE CONTRACTOR IS RESPONSIBLE FOR ALL METHODS, SEQUENCING, AND SAFETY CONCERNS ASSOCIATED WITH THIS PROJECT DURING CONSTRUCTION, UNLESS SPECIFICALLY ADDRESSED OTHERWISE IN THIS PLAN OR ELSEWHERE.
16. A REASONABLE EFFORT HAS BEEN MADE TO SHOW THE LOCATIONS OF EXISTING UNDERGROUND FACILITIES AND UTILITIES IN THE CONSTRUCTION AREA. THE CONTRACTOR IS RESPONSIBLE FOR ANY DAMAGE TO UTILITIES AND/OR FACILITIES CAUSED DURING THEIR CONSTRUCTION OPERATIONS. THE CONTRACTOR SHALL CALL 48 HOURS IN ADVANCE FOR BLUE STAKE (1-800-STAKE-IT) PRIOR TO ANY EXCAVATION.
17. THE CONTRACTOR IS RESPONSIBLE FOR ALL COORDINATION OF CONSTRUCTION AFFECTING UTILITIES AND THE COORDINATION OF ANY NECESSARY UTILITY RELOCATION WORK.
18. ALL PAVING, GRADING, EXCAVATION, TRENCHING, PIPE BEDDING, CUT, FILL AND BACKFILL SHALL COMPLY WITH THE RECOMMENDATIONS SET FORTH IN THE SOILS (GEOTECHNICAL) REPORT FOR THIS PROJECT IN ADDITION TO THE REFERENCED REQUIRED SPECIFICATIONS AND DETAILS.
19. THE CONTRACTOR IS TO VERIFY THE LOCATION AND THE ELEVATIONS OF ALL EXISTING UTILITIES AT POINTS OF TIE-IN PRIOR TO COMMENCING ANY NEW CONSTRUCTION. SHOULD ANY LOCATION OR ELEVATION DIFFER FROM THAT SHOWN ON THESE PLANS, THE CONTRACTOR SHALL CONTACT THE OWNER'S AGENT.
20. CONTRACTOR TO VERIFY AND COORDINATE ALL DIMENSIONS AND SITE LAYOUT WITH ARCHITECTURE'S FINAL SITE PLAN AND FINAL BUILDING DIMENSIONS BEFORE STARTING WORK. REPORT DISCREPANCIES TO OWNER'S AGENT.
21. COORDINATION BETWEEN ALL PARTIES IS ESSENTIAL PART OF CONTRACT.
22. CONTRACTOR IS RESPONSIBLE FOR PROJECT AND SITE CONDITIONS, AND TO WORK WITH WEATHER CONDITIONS AS THE PROJECT SITE MAY BE LOCATED IN A FLOOD PRONE AREA AND SUBJECT TO FLOODING AND ITS HAZARDS.
23. THE CONTRACTOR IS TO VERIFY THE LOCATION, ELEVATION, CONDITION, AND PAVEMENT CROSS-SLOPE OF ALL EXISTING SURFACES AT POINTS OF TIE-IN AND MATCHING, PRIOR TO COMMENCEMENT OF GRADING, PAVING, CURB AND GUTTER, OR OTHER SURFACE CONSTRUCTION. SHOULD EXISTING LOCATIONS, ELEVATIONS, CONDITION, OR PAVEMENT CROSS-SLOPE DIFFER FROM THAT SHOWN ON THESE PLANS, RESULTING IN THE DESIGN INTENT REFLECTED ON THESE PLANS NOT ABLE TO BE CONSTRUCTED, THE CONTRACTOR SHALL NOTIFY THE OWNER'S AGENT IMMEDIATELY FOR DIRECTION ON HOW TO PROCEED PRIOR TO COMMENCEMENT OF CONSTRUCTION. THE CONTRACTOR ACCEPTS RESPONSIBILITY FOR ALL COSTS ASSOCIATED WITH CORRECTIVE ACTION IF THESE PROCEDURES ARE NOT FOLLOWED.
24. CONTRACTOR IS RESPONSIBLE TO COORDINATE UTILITY CROSSINGS AT CULVERT CROSSINGS BEFORE STARTING WORK ON CULVERT. COORDINATE WITH OWNER REPRESENTATIVE. VERIFY UTILITY LINES AND/OR CONDUITS ARE IN PLACE BEFORE STARTING CULVERT WORK.
25. ALL ON-SITE UTILITIES PER OTHERS.
26. THIS PROJECT REQUIRES A REGULAR ONGOING MAINTENANCE PROGRAM FOR THE DESIGNED DRAINAGE SYSTEM(S) TO PRESERVE THE DESIGN INTEGRITY AND THE ABILITY TO PERFORM ITS OPERATIONAL INTENT. FAILURE TO PROVIDE MAINTENANCE WILL JEOPARDIZE THE DRAINAGE SYSTEM(S) PERFORMANCE AND MAY LEAD TO IT'S INABILITY TO PERFORM PROPERLY AND/OR CAUSE DAMAGE ELSEWHERE IN THE PROJECT.
27. IF A DISCREPANCY IS FOUND BETWEEN ENGINEER'S PLAN OR SURVEYOR'S STAKING AND THE ARCHITECTURAL PLAN, ENGINEER SHALL BE NOTIFIED IMMEDIATELY. FAILURE TO NOTIFY ENGINEER SHALL NEGATE ENGINEER'S LIABILITY.
28. ALL DISTURBED AREAS ARE TO BE ROPED AND ROPING MUST MATCH PLAN.
29. VEGETATION OUTSIDE OF CONSTRUCTION AREA TO REMAIN.
30. AREAS OUTSIDE THE WALL AND CUT AND FILL SLOPES SHALL BE REVEGETATED WITH SIMILAR PLANT TYPES AND DENSITIES FOUND ON THE SITE. REVEGETATION SHALL BE COMPLETED PRIOR TO OCCUPANCY AND THE ISSUANCE OF A CERTIFICATE OF OCCUPANCY.
31. MECHANICAL EQUIPMENT SHALL BE SCREENED TO A MINIMUM OF ONE FOOT ABOVE TOP OF EQUIPMENT.
32. ANY FUTURE IMPROVEMENTS SHOWN HEREON SHALL REQUIRE A SEPARATE PERMIT.
33. ANY POINTS OF DRAINAGE CONCENTRATION SHOULD BE PROTECTED AGAINST EROSION WITH NATIVE STONE.
34. THIS PLAN IS DESIGNED TO SHOW SITE GRADING AND DRAINAGE CONTRACTOR SHALL USE THE ARCHITECTURAL SITE PLAN TO DETERMINE FINAL HOUSE, WALL, STEP, ETC., LOCATIONS AND ELEVATIONS.
35. ALL DRAINAGE FACILITIES TO BE MAINTAINED BY HOMEOWNER.
36. SEE ARCHITECTURAL AND STRUCTURAL PLANS FOR SITE AND RETAINING WALLS LAYOUT, DIMENSIONS, AND DETAILS.
37. TOP OF FOOTING ELEVATIONS SHOWN IN PLAN ARE APPROXIMATE ONLY. ACTUAL TOP OF FOOTINGS TO BE DETERMINED AT TIME OF CONSTRUCTION AND TO BE A MINIMUM OF SIX INCHES BELOW EXISTING NATURAL GRADE OR FINISHED GRADE WHICHEVER IS LOWER (TYPICAL).
37. REFER TO ARCHITECTURAL DRAWINGS FOR BUILDING LAYOUT, DIMENSIONS AND ELEVATIONS.
38. REFER TO STRUCTURAL DRAWINGS, DETAILS AND CALCULATIONS FOR ALL PROPOSED RETAINING WALLS.
39. FOR CHANGE IN ELEVATION THAT ARE GREATER THAN 30", PROVIDE 36" HIGH GUARDRAILS FOR TOTAL OF 42" FALL PROTECTION BARRIER U.N.O.
40. CONTRACTOR TO PROVIDE POSITIVE DRAINAGE AWAY FROM STRUCTURE - 5% MIN SLOPE FOR FIRST 10 FEET, U.N.O.
41. ALL WATER AND SEWER LINES AND CONNECTIONS MUST BE INSTALLED PER IPC 2018, MAG AND TOWN OF PARADISE VALLEY SUPPLEMENT TO MAG.
42. WATERPROOF ALL EXTERIOR WALLS 18" ABOVE FINISH GRADE-(BITUTHENE@ 3000 HC MEMBRANE W/ GRACE PROTECTION 03 OR APPROVED EQUAL).
43. ALL PIPES AND FITTINGS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS AND DETAILS.
44. ABANDONMENT OF EXISTING AND INSTALLATION OF NEW SEPTIC SYSTEMS SHALL BE PERFORMED IN ACCORDANCE WITH THE MARICOPA COUNTY ENVIRONMENTAL SERVICES DEPARTMENT RULES AND STANDARDS, AND WILL REQUIRE SEPARATE PERMIT.
45. COORDINATE RIPRAP COLOR WITH LANDSCAPE PLANS AND DETAILS.
46. VERIFY AND COORDINATE WITH LANDSCAPE PLANS FINAL LOCATION AND GRATE TYPE OF SPECIFIED AREA DRAINS AND TRENCH DRAINS.
47. VERIFY AND COORDINATE WITH ARCHITECTURAL AND LANDSCAPE PLANS LOCATION AND HEIGHT OF ALL SITE WALLS.
48. DISTURBED AREA: TOTAL ACRES = 1.9 ACRES > 1 ACRE; NPDES PERMIT IS REQUIRED.
49. REFER TO ARCHITECTURAL PLANS AND DETAILS FOR DEMOLITION AND REMOVAL OF ANY EXISTING BUILDING STRUCTURES, SITE WALLS, POOL, AND PAVEMENT ETC.
50. REFER TO GEOTECHNICAL REPORT FOR SPECIFIC RECOMMENDATIONS AND MAXIMUM ALLOWED FILL AND CUT SLOPES.
51. THE PROPOSED POOL EQUIPMENT FOR THIS PROJECT SHALL BE EQUIPPED WITH CARTRIDGE FILTER IN ORDER TO AVOID THE BACKWASH
52. THE SCOPE OF THIS GRADING AND DRAINAGE PLAN COVERS CERTAIN SITE DRAINAGE IMPROVEMENTS AS DELINEATED BY THE LIMITS OF THE CONSTRUCTION AND IN ACCORDANCE TO THE PREPARED BY THE ARCHITECT SITE PLAN, WHICH HAS BEEN COORDINATED AND APPROVED BY THE OWNER. LAND DEVELOPMENT GROUP (LDG) ASSUMES NO LIABILITY FOR DRAINAGE ISSUES THAT MAY EXIST AND COULD CAUSE DAMAGE TO THE SUBJECT OR NEIGHBORING PROPERTIES BEYOND THE LIMITS OF THE CONSTRUCTION SHOWN ON THESE PLANS.
53. THE GRADING AND DRAINAGE DESIGN PRESENTED HEREIN IS BASED ON EVALUATING STORMWATER RUNOFF RESULTING FROM A STATISTICAL ANALYSIS OF STORM EVENTS OF PARTICULAR FREQUENCY, UP TO AND INCLUDING 100-YEAR EVENT AS REQUIRED BY THE CITY OF PHOENIX AND MARICOPA COUNTY DRAINAGE DESIGN MANUALS. A STORM EVENT EXCEEDING THE 100-YEAR EVENT MAY CAUSE OR CREATE THE RISK OF GREATER STORM IMPACT THAN IS PRESENTED AND ADDRESSED ON THIS PLAN.

FLOOD INSURANCE RATE MAP (FIRM) DATA

COMMUNITY #	PANEL #	SUFFIX	BASE FLOOD ELEVATION
040049	1765 OF 4425	L	N/A
MAP #	PANEL DATE	FIRM INDEX DATE	ZONE
04013C	10/16/2013	11/04/2015	XX*

*AREAS DETERMINED TO BE OUTSIDE THE 0.2% ANNUAL CHANCE FLOODPLAIN.

PRELIMINARY GRADING & DRAINAGE PLAN
RUKAVINA RESIDENCE
5611 E ROAD RUNNER LN., PARADISE VALLEY, AZ 85253
LOT 12 - MUMMY MOUNTAIN ESTATES

A SUBDIVISION PLAT RECORDED IN BOOK 49 OF MAPS, PAGE 40, MCR.,
LOCATED IN A PORTION OF THE NW 1/4 OF THE SW 1/4 OF THE SW 1/4 OF SECTION 33, T.3N, R.4E
OF THE GILA & SALT RIVER BASE AND MERIDIAN, MARICOPA COUNTY, ARIZONA

LEGEND

- BRASS CAP FLUSH
- FOUND REBAR OR AS NOTED
- CALCULATED POINT
- PROPERTY LINE
- MONUMENT LINE
- CATV, PHONE
- WATER LINE
- ELECTRIC LINE
- x - x - x - FENCE
- ⏏ TRANSFORMER
- ⏏ WATER METER
- ⏏ TELEPHONE PEDESTAL
- EXISTING CONTOUR
- EXIST. DRAINAGE FLOW
- EXIST. SPOT ELEVATION
- MESQUITE TREE
- PALO VERDE
- SAGUARO
- PROPOSED SPOT ELEVATION
- PROPOSED CONTOUR
- EXISTING DISTURBED AREA
- PROPOSED DISTURBED AREA
- PROPOSED TRIBUTARY AREA
- STORM DRAIN PIPE
- CATCH BASIN
- RETAINING WALL
- TP:XX.XX TOP OF PARAPET
- TM:XX.XX TOP OF WALL
- TRW:XX.XX TOP OF RETAINING WALL
- FG:XX.XX FINISH GRADE
- BM:XX.XX BOTTOM OF WALL
- TF:XX.XX TOP OF FOOTING
- TRB:XX.XX TOP OF RET. BOULDERS
- BRB:XX.XX BACK OF RET. BOULDERS

ABBREVIATIONS

- BSL BUILDING SETBACK LINE
- (C) CALCULATED
- (G) EXISTING GRADE
- EL, ELEV ELEVATION
- EP, ELEV EDGE OF PAVEMENT
- ESMT EASEMENT
- EX, EXIST. EXISTING
- G GUTTER, GAS
- INV INVERT
- (M) MEASURED
- MCR MARICOPA COUNTY RECORDER
- P, PVMT PAVEMENT
- PUE PUBLIC UTILITY EASEMENT
- (R), REC. RECORDED
- R RADIUS
- R/W RIGHT OF WAY
- T TANGENT, TELEPHONE
- W WEST, WATERLINE
- WM WATER METER

UTILITIES

WATER: CITY OF PHOENIX
SANITARY SEWER: SEPTIC
ELECTRIC: APS
TELEPHONE: CENTURY LINK, COX COMM.
NATURAL GAS: SOUTHWEST GAS
CABLE TV: CENTURY LINK, COX COMM.

SHEET INDEX

- C-1 COVER SHEET
- C-2 IMPROVEMENT PLAN
- C-3 CROSS SECTIONS
- DETAILS

DISTURBED AREA CALCULATIONS

EXISTING LOT AREA: 221,685 S.F. (5.089 AC.)
AREA UNDER ROOF: 28,792 S.F.
FLOOR AREA RATIO: 12.99% < 25%
BUILDING PAD SLOPE: 18.6%
VERTICAL: 41.5 FT
HORIZONTAL: 223 FT
ALLOWABLE DISTURBED AREA: 48,793 S.F.
EXISTING DISTURBED AREA: 39.09%
EXISTING DISTURBED AREA: 86,658 S.F.
PROPOSED DISTURBED AREA: 36.24%
PROPOSED DISTURBED AREA: 80,342 S.F.
TOTAL LIVABLE FOOTPRINT: 18,827 S.F.
ATTACHED GARAGE FOOTPRINT: 2,248 S.F.
RESTORED AREAS: 28,109 S.F.
NET PROPOSED DISTURBED AREA: 37,474 S.F. (16.90%)
PERCENT OF LOT STEEPER THAN NATURAL GRADE (5% MAX.): 6,263 S.F. (2.83%)
VOLUME OF CUT: 3,776 C.Y.
VOLUME OF FILL: 6,122 C.Y.
TOTAL CUT&FILL: 9,898 C.Y.
HILLSIDE ASSURANCE = 35 TIMES THE GRADING PERMIT FEE.
GRADING PERMIT FEE: \$9,576
(\$168 FIRST 100 CY / \$96 EA. ADDITIONAL 100 CY).
ASSURANCE AMOUNT: \$335,160
ALL QUANTITIES LISTED ON THESE PLANS ARE ESTIMATES ONLY. THE CONTRACTOR SHALL MAKE THEIR OWN DETERMINATION OF THE QUANTITIES AND BASE THEIR BIDS ON THEIR ESTIMATES.

EARTHWORK QUANTITIES

CUT: 3,644 C.Y.
CUT FOR PIPES: 132 C.Y.
FILL: 6,122 C.Y.
NET FILL: 2,346 C.Y.

ALL QUANTITIES LISTED ON THESE PLANS ARE ESTIMATES ONLY. NO SHRINK OR SWELL IS ASSUMED. THE CONTRACTOR SHALL MAKE THEIR OWN DETERMINATION OF THE QUANTITIES AND BASE THEIR BIDS ON THEIR ESTIMATES.

PROJECT DESCRIPTION

NEW SINGLE FAMILY RESIDENCE, NEW CASITA, NEW GARAGE, NEW DRIVEWAY, NEW POOL & SPA AND SITE IMPROVEMENTS WITH ON-SITE RETENTION.

GRADING SPECIFICATIONS


1. EXCAVATION AND GRADING OF THIS SITE IS CLASSIFIED AS "ENGINEERED GRADING" PER 2015 I.B.C. AND WILL BE PERFORMED ACCORDINGLY.
2. THE CONTRACTOR WILL RETAIN A SOILS ENGINEER DURING CONSTRUCTION TO INSPECT PROGRESS OF CONSTRUCTION, CONCERNING PREPARATION OF GROUND TO RECEIVE FILLS, TESTING AND REQUIRED COMPACTION STABILITY OF ALL FINISH SLOPES INCLUDING CUT SLOPES.
3. COMPACTION SHALL COMPLY WITH M.A.G. SECTION 601 AND PROVISIONS AS SET FORTH IN THE SOILS REPORT.
4. BEARING MATERIALS FOR FILL UNDER RESIDENCE PAD IF NATIVE MATERIAL IS USED. LARGE ROCK FRAGMENTS MUST BE REMOVED THAT ARE IN EXCESS OF SIX INCHES. REMAINING MATERIAL MUST BE SMALLER PARTICLES OF SAND AND ROCK THAT CAN BE COMPACTED INTO A DENSE CONSTRUCTION. MAXIMUM PARTICLE SIZE: 6 INCHES
PERCENT PASSING NO. 4 SIEVE: 35% TO 70%
PERCENT PASSING NO. 200 SIEVE: 25% MAX.
PLASTICITY INDEX: 10% MAX.
5. CUT-SLOPES: MAXIMUM ROCK CUT SLOPE TO BE 1.0 FEET HORIZONTAL TO 3.0 FEET VERTICAL PER GEOTECHNICAL STUDY.
6. FILL SLOPES: MAXIMUM FILL SLOPE TO BE 2.0 FEET HORIZONTAL TO 1.0 FEET VERTICAL.
7. COMPACTION FILL MATERIAL MUST BE PLACED ON LEVELED BENCHES OUT INTO UNDISTURBED EXISTING HILLSIDE. PLACE FILL IN HORIZONTAL LIFTS OF THICKNESS COMPATIBLE WITH THE COMPACTION EQUIPMENT USED. COMPACT TO A MINIMUM OF 95 PERCENT OF THE MAXIMUM A.S.T.M. DENSITY AT THE OPTIMUM MOISTURE CONTENT OF ± TWO PERCENT. THIS PERTAINS TO ALL ENGINEERED STRUCTURAL FILL SUPPORTING STRUCTURES AND INCLUDING FILL UNDER ANY OF THE RETAINING WALLS. COMPACTION TEST RESULTS SHALL BE SUBMITTED TO THE SOILS ENGINEER AND TOWN OF PARADISE VALLEY BUILDING AND SAFETY DEPARTMENT.
8. ANY RETAINING WALLS ADJACENT TO THE PROPERTY LINES WILL BE UNDER THE SCOPE OF SPECIAL INSPECTION BY THE SOILS ENGINEER. THE DEVELOPER SHALL NOTIFY THE ADJOINING PROPERTY OWNERS IN WRITING, TEN DAYS PRIOR TO START OF CONSTRUCTION ON THESE WALLS PER SECTION 2903-B OF IBC. THE DEVELOPER WILL HAVE TO PROVIDE MEANS OF PROTECTION OF ADJACENT PROPERTY WHILE THIS WORK IS UNDER CONSTRUCTION.
9. ALL EXPOSED CUT AND FILL SHALL BE TREATED WITH AN APPROVED AGING AGENT TO MINIMIZE TO VISUAL CONTINUITY.
10. NO CERTIFICATE OF OCCUPANCY SHALL BE ISSUED UNTIL ALL HILLSIDE STIPULATIONS AND ALL TOWN CODE REQUIREMENTS ARE COMPLIED INCLUDING, BUT NOT LIMITED TO LANDSCAPING, GROUND RESTORATION, FIRE FLOW, FIRE SAFETY AND ALL ONSITE AND OFFSITE IMPROVEMENTS.
11. ALL OUTDOOR LIGHTING SHALL BE IN CONFORMANCE WITH ARTICLE XXII OF THE TOWN ZONING ORDINANCE.
12. ALL EXCESS FILL MATERIAL SHALL BE REMOVED FROM THE SITE WITH NO NEW SPILL SLOPES.
13. THE USE OF HYDRAULIC RAM HAMMERS, OR OTHER HEAVY EQUIPMENT USED TO CUT THROUGH ROCK, INCLUDING MACHINERY WITH AUDIBLE BACK UP WARNING DEVICES SHALL BE LIMITED TO USE BETWEEN THE HOURS OF 7:00AM OR SUNRISE, WHICHEVER IS LATER, AND 6:00PM OR SUNSET, WHICHEVER IS EARLIER, MONDAY THROUGH FRIDAY, WITH LIMITED WORK ON SATURDAY AND NO WORK ON SUNDAY OR LEGAL HOLIDAYS.
14. CONSTRUCTION STAKING AND/OF FENCING SHALL BE PLACED AROUND THE CONSTRUCTION SITE SO AS TO PROTECT THE UNDISTURBED NATURAL AREAS.

DRAINAGE STATEMENT

1. ULTIMATE STORM OUTFALL IS AT THE NEAR OF SOUTHWESTERN PROPERTY CORNER AT ELEVATION OF 1378.00.
2. NEW SINGLE FAMILY RESIDENCE, NEW CASITA, NEW DRIVEWAY, NEW GARAGE, NEW POOL & SPA AND SITE IMPROVEMENTS ARE PROPOSED WITH THIS PROJECT.
3. PROPOSED DEVELOPMENT DOES NOT IMPACT DRAINAGE CONDITIONS OF ADJOINING LOTS.
4. HISTORIC DRAINAGE PATTERNS ARE RESTORED AND PRESERVED.
5. THE MINIMUM FINISH FLOOR ELEVATIONS SHOWN ARE SAFE FROM INUNDATION DURING A 100-YEAR PEAK RUN-OFF EVENT IF CONSTRUCTED PER THE APPROVED CIVIL PLANS.
6. PROPOSED STORM DRAIN SYSTEM SHALL BE INSPECTED AND CLEANED FROM DEBRIS AND SILT AFTER EVERY MAJOR STORM EVENT.
7. CHECK DAMS, RIPRAP AND BOULDERS ARE SPECIFIED AT ALL POINTS OF DISCHARGE TO MITIGATE EROSION AND TO CONVERT CONCENTRATED FLOWS BACK TO SHEET FLOWS.
8. ON-SITE RETENTION IS PROVIDED FOR THE FIRST FLUSH STORM EVENT FOR THE LIMITS OF DISTURBANCE.

FIRE SPRINKLER SYSTEM

FIRE SPRINKLER SYSTEM TO BE INSTALLED PER THE REQUIREMENTS OF THE TOWN OF PARADISE VALLEY AND IN ACCORDANCE WITH I.B.C. SECT. 904.2.2 AMD. AND 2018 IFC, SEC. 903.

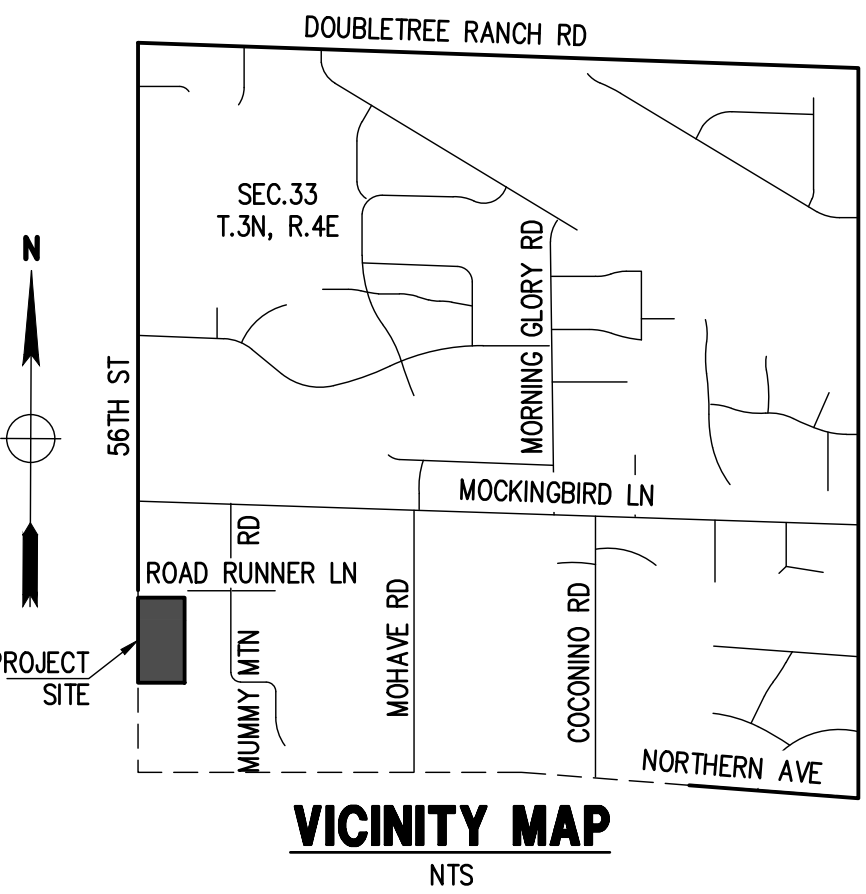

OWNER

MARKO ALFRED RUKAVINA III
AND CELINA MARIE RUKAVINA
5611 E ROAD RUNNER LN.,
PARADISE VALLEY, AZ 85253

SITE DATA

APN: 168-77-004
ADDRESS: 5611 E ROAD RUNNER LN.,
PARADISE VALLEY, AZ 85253
ZONING: R-175 HILLSIDE
LOT AREA: 221,685 S.F. (5.089 AC.)
QS #: 25-41

LOT LIVABLE FOOTPRINT: 18,827 S.F.
GARAGE FOOTPRINT: 2,248 S.F.
TOTAL AREA UNDER ROOF: 28,882 S.F.
LOT COVERAGE: 13.03%

EXIST. DISTURBED AREA: 86,658 S.F. (1.989 AC.)
PROPOSED DISTURBANCE: 80,342 S.F. (1.844 AC.)

LEGAL DESCRIPTION

LOT 12, MUMMY MOUNTAIN ESTATES, ACCORDING TO BOOK 49 OF MAPS, PAGE 40, RECORDS OF MARICOPA COUNTY, ARIZONA.

BENCHMARK

BRASS CAP FLUSH AT THE INTERSECTION OF 56TH STREET AND MOCKINGBIRD LANE HAVING AN ELEVATION OF 1349.97 NAVD 88 DATUM, GOAC#S 26101-1.

BASIS OF BEARINGS

THE FOUND EASTERLY LINE OF SUBJECT PROPERTY, THE BEARING OF WHICH IS N00°05'21"E.

FINISH FLOOR CERTIFICATION

I HEREBY CERTIFY THAT FINISHED FLOOR ELEVATIONS SHOWN ON THE PLAN OF 1421 & 1433 IS MINIMUM OF 12" ABOVE THE 100-YEAR STORM ELEVATION OF 1420, ACCORDING TO THE TOWN OF PARADISE VALLEY CODE OF ORDINANCE.

Nick Prodanov
REGISTERED CIVIL ENGINEER

APPROVAL

THIS SET OF PLANS HAS BEEN REVIEWED FOR COMPLIANCE WITH TOWN OF PARADISE VALLEY REQUIREMENTS PRIOR TO ISSUANCE OF PERMIT. THE TOWN NEITHER ACCEPTS NOR ASSUMES ANY LIABILITY FOR ERRORS OR OMISSIONS. THIS COMPLIANCE APPROVAL SHALL NOT PREVENT THE TOWN ENGINEER FROM REQUIRING CORRECTIONS OF ERRORS OR OMISSIONS IN THE PLANS TO BE FOUND IN VIOLATION OF LAWS OR ORDINANCES.

TOWN ENGINEER
TOWN OF PARADISE VALLEY

DATE


07/01/26
DATE

PRELIMINARY
GRADING & DRAINAGE PLAN
COVER SHEET


RUKAVINA RESIDENCE
5611 E ROAD RUNNER LN.,
PARADISE VALLEY, AZ 85253

Land
DEVELOPMENT GROUP


REGISTERED PROFESSIONAL
PRELIMINARY
GRADING & DRAINAGE PLAN
COVER SHEET
NICK PRODANOV
REGISTERED CIVIL ENGINEER
C-1
1 OF 3

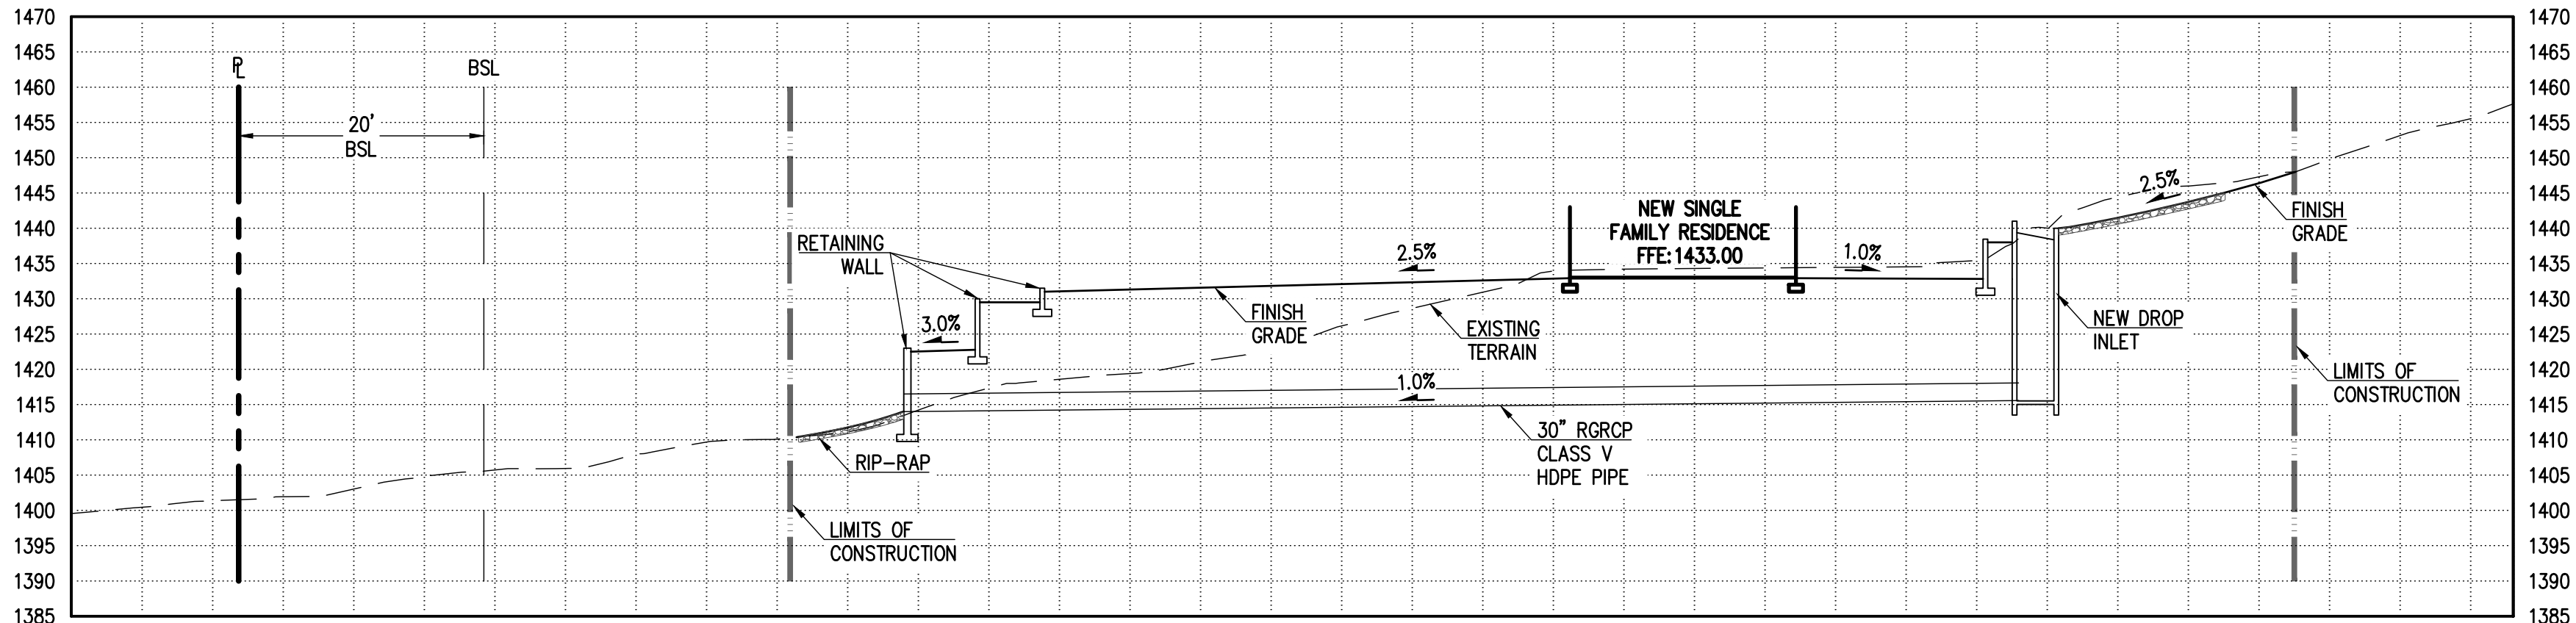






CROSS SECTION 1 - 1
SCALE HOR. 1" = 20', VER. 1" = 20'

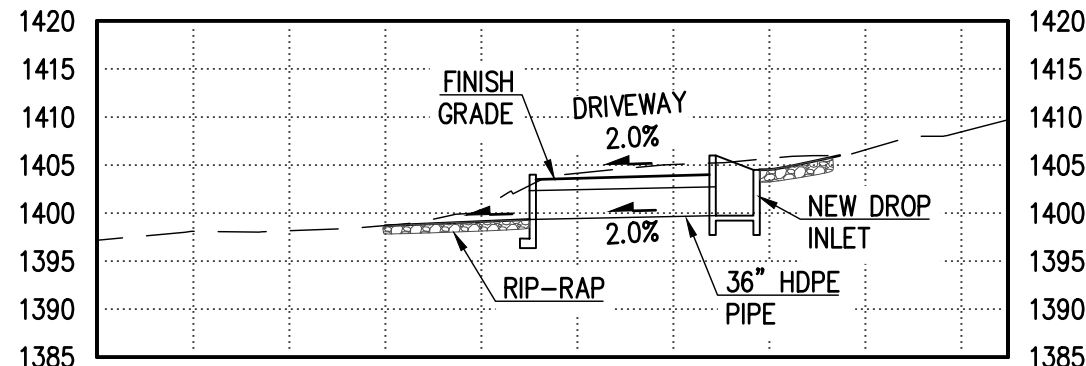

CROSS SECTION 2 - 2
SCALE HOR. 1" = 20', VER. 1" = 20'


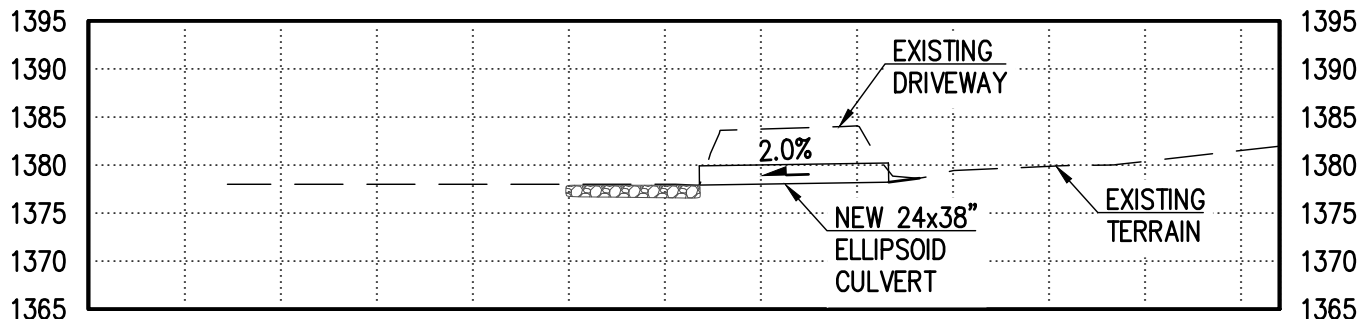


CROSS SECTION 3 - 3
SCALE HOR. 1" = 20', VER. 1" = 20'

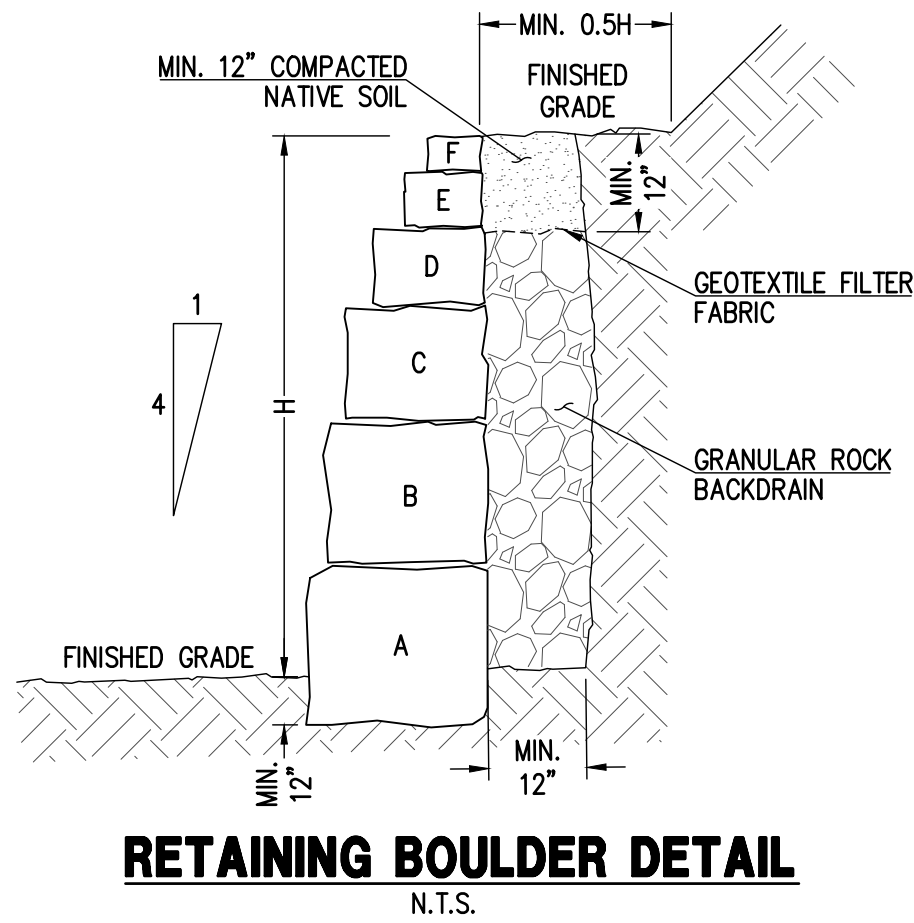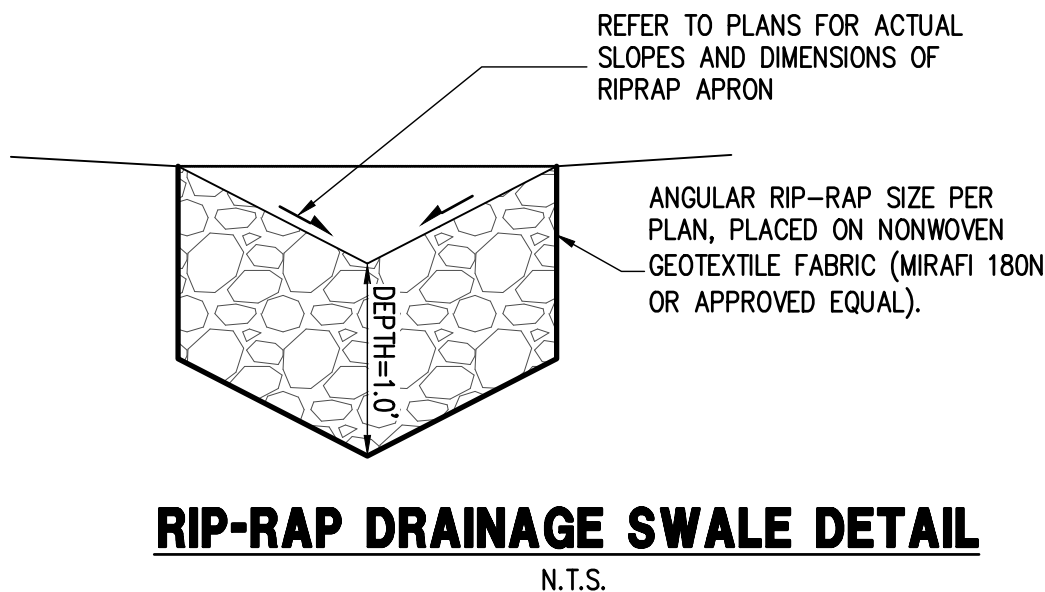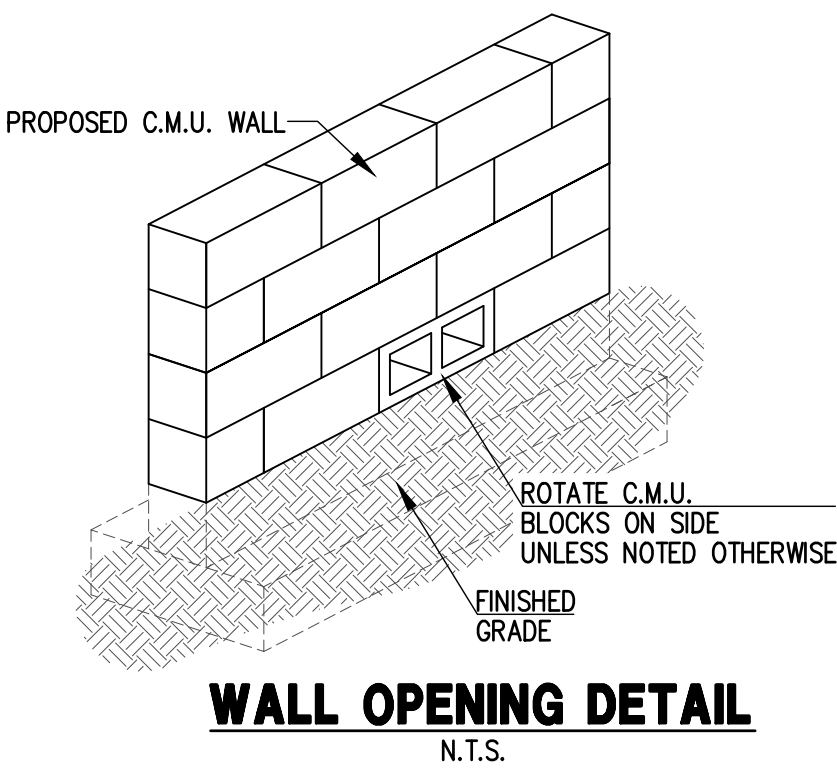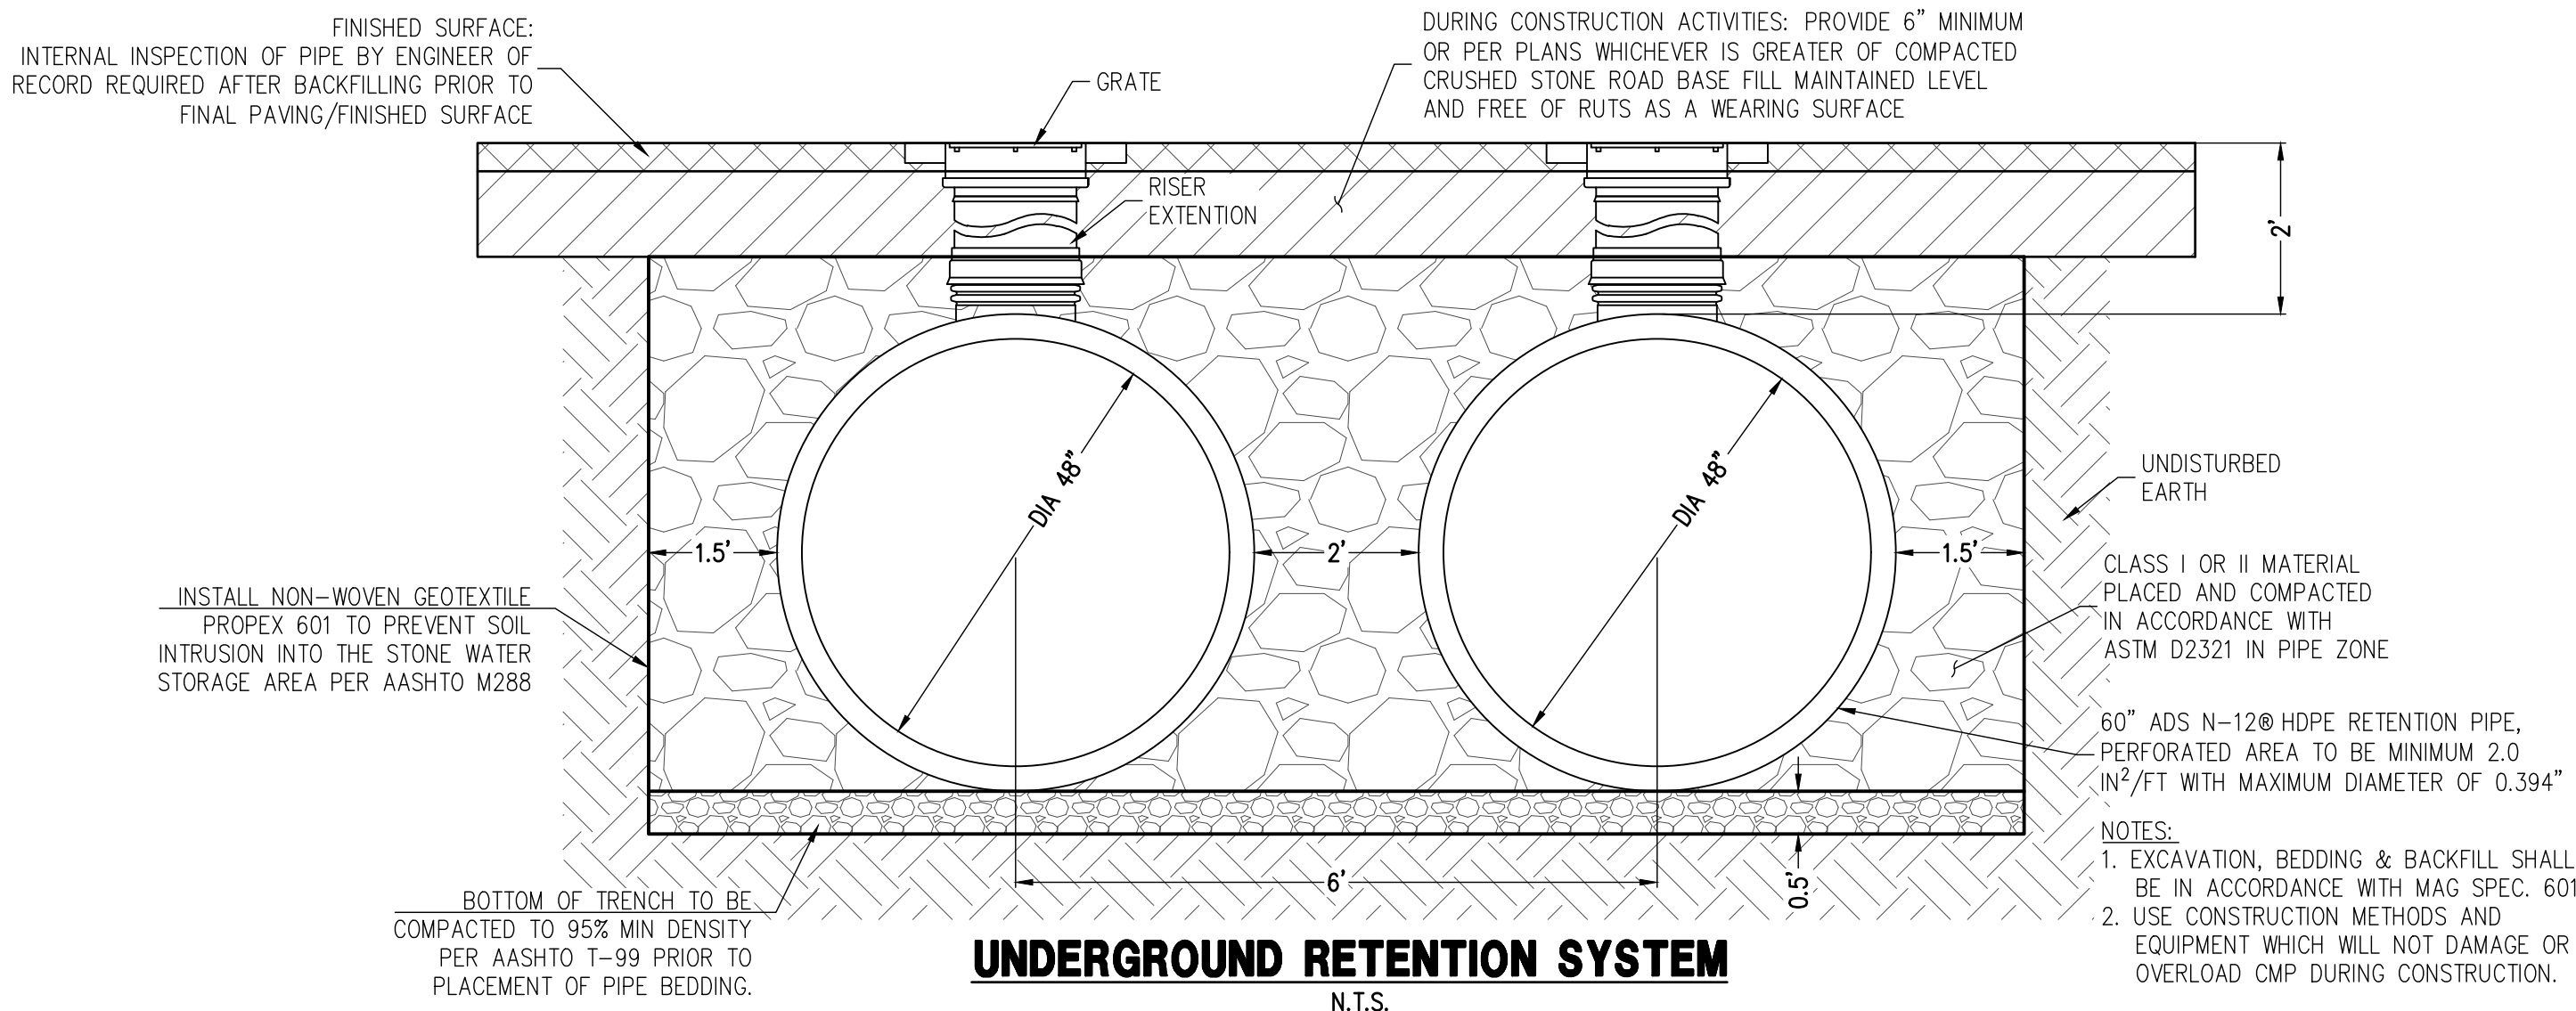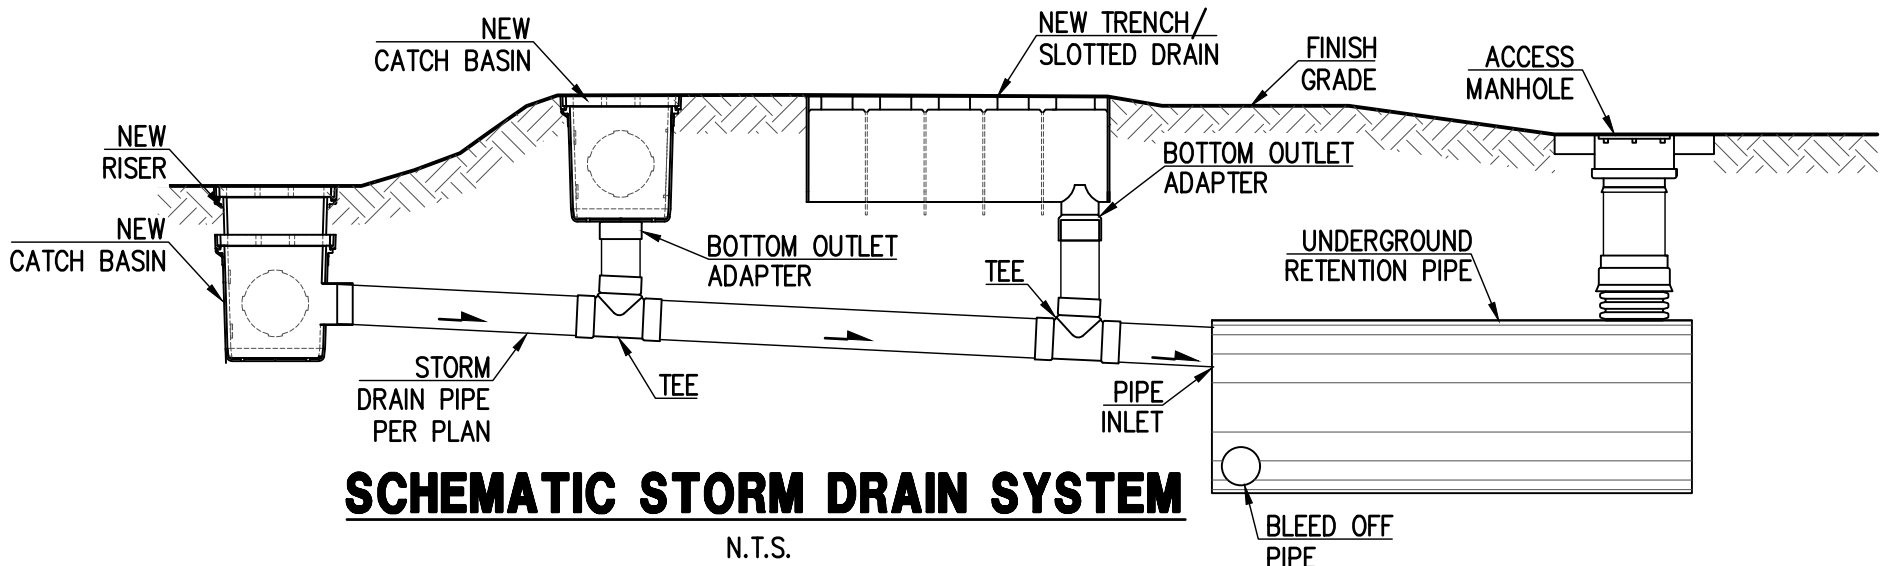

ROCK SIZE		
ROCK SIZE (PERSON)	ROCK WEIGHT (POUNDS)	AVERAGE DIMENSIONS (FT.)
1	50 TO 200	0.7 TO 1.1
2	200 TO 650	1.1 TO 1.6
3	650 TO 1950	1.6 TO 2.3
4	1950 TO 3900	2.3 TO 2.9
5	3900 TO 5850	2.9 TO 3.3
6	5850 TO 7800	3.3 TO 3.7

ROCK SIZE DESIGNATION						
WALL HEIGHT H (FT.)	A	B	C	D	E	F
3	3	2	-	-	-	-
6	4	3	2	-	-	-
9	5	4	3	2	-	-
12	6	5	4	3	2	-
15	6	6	5	4	3	2

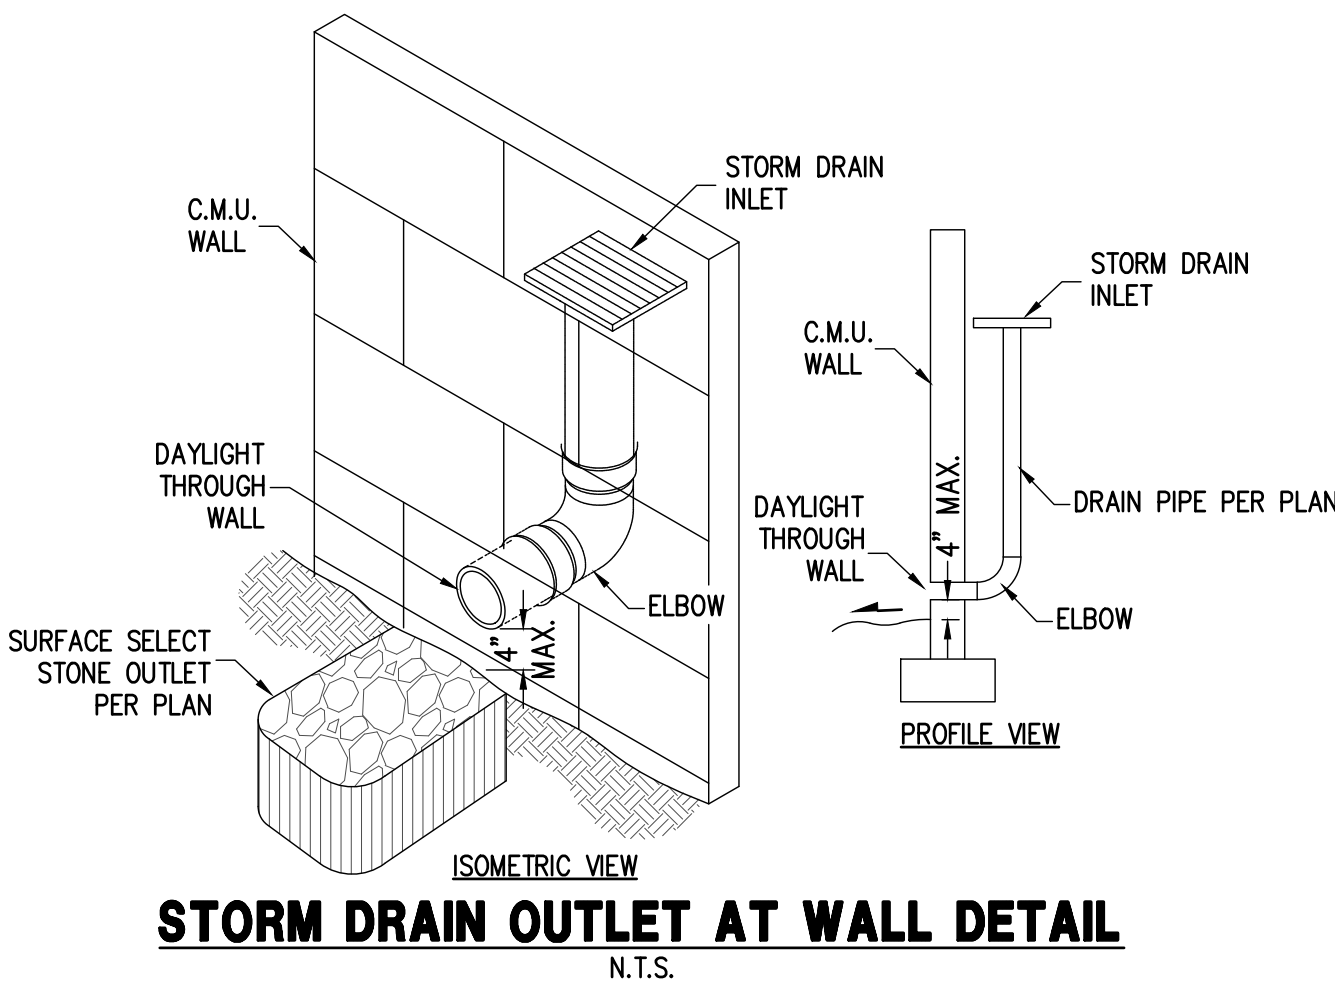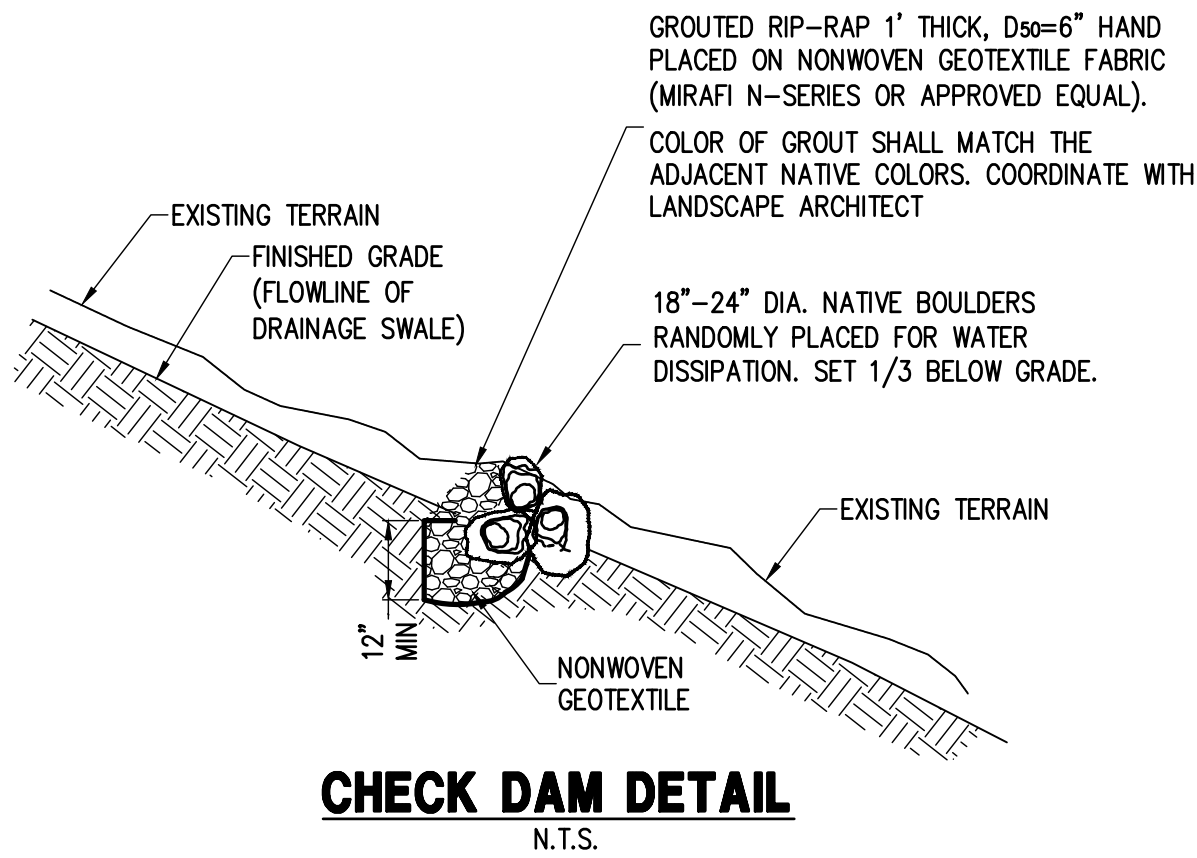

PERCENT PASSING		SIZE		D50 CLASS, INCHES	
100	10	90	1.5	D50	6
85	10	70	1.3	D50	5
50	10	30	1.0	D50	4
15	10	5	0.67	D50	3
5	10	0	0.50	D50	2



**PRELIMINARY
GRADING & DRAINAGE PLAN
CROSS SECTIONS
DETAILS**

**RUKAVINA RESIDENCE
5611 E ROAD RUNNER LN.,
PARADISE VALLEY, AZ 85253**

P 602 889 1984 | F 602 445 9482
8808 N CENTRAL AVE., SUITE 288
PHOENIX, AZ 85020
PHOENIX@LDGNG.COM



C-3
3 OF 3

REINFORCING NOTES:	CONCRETE NOTES:	MASONRY NOTES:	GENERAL NOTES:
1. REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 60 (Fy = 60 KSI) DEFORMED BARS FOR ALL BARS #4 AND LARGER. ASTM A615, GRADE 40 (Fy = 40 KSI) DEFORMED BARS FOR ALL BARS #3 AND SMALLER. REINFORCING TO BE WELDED SHALL CONFORM ASTM A706, GRADE 60 (Fy = 60KSI) LOW ALLOY DEFORMED BARS. NO TACK WELDING OF REINFORCING BARS ALLOWED. 2. ALL REINFORCING STEEL SHALL BE ACCURATELY PLACED AND SUPPORTED BY GALVANIZED METAL CHAIRS, SPACERS OR HANGERS. PROVIDE THE FOLLOWING MINIMUM CLEAR CONCRETE COVERAGE: CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH: EXPOSED TO EARTH OR WEATHER: #6 AND LARGER #5 AND SMALLER ALL OTHERS PER LATEST EDITION OF ACI 318. 3. UNLESS NOTED OTHERWISE, LAP SPLICES IN CONCRETE SHALL BE CLASS "B" TENSION LAP SPLICES (2'-0" MINIMUM) PER THE LATEST EDITION OF ACI 318. STAGGER ALTERNATE SPLICES A MINIMUM OF ONE LAP LENGTH. EXTEND ALL HORIZONTAL REINFORCING CONTINUOUS AROUND CORNERS AND INTERSECTIONS OR PROVIDE BENT CORNER BARS TO MATCH AND LAP HORIZONTAL BARS AT CORNERS AND INTERSECTIONS OF FOOTINGS AND WALLS. 4. REINFORCING BAR HOOKS SHALL BE STANDARD ACI HOOKS UNLESS NOTED OTHERWISE.	1. CONCRETE WORK SHALL CONFORM TO ALL REQUIREMENTS OF ACI 301, "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" AND ACI 318, "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE." 2. CONCRETE SHALL BE READY MIXED CONCRETE IN ACCORDANCE WITH ASTM C94. MINIMUM 28 DAY COMPRESSIVE STRENGTH SHALL BE 3,000 PSI (DESIGNED FOR 2,500 PSI U.N.O.) EXCEPT AS FOLLOWS: SLABS ON GRADE FOUNDATIONS 3,000 PSI 2,500 PSI 3. CEMENT SHALL CONFORM TO ASTM C150, TYPE II. AGGREGATE PER ASTM C33. LIGHTWEIGHT AGGREGATE PER ASTM C330. MAXIMUM 3 INCH SLUMP FOR SLABS ON GRADE, 4 INCH FOR OTHER CONCRETE. CONCRETE CONTAINING SUPERPLASTICIZING ADMIXTURE SHALL HAVE FIELD-VERIFIED 3 INCH MAXIMUM SLUMP PRIOR TO ADDING ADMIXTURE AND 8 INCH MAXIMUM SLUMP AT PLACEMENT. MIX DESIGNS SHALL BE DESIGNED BY THE CONCRETE PRODUCTION FACILITY IN ACCORDANCE WITH ACI 301 AND REVIEWED BY THE STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION. 4. CONCRETE SHALL BE FREE OF CHLORIDE. NO FLY ASH ADDITIVES SHALL BE USED IN CONCRETE WHEN USED IN FLATWORK OR ARCHITECTURALLY EXPOSED CONCRETE. WHEN USED, FLY ASH SHALL CONFORM TO ASTM C618, CLASS F. FLY ASH SHALL NOT REPLACE MORE THAN 15% OF CEMENT BY WEIGHT. 5. MECHANICALLY VIBRATE ALL CONCRETE WHEN PLACED, EXCEPT THAT SLABS ON GRADE NEED TO BE VIBRATED ONLY AROUND UNDERFLOOR DUCTS, ETC. CAST CLOSURE POUR AROUND COLUMNS AFTER DEAD LOAD IS APPLIED UNLESS APPROVED OTHERWISE IN WRITING BY ARCHITECT. ALL CONCRETE SLABS ON GRADE SHALL BE BOUNDED BY CONTROL JOINTS, KEYED OR SAW CUT SUCH THAT THE ENCLOSED AREA DOES NOT EXCEED 225 SQUARE FEET. KEYED CONTROL JOINTS NEED ONLY OCCUR AT EXPOSED EDGES DURING POURING. ALL OTHER JOINTS MAY BE SAW CUT. 6. CONCRETE WHICH HAS CONTAINED WATER FOR MORE THAN 90 MINUTES (60 MINUTES IF AIR TEMPERATURE EXCEEDS 85°F) SHALL NOT BE USED. RETEMPERING OF CONCRETE INITIAL SET HAS OCCURRED IS NOT PERMITTED. 7. CURE EXPOSED CONCRETE FOR A MINIMUM OF 7 DAYS IN ACCORDANCE WITH ACI 301 PROCEDURES IN ORDER TO PREVENT CRACKING. CURE WITH CURING AND SEALING COMPOUND, MOIST CURING, MOISTURE-RETAINING COVER CURING OR COMBINATIONS THEREOF. 8. CONCRETE COMPRESSIVE STRENGTH AND SLUMP SHALL BE TESTED PER ASTM C31, C39 AND C143. PROVIDE 3 CYLINDERS PER TEST FOR EACH DAY'S CONCRETE PLACEMENT OR AS DIRECTED BY THE ARCHITECT. TEST ONE CYLINDER AT 7 DAYS AND TWO AT 28 DAYS. TESTING SHALL BE DONE BY A QUALIFIED TESTING LABORATORY.	1. MASONRY WORK SHALL CONFORM TO ALL REQUIREMENTS OF IBC AND ACI 530, "BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES." VERTICAL REINFORCING SHALL BE PER DETAILS AND AT ALL CORNERS, WALL ENDS, JAMBS AND EACH SIDE OF CONTROL JOINTS. 2. HOLLOW CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90, GRADE N, TYP 1, F'm = 1500 PSI, NET COMPRESSIVE STRENGTH OF 1900 PSI PER ASTM C140, RUNNING BOND. 3. MORTAR SHALL CONFORM TO ASTM C270 AND IRC R606.2.8, TYPE S WITH 28 DAY COMPRESSIVE STRENGTH OF 1800 PSI, TESTED PER ASTM C780. MASONRY CEMENT, PRE-MIXED MORTAR AND RETARDANT ADDITIVES SHALL NOT BE USED. 4. GROUT SHALL CONFORM TO ASTM C476 AND IRC R606.2.12, FINE OR COARSE GROUT, WITH 28 DAY COMPRESSIVE STRENGTH OF 2000 PSI, TESTED PER ASTM C1019. GROUT SHALL BE FREE OF FLY ASH AND/OR CHLORIDE. 5. ALL CELLS AND COURSES WITH REINFORCING AND ADDITIONAL GROUT SPACES AS REQUIRED BY THE DRAWINGS SHALL BE FILLED SOLID WITH GROUT. MAXIMUM GROUT LIFT 4'-8" WITH EACH GROUT POUR STOPPING 1-1/2 INCHES BELOW THE TOP COURSE OF LIFT. PROVIDE CLEANOUTS IF GROUT LIFT EXCEEDS 5'-0". PLACE GROUT CONTINUOUSLY. DO NOT INTERRUPT GROUTING FOR MORE THAN ONE HOUR. MECHANICALLY VIBRATE GROUT IN VERTICAL SPACES IMMEDIATELY AFTER POURING AND AGAIN ABOUT 5 MINUTES LATER. RODDING OF GROUT IS NOT ACCEPTABLE. 6. PROVIDE CONTROL JOINTS AT 20'-0" O.C. MAXIMUM. 7. ANY RADIUS WALLS SHALL HAVE A MINIMUM OF #5 VERTICALS AT 24" O.C. AND #4 HORIZONTALS AT 24" O.C. UNLESS MORE IS REQUIRED ON PLAN/DETAIL. 8. ANY STACK BOND WALLS SHALL HAVE A MINIMUM OF #4 VERTICALS AT 16" O.C. AND #4 HORIZONTALS AT 24' O.C. UNLESS MORE IS REQUIRED ON PLANS/DETAILS.	1. ALL WORK SHALL CONFORM TO THE 2015 INTERNATIONAL BUILDING CODE. 2. CONSTRUCTION MATERIALS SHALL BE SPREAD OUT IF PLACED ON FRAMED ROOF OR FLOOR. LOAD SHALL NOT EXCEED THE DESIGN LIVE LOAD PER SQUARE FOOT. 3. THE CONTRACTOR SHALL TAKE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION, INCLUDING, BUT NOT LIMITED TO, BRACING, SHORING, ETC. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND IMPLEMENTATION OF ALL SCAFFOLDING, BRACING AND SHORING. OBSERVATION VISITS TO THE SITE BY THE STRUCTURAL ENGINEER SHALL NOT INCLUDE INSPECTION OF THE ABOVE ITEMS. THE STRUCTURAL ENGINEER WILL NOT BE RESPONSIBLE FOR THE CONTRACTOR'S MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES OF CONSTRUCTION, NOR WILL THE STRUCTURAL ENGINEER BE RESPONSIBLE FOR CONSTRUCTION SITE SAFETY, OR THE SAFETY PRECAUTIONS AND THE PROGRAMS INCIDENT THERETO. 4. CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION WITH THE SITE CONDITIONS. RESOLVE DISCREPANCIES AND OMISSIONS WITH THE ARCHITECT. PLANS AND DETAILS IN THIS SET ARE NOT TO BE SCALED. 5. THE CONTRACT STRUCTURAL DRAWINGS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION. 6. WHERE ANY DISCREPANCIES OCCUR BETWEEN PLANS, DETAILS, GENERAL STRUCTURAL NOTES AND SPECIFICATIONS, THE GREATER REQUIREMENTS SHALL GOVERN. WHERE NO SPECIFIC DETAIL IS SHOWN, CONSTRUCTION SHALL CONFORM TO SIMILAR WORK ON THE PROJECT. FOR BIDDING PURPOSES, WHERE ANY MEMBER OR STRUCTURAL ELEMENT IS SHOWN BUT NOT CALLED OUT ON THE PLANS OR DETAILS, THE LARGEST SIMILAR MEMBER OR ELEMENT USED IN THE PROJECT SHALL BE UTILIZED. 7. DESIGN LOADS: WIND: ULTIMATE WIND SPEED = 115 MPH (ULT.) – 3 SEC. GUST, EXPOSURE "C" SEISMIC: DESIGN CATEGORY "B"
FOUNDATION NOTES:			
1. ALL SURFACE-LEVEL PERIMETER FOUNDATIONS AND ISOLATED EXTERIOR FOUNDATIONS SHALL BEAR ON 1'-6" OF CONTROLLED COMPACTED FILL AT A MINIMUM OF 1'-6" EMBEDMENT BELOW THE LOWEST ADJACENT FINISH PAD GRADE WITHIN 5'-0" OF PROPOSED EXTERIOR WALLS. SURFACE LEVEL INTERIOR FOOTINGS BEARING ON 1'-6" OF CONTROLLED COMPACTED FILL, MUST BE FOUNDED A MINIMUM OF 1'-6" BELOW FINISH FLOOR LEVEL. OVER-EXCAVATION AND RE-COMPACTION TO A DEPTH OF 3'-0" BELOW FINISHED PAD GRADE IS RECOMMENDED TO ACHIEVE 1'-6" OF CONTROLLED COMPACTED FILL BENEATH FOUNDATIONS. EXTEND OVER-EXCAVATION ACROSS ENTIRE BUILDING PAD AND TO A MINIMUM LATERAL DISTANCE OF 5'-0" BEYOND EXTERIOR FOUNDATION EDGES. EMBED ALL FOOTINGS IN CLOSE PROXIMITY TO RETENTION BASINS (WITHIN 5'-0") AN ADDITIONAL 1'-0" AS REQUIRED PER THE SOILS REPORT. 2. ALLOWABLE SOIL BEARING CAPACITY= 1,500 PSF, ACTIVE PRESSURE = 38PCF, COEFF. OF BASE FRICTION INDEPENDENT OF PASSIVE RESISTANCE = 0.53. 3. FOR ALL EARTHWORK REQUIREMENTS AND RECOMMENDATIONS FOR THIS PROJECT REFERENCE THE GEOTECHNICAL INVESTIGATION REPORT #2501519 DATED AUGUST 25, 2025 PREPARED BY ACS SERVICES LLC. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR ANY GEOTECHNICAL ASPECTS OF THIS PROJECT.			

CMU RETAINING WALL SCHEDULE BEARING ON CONTROLLED COMPACTED FILL									
HEIGHT "H"	REFERENCE DETAIL TYPE	"W" FTG. WIDTH	"Tw" TOE WIDTH	"t" FTG. THICKNESS	"L" LONG. BARS	HEEL REINFORCING T.O.F.	TOE REINFORCING B.O.F.	DOWELS	"V" VERTICAL BARS
0'-0" TO 2'-0"	"A"	2'-0"	0'-8"	0'-10"	3 #4 BARS	NOT REQ.	NOT REQ.	#5 AT 48" O.C. CENTERED – FULL HEIGHT EXTENSION	SEE DOWELS
2'-1" TO 4'-8"	"A"	3'-0"	0'-8"	1'-0"	4 #4 BARS	NOT REQ.	NOT REQ.	#5 AT 32" O.C. SOIL SIDE – 38" EXTENSION MIN.	#5 AT 48" O.C. CENTERED
4'-9" TO 6'-8"	"A"	4'-3"	1'-0"	1'-0"	4 #5 BARS	#5 AT 14" O.C.	NOT REQ.	#5 AT 8" O.C. SOIL SIDE – 38" EXTENSION MIN.	#5 AT 32" O.C. SOIL SIDE
6'-9" TO 8'-8"	"B"	5'-6"	1'-2"	1'-0"	6 #5 BARS	#5 AT 12" O.C.	NOT REQ.	#5 AT 8" O.C. SOIL SIDE – 38" EXTENSION MIN.	#5 AT 32" O.C. SOIL SIDE
8'-9" TO 10'-0"	"B"	6'-9"	1'-6"	1'-2"	8 #5 BARS	#5 AT 8" O.C.	#5 AT 12" O.C.	#6 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 16" O.C. SOIL SIDE
10'-1" TO 12'-0"	"C"	8'-0"	2'-0"	1'-2"	10 #5 BARS	#5 AT 8" O.C.	#5 AT 12" O.C.	#6 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 32" O.C. SOIL SIDE
12'-1" TO 13'-4"	"C"	9'-4"	2'-8"	1'-4"	10 #5 BARS	#6 AT 9" O.C.	#6 AT 14" O.C.	#7 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 24" O.C. SOIL SIDE
13'-5" TO 16'-0"	"D"	11'-9"	3'-9"	1'-6"	15 #5 BARS	#6 AT 8" O.C.	#6 AT 8" O.C.	#7 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 16" O.C. SOIL SIDE

DETAIL NOTES

1. "V" VERTICALS PER SCHEDULE – LAP DOWELS FULL HEIGHT AND VERTICALS 60 BAR DIAMETER U.N.O.

2. DOWELS PER SCHEDULE – EXTEND OUT OF FOOTING A MINIMUM OF 60 BAR DIAMETERS U.N.O.

3. LADDER REINFORCING PER G.S.N. AT 16" O.C.

4. 1" Ø WEEP HOLE AT 6'-0" O.C. – LOCATE 12" ABOVE LOWER FINISHED GRADE

5. CONCRETE SLAB WHERE SHOWN ON PLANS

6. LEVEL FINISHED GRADE

7. CONCRETE FOOTING PER SCHEDULE

8. "L" LONGITUDINAL BARS PER SCHEDULE – SPREAD EVENLY BETWEEN TOP AND BOTTOM OF FOOTING

9. TRANSVERSE HEEL REINFORCING PER SCHEDULE – LOCATE AT THE TOP OF FOOTING

10. TRANSVERSE TOE REINFORCING – LOCATE AT THE BOTTOM OF FOOTING

11. #5 DOWELS AT 16" O.C. AT NON-SOIL SIDE FACE OF MASONRY – EXTEND FULL HEIGHT OF FIRST LIFT

12. #3 HAIRPINS AT 16" O.C. EACH WAY WITH 6" BEND EACH END

13. 1 #4 CONTINUOUS IN 8" DEEP GROUTED BOND BEAM AT TOP OF WALL, FINISHED GRADE AND 48" O.C. BLW

14. 2 #4 CONTINUOUS IN 8" DEEP GROUTED BOND BEAM AT TOP AND MID-HEIGHT OF 12" AND 16" BLOCK

15. ROCK POCKET WRAPPED IN FILTER FABRIC – BOTTOM OF POCKET SHALL BE 9" ABOVE LOWER FINISHED GRADE

16. EMBED DOWEL FULL DEPTH OF FOOTING TO 3" CLR FROM BOTTOM – TERMINATE WITH STANDARD ACI HOOK

17. #5 VERTICALS AT 48" O.C. CENTERED IN SCREEN WALL ABOVE RETAINING – LAP 30" MIN. BELOW

18. VENEER AS OCCURS PER ARCH'L DWGS.

19. 8" CMU RETAINING WALL – SOLID GROUT WALLS BELOW GRADE

20. 12" SOLID GROUTED CMU RETAINING WALL – EXTEND

FOOTING DOWELS FULL HEIGHT

21. 16" SOLID GROUTED CMU RETAINING WALL – EXTEND DOWELS FULL HEIGHT. 16" WIDE NOMINAL BLOCK REQUIRED WHERE 12" CMU WALL ABOVE OCCURS – WHERE 8" CMU WALL ABOVE OCCURS DOUBLE WYTHE 8" CMU MAY BE USED AND TIED TOGETHER PER NOTE 17

22. 24" SOLID GROUTED CMU RETAINING WALL, IF MULTIPLE WYTHE MASONRY UNITS USED, TIE WYTHES TOGETHER PER NOTE 12

23. 3 #4 CONTINUOUS IN 8" DEEP GROUTED BOND BEAM AT 16" O.C. AT 24" BLOCK

24. #5 VERTICAL AT 8" O.C. – LAP 48" WITH DOWELS BELOW AND EXTEND FULL HEIGHT OF MASONRY LIFT ABOVE

DETAIL TYPE "A"

DETAIL TYPE "B"

DETAIL TYPE "C"

DETAIL TYPE "D"

RI

RETAINING WALL BEARING ON CONTROLLED COMPACTED FILL

NO BUILDING OR TIERED RETAINING WALL SURCHARGE ALLOWED ABOVE IN BACKFILL)

FOR

Construction Documents

DATE

10/27/2025

REV.

HILLSIDE

GENERAL STRUCTURAL

NOTES AND DETAILS

SO.0

1 OF 1 SHEETS

RUKAVINA
 RESIDENCE

5611 EAST ROAD RUNNER LANE
 PARADISE VALLEY AZ 85253
 Project No.XXXX

STATION
 ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
 (860) 331-0701

This Drawing is an instrument of service and is the sole property of STATION ARCHITECTS © LLC. This drawing may not be reproduced or reproduction thereof used without the written permission of STATION ARCHITECTS © LLC.

23-30

**A SUBDIVISION PLAT RECORDED IN BOOK 49 OF MAPS, PAGE 40, MCR,
LOCATED IN A PORTION OF THE NW 1/4 OF THE SW 1/4 OF THE SW 1/4 OF SECTION 33, T.3N, R.4E
OF THE GILA & SALT RIVER BASE AND MERIDIAN, MARICOPA COUNTY, ARIZONA**

**A SUBDIVISION PLAT RECORDED IN BOOK 49 OF MAPS, PAGE 40, MCR,
LOCATED IN A PORTION OF THE NW 1/4 OF THE SW 1/4 OF THE SW 1/4 OF SECTION 33, T.3N, R.4E
OF THE GILA & SALT RIVER BASE AND MERIDIAN, MARICOPA COUNTY, ARIZONA**



APN: 168-77-004
ADDRESS: 5611 E ROAD RUNNER LN.,
PARADISE VALLEY, AZ 85253
ZONING: R-175 HILLSIDE
LOT AREA: 221,685 S.F. (5.089 AC.)
QS #: 25-41

LAND DEVELOPMENT GROUP, LLC
8808 N CENTRAL AVE, SUITE 288
PHOENIX, AZ 85020
CONTACT: NICK PRODANOV, PE
P: 602 889 1984

LOT 12, MUMMY MOUNTAIN ESTATES, ACCORDING TO BOOK 49
OF MAPS, PAGE 40, RECORDS OF MARICOPA COUNTY,
ARIZONA.


BRASS CAP FLUSH AT THE INTERSECTION OF 56TH STREET AND MOCKINGBIRD
LANE HAVING AN ELEVATION OF 1349.97 NAVD 88 DATUM, GDACS# 26101-1.

THE FOUND EASTERLY LINE OF SUBJECT PROPERTY, THE BEARING OF WHICH IS N00°05'21"E.

COMMUNITY # 040049	PANEL # 1765 OF 4425		SUFFIX L	BASE FLOOD ELEVATION N/A
MAP # 04013C	PANEL DATE 10/16/2013	FIRM INDEX DATE 11/04/2015	ZONE X*	

*AREAS DETERMINED TO BE OUTSIDE THE 0.2% ANNUAL CHANCE FLOODPLAIN.

---1450--- EXISTING CONTOUR
1450..... HISTORIC CONTOUR

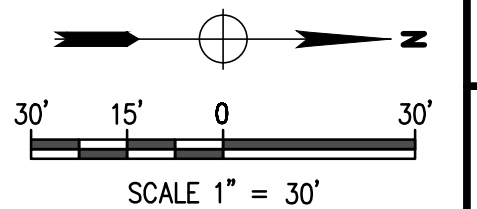

Contact Arizona 811 at least two full working days before you begin excavation


ARIZONA811
BLISS STAFF, INC.

Call 811 or click Arizona811.com

**RUKAVINA RESIDENCE
5611 E ROAD RUNNER LN.,
PARADISE VALLEY, AZ 85253**

P 602 889 1984 | F 602 445 9482
8808 N CENTRAL AVE., SUITE 288
PHOENIX, AZ 85020
PHOENIX@LDGENG.COM



AE

REINFORCING NOTES:	CONCRETE NOTES:	MASONRY NOTES:	GENERAL NOTES:
1. REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 60 (Fy = 60 KSI) DEFORMED BARS FOR ALL BARS #4 AND LARGER. ASTM A615, GRADE 40 (Fy = 40 KSI) DEFORMED BARS FOR ALL BARS #3 AND SMALLER. REINFORCING TO BE WELDED SHALL CONFORM ASTM A706, GRADE 60 (Fy = 60KSI) LOW ALLOY DEFORMED BARS. NO TACK WELDING OF REINFORCING BARS ALLOWED. 2. ALL REINFORCING STEEL SHALL BE ACCURATELY PLACED AND SUPPORTED BY GALVANIZED METAL CHAIRS, SPACERS OR HANGERS. PROVIDE THE FOLLOWING MINIMUM CLEAR CONCRETE COVERAGE: CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH: EXPOSED TO EARTH OR WEATHER: #6 AND LARGER #5 AND SMALLER ALL OTHERS PER LATEST EDITION OF ACI 318. 3. UNLESS NOTED OTHERWISE, LAP SPLICES IN CONCRETE SHALL BE CLASS "B" TENSION LAP SPLICES (2'-0" MINIMUM) PER THE LATEST EDITION OF ACI 318. STAGGER ALTERNATE SPLICES A MINIMUM OF ONE LAP LENGTH. EXTEND ALL HORIZONTAL REINFORCING CONTINUOUS AROUND CORNERS AND INTERSECTIONS OR PROVIDE BENT CORNER BARS TO MATCH AND LAP HORIZONTAL BARS AT CORNERS AND INTERSECTIONS OF FOOTINGS AND WALLS. 4. REINFORCING BAR HOOKS SHALL BE STANDARD ACI HOOKS UNLESS NOTED OTHERWISE.	1. CONCRETE WORK SHALL CONFORM TO ALL REQUIREMENTS OF ACI 301, "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" AND ACI 318, "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE." 2. CONCRETE SHALL BE READY MIXED CONCRETE IN ACCORDANCE WITH ASTM C94. MINIMUM 28 DAY COMPRESSIVE STRENGTH SHALL BE 3,000 PSI (DESIGNED FOR 2,500 PSI U.N.O.) EXCEPT AS FOLLOWS: SLABS ON GRADE FOUNDATIONS 3,000 PSI 2,500 PSI 3. CEMENT SHALL CONFORM TO ASTM C150, TYPE II. AGGREGATE PER ASTM C33. LIGHTWEIGHT AGGREGATE PER ASTM C330. MAXIMUM 3 INCH SLUMP FOR SLABS ON GRADE, 4 INCH FOR OTHER CONCRETE. CONCRETE CONTAINING SUPERPLASTICIZING ADMIXTURE SHALL HAVE FIELD-VERIFIED 3 INCH MAXIMUM SLUMP PRIOR TO ADDING ADMIXTURE AND 8 INCH MAXIMUM SLUMP AT PLACEMENT. MIX DESIGNS SHALL BE DESIGNED BY THE CONCRETE PRODUCTION FACILITY IN ACCORDANCE WITH ACI 301 AND REVIEWED BY THE STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION. 4. CONCRETE SHALL BE FREE OF CHLORIDE. NO FLY ASH ADDITIVES SHALL BE USED IN CONCRETE WHEN USED IN FLATWORK OR ARCHITECTURALLY EXPOSED CONCRETE. WHEN USED, FLY ASH SHALL CONFORM TO ASTM C618, CLASS F. FLY ASH SHALL NOT REPLACE MORE THAN 15% OF CEMENT BY WEIGHT. 5. MECHANICALLY VIBRATE ALL CONCRETE WHEN PLACED, EXCEPT THAT SLABS ON GRADE NEED TO BE VIBRATED ONLY AROUND UNDERFLOOR DUCTS, ETC. CAST CLOSURE POUR AROUND COLUMNS AFTER DEAD LOAD IS APPLIED UNLESS APPROVED OTHERWISE IN WRITING BY ARCHITECT. ALL CONCRETE SLABS ON GRADE SHALL BE BOUNDED BY CONTROL JOINTS, KEYED OR SAW CUT SUCH THAT THE ENCLOSED AREA DOES NOT EXCEED 225 SQUARE FEET. KEYED CONTROL JOINTS NEED ONLY OCCUR AT EXPOSED EDGES DURING POURING. ALL OTHER JOINTS MAY BE SAW CUT. 6. CONCRETE WHICH HAS CONTAINED WATER FOR MORE THAN 90 MINUTES (60 MINUTES IF AIR TEMPERATURE EXCEEDS 85°F) SHALL NOT BE USED. RETEMPERING OF CONCRETE INITIAL SET HAS OCCURRED IS NOT PERMITTED. 7. CURE EXPOSED CONCRETE FOR A MINIMUM OF 7 DAYS IN ACCORDANCE WITH ACI 301 PROCEDURES IN ORDER TO PREVENT CRACKING. CURE WITH CURING AND SEALING COMPOUND, MOIST CURING, MOISTURE-RETAINING COVER CURING OR COMBINATIONS THEREOF. 8. CONCRETE COMPRESSIVE STRENGTH AND SLUMP SHALL BE TESTED PER ASTM C31, C39 AND C143. PROVIDE 3 CYLINDERS PER TEST FOR EACH DAY'S CONCRETE PLACEMENT OR AS DIRECTED BY THE ARCHITECT. TEST ONE CYLINDER AT 7 DAYS AND TWO AT 28 DAYS. TESTING SHALL BE DONE BY A QUALIFIED TESTING LABORATORY.	1. MASONRY WORK SHALL CONFORM TO ALL REQUIREMENTS OF IBC AND ACI 530, "BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES." VERTICAL REINFORCING SHALL BE PER DETAILS AND AT ALL CORNERS, WALL ENDS, JAMBS AND EACH SIDE OF CONTROL JOINTS. 2. HOLLOW CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90, GRADE N, TYP 1, F'm = 1500 PSI, NET COMPRESSIVE STRENGTH OF 1900 PSI PER ASTM C140, RUNNING BOND. 3. MORTAR SHALL CONFORM TO ASTM C270 AND IRC R606.2.8, TYPE S WITH 28 DAY COMPRESSIVE STRENGTH OF 1800 PSI, TESTED PER ASTM C780. MASONRY CEMENT, PRE-MIXED MORTAR AND RETARDANT ADDITIVES SHALL NOT BE USED. 4. GROUT SHALL CONFORM TO ASTM C476 AND IRC R606.2.12, FINE OR COARSE GROUT, WITH 28 DAY COMPRESSIVE STRENGTH OF 2000 PSI, TESTED PER ASTM C1019. GROUT SHALL BE FREE OF FLY ASH AND/OR CHLORIDE. 5. ALL CELLS AND COURSES WITH REINFORCING AND ADDITIONAL GROUT SPACES AS REQUIRED BY THE DRAWINGS SHALL BE FILLED SOLID WITH GROUT. MAXIMUM GROUT LIFT 4'-8" WITH EACH GROUT POUR STOPPING 1-1/2 INCHES BELOW THE TOP COURSE OF LIFT. PROVIDE CLEANOUTS IF GROUT LIFT EXCEEDS 5'-0". PLACE GROUT CONTINUOUSLY. DO NOT INTERRUPT GROUTING FOR MORE THAN ONE HOUR. MECHANICALLY VIBRATE GROUT IN VERTICAL SPACES IMMEDIATELY AFTER POURING AND AGAIN ABOUT 5 MINUTES LATER. RODDING OF GROUT IS NOT ACCEPTABLE. 6. PROVIDE CONTROL JOINTS AT 20'-0" O.C. MAXIMUM. 7. ANY RADIUS WALLS SHALL HAVE A MINIMUM OF #5 VERTICALS AT 24" O.C. AND #4 HORIZONTALS AT 24" O.C. UNLESS MORE IS REQUIRED ON PLAN/DETAIL. 8. ANY STACK BOND WALLS SHALL HAVE A MINIMUM OF #4 VERTICALS AT 16" O.C. AND #4 HORIZONTALS AT 24' O.C. UNLESS MORE IS REQUIRED ON PLANS/DETAILS.	1. ALL WORK SHALL CONFORM TO THE 2015 INTERNATIONAL BUILDING CODE. 2. CONSTRUCTION MATERIALS SHALL BE SPREAD OUT IF PLACED ON FRAMED ROOF OR FLOOR. LOAD SHALL NOT EXCEED THE DESIGN LIVE LOAD PER SQUARE FOOT. 3. THE CONTRACTOR SHALL TAKE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION, INCLUDING, BUT NOT LIMITED TO, BRACING, SHORING, ETC. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND IMPLEMENTATION OF ALL SCAFFOLDING, BRACING AND SHORING. OBSERVATION VISITS TO THE SITE BY THE STRUCTURAL ENGINEER SHALL NOT INCLUDE INSPECTION OF THE ABOVE ITEMS. THE STRUCTURAL ENGINEER WILL NOT BE RESPONSIBLE FOR THE CONTRACTOR'S MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES OF CONSTRUCTION, NOR WILL THE STRUCTURAL ENGINEER BE RESPONSIBLE FOR CONSTRUCTION SITE SAFETY, OR THE SAFETY PRECAUTIONS AND THE PROGRAMS INCIDENT THERETO. 4. CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION WITH THE SITE CONDITIONS. RESOLVE DISCREPANCIES AND OMISSIONS WITH THE ARCHITECT. PLANS AND DETAILS IN THIS SET ARE NOT TO BE SCALED. 5. THE CONTRACT STRUCTURAL DRAWINGS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION. 6. WHERE ANY DISCREPANCIES OCCUR BETWEEN PLANS, DETAILS, GENERAL STRUCTURAL NOTES AND SPECIFICATIONS, THE GREATER REQUIREMENTS SHALL GOVERN. WHERE NO SPECIFIC DETAIL IS SHOWN, CONSTRUCTION SHALL CONFORM TO SIMILAR WORK ON THE PROJECT. FOR BIDDING PURPOSES, WHERE ANY MEMBER OR STRUCTURAL ELEMENT IS SHOWN BUT NOT CALLED OUT ON THE PLANS OR DETAILS, THE LARGEST SIMILAR MEMBER OR ELEMENT USED IN THE PROJECT SHALL BE UTILIZED. 7. DESIGN LOADS: WIND: ULTIMATE WIND SPEED = 115 MPH (ULT.) – 3 SEC. GUST, EXPOSURE "C" SEISMIC: DESIGN CATEGORY "B"

CMU RETAINING WALL SCHEDULE BEARING ON CONTROLLED COMPACTED FILL									
HEIGHT "H"	REFERENCE DETAIL TYPE	"W" FTG. WIDTH	"Tw" TOE WIDTH	"t" FTG. THICKNESS	"L" LONG. BARS	HEEL REINFORCING T.O.F.	TOE REINFORCING B.O.F.	DOWELS	"V" VERTICAL BARS
0'-0" TO 2'-0"	"A"	2'-0"	0'-8"	0'-10"	3 #4 BARS	NOT REQ.	NOT REQ.	#5 AT 48" O.C. CENTERED – FULL HEIGHT EXTENSION	SEE DOWELS
2'-1" TO 4'-8"	"A"	3'-0"	0'-8"	1'-0"	4 #4 BARS	NOT REQ.	NOT REQ.	#5 AT 32" O.C. SOIL SIDE – 38" EXTENSION MIN.	#5 AT 48" O.C. CENTERED
4'-9" TO 6'-8"	"A"	4'-3"	1'-0"	1'-0"	4 #5 BARS	#5 AT 14" O.C.	NOT REQ.	#5 AT 8" O.C. SOIL SIDE – 38" EXTENSION MIN.	#5 AT 32" O.C. SOIL SIDE
6'-9" TO 8'-8"	"B"	5'-6"	1'-2"	1'-0"	6 #5 BARS	#5 AT 12" O.C.	NOT REQ.	#5 AT 8" O.C. SOIL SIDE – 38" EXTENSION MIN.	#5 AT 32" O.C. SOIL SIDE
8'-9" TO 10'-0"	"B"	6'-9"	1'-6"	1'-2"	8 #5 BARS	#5 AT 8" O.C.	#5 AT 12" O.C.	#6 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 16" O.C. SOIL SIDE
10'-1" TO 12'-0"	"C"	8'-0"	2'-0"	1'-2"	10 #5 BARS	#5 AT 8" O.C.	#5 AT 12" O.C.	#6 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 32" O.C. SOIL SIDE
12'-1" TO 13'-4"	"C"	9'-4"	2'-8"	1'-4"	10 #5 BARS	#6 AT 9" O.C.	#6 AT 14" O.C.	#7 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 24" O.C. SOIL SIDE
13'-5" TO 16'-0"	"D"	11'-9"	3'-9"	1'-6"	15 #5 BARS	#6 AT 8" O.C.	#6 AT 8" O.C.	#7 AT 8" O.C. SOIL SIDE – 54" EXTENSION MIN.	#5 AT 16" O.C. SOIL SIDE

DETAIL NOTES

1. "V" VERTICALS PER SCHEDULE – LAP DOWELS FULL HEIGHT AND VERTICALS 60 BAR DIAMETER U.N.O.

2. DOWELS PER SCHEDULE – EXTEND OUT OF FOOTING A MINIMUM OF 60 BAR DIAMETERS U.N.O.

3. LADDER REINFORCING PER G.S.N. AT 16" O.C.

4. 1" Ø WEEP HOLE AT 6'-0" O.C. – LOCATE 12" ABOVE LOWER FINISHED GRADE

5. CONCRETE SLAB WHERE SHOWN ON PLANS

6. LEVEL FINISHED GRADE

7. CONCRETE FOOTING PER SCHEDULE

8. "L" LONGITUDINAL BARS PER SCHEDULE – SPREAD EVENLY BETWEEN TOP AND BOTTOM OF FOOTING

9. TRANSVERSE HEEL REINFORCING PER SCHEDULE – LOCATE AT THE TOP OF FOOTING

10. TRANSVERSE TOE REINFORCING – LOCATE AT THE BOTTOM OF FOOTING

11. #5 DOWELS AT 16" O.C. AT NON-SOIL SIDE FACE OF MASONRY – EXTEND FULL HEIGHT OF FIRST LIFT

12. #3 HAIRPINS AT 16" O.C. EACH WAY WITH 6" BEND EACH END

13. 1 #4 CONTINUOUS IN 8" DEEP GROUTED BOND BEAM AT TOP OF WALL, FINISHED GRADE AND 48" O.C. BLW

14. 2 #4 CONTINUOUS IN 8" DEEP GROUTED BOND BEAM AT TOP AND MID-HEIGHT OF 12" AND 16" BLOCK

15. ROCK POCKET WRAPPED IN FILTER FABRIC – BOTTOM OF POCKET SHALL BE 9" ABOVE LOWER FINISHED GRADE

16. EMBED DOWEL FULL DEPTH OF FOOTING TO 3" CLR FROM BOTTOM – TERMINATE WITH STANDARD ACI HOOK

17. #5 VERTICALS AT 48" O.C. CENTERED IN SCREEN WALL ABOVE RETAINING – LAP 30" MIN. BELOW

18. VENEER AS OCCURS PER ARCH'L DWGS.

19. 8" CMU RETAINING WALL – SOLID GROUT WALLS BELOW GRADE

20. 12" SOLID GROUTED CMU RETAINING WALL – EXTEND

FOOTING DOWELS FULL HEIGHT

21. 16" SOLID GROUTED CMU RETAINING WALL – EXTEND DOWELS FULL HEIGHT. 16" WIDE NOMINAL BLOCK REQUIRED WHERE 12" CMU WALL ABOVE OCCURS – WHERE 8" CMU WALL ABOVE OCCURS DOUBLE WYTHE 8" CMU MAY BE USED AND TIED TOGETHER PER NOTE 17

22. 24" SOLID GROUTED CMU RETAINING WALL, IF MULTIPLE WYTHE MASONRY UNITS USED, TIE WYTHES TOGETHER PER NOTE 12

23. 3 #4 CONTINUOUS IN 8" DEEP GROUTED BOND BEAM AT 16" O.C. AT 24" BLOCK

24. #5 VERTICAL AT 8" O.C. – LAP 48" WITH DOWELS BELOW AND EXTEND FULL HEIGHT OF MASONRY LIFT ABOVE

DETAIL TYPE "A"

DETAIL TYPE "B"

DETAIL TYPE "C"

DETAIL TYPE "D"

RETAINING WALL BEARING ON CONTROLLED COMPACTED FILL

NO BUILDING OR TIERED RETAINING WALL SURCHARGE ALLOWED ABOVE IN BACKFILL)

RUKAVINA
 RESIDENCE

5611 EAST ROAD RUNNER LANE
 PARADISE VALLEY AZ 85253
 Project No.XXXX

STATION
 ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
 (860) 331-0701

FOR Construction Documents

DATE 10/27/2025

REV.

HILLSIDE
 GENERAL STRUCTURAL
 NOTES AND DETAILS

SO.0

1 OF 1 SHEETS

23-30



EXISTING DISTURBANCE

1" = 30'-0"



ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FDR FINAL HILLSIDE


DATE 4.21.2026

REV.

AERIAL OVERLAY -
EXISTING SITE
CONDITIONS

HS-1

OF SHEETS

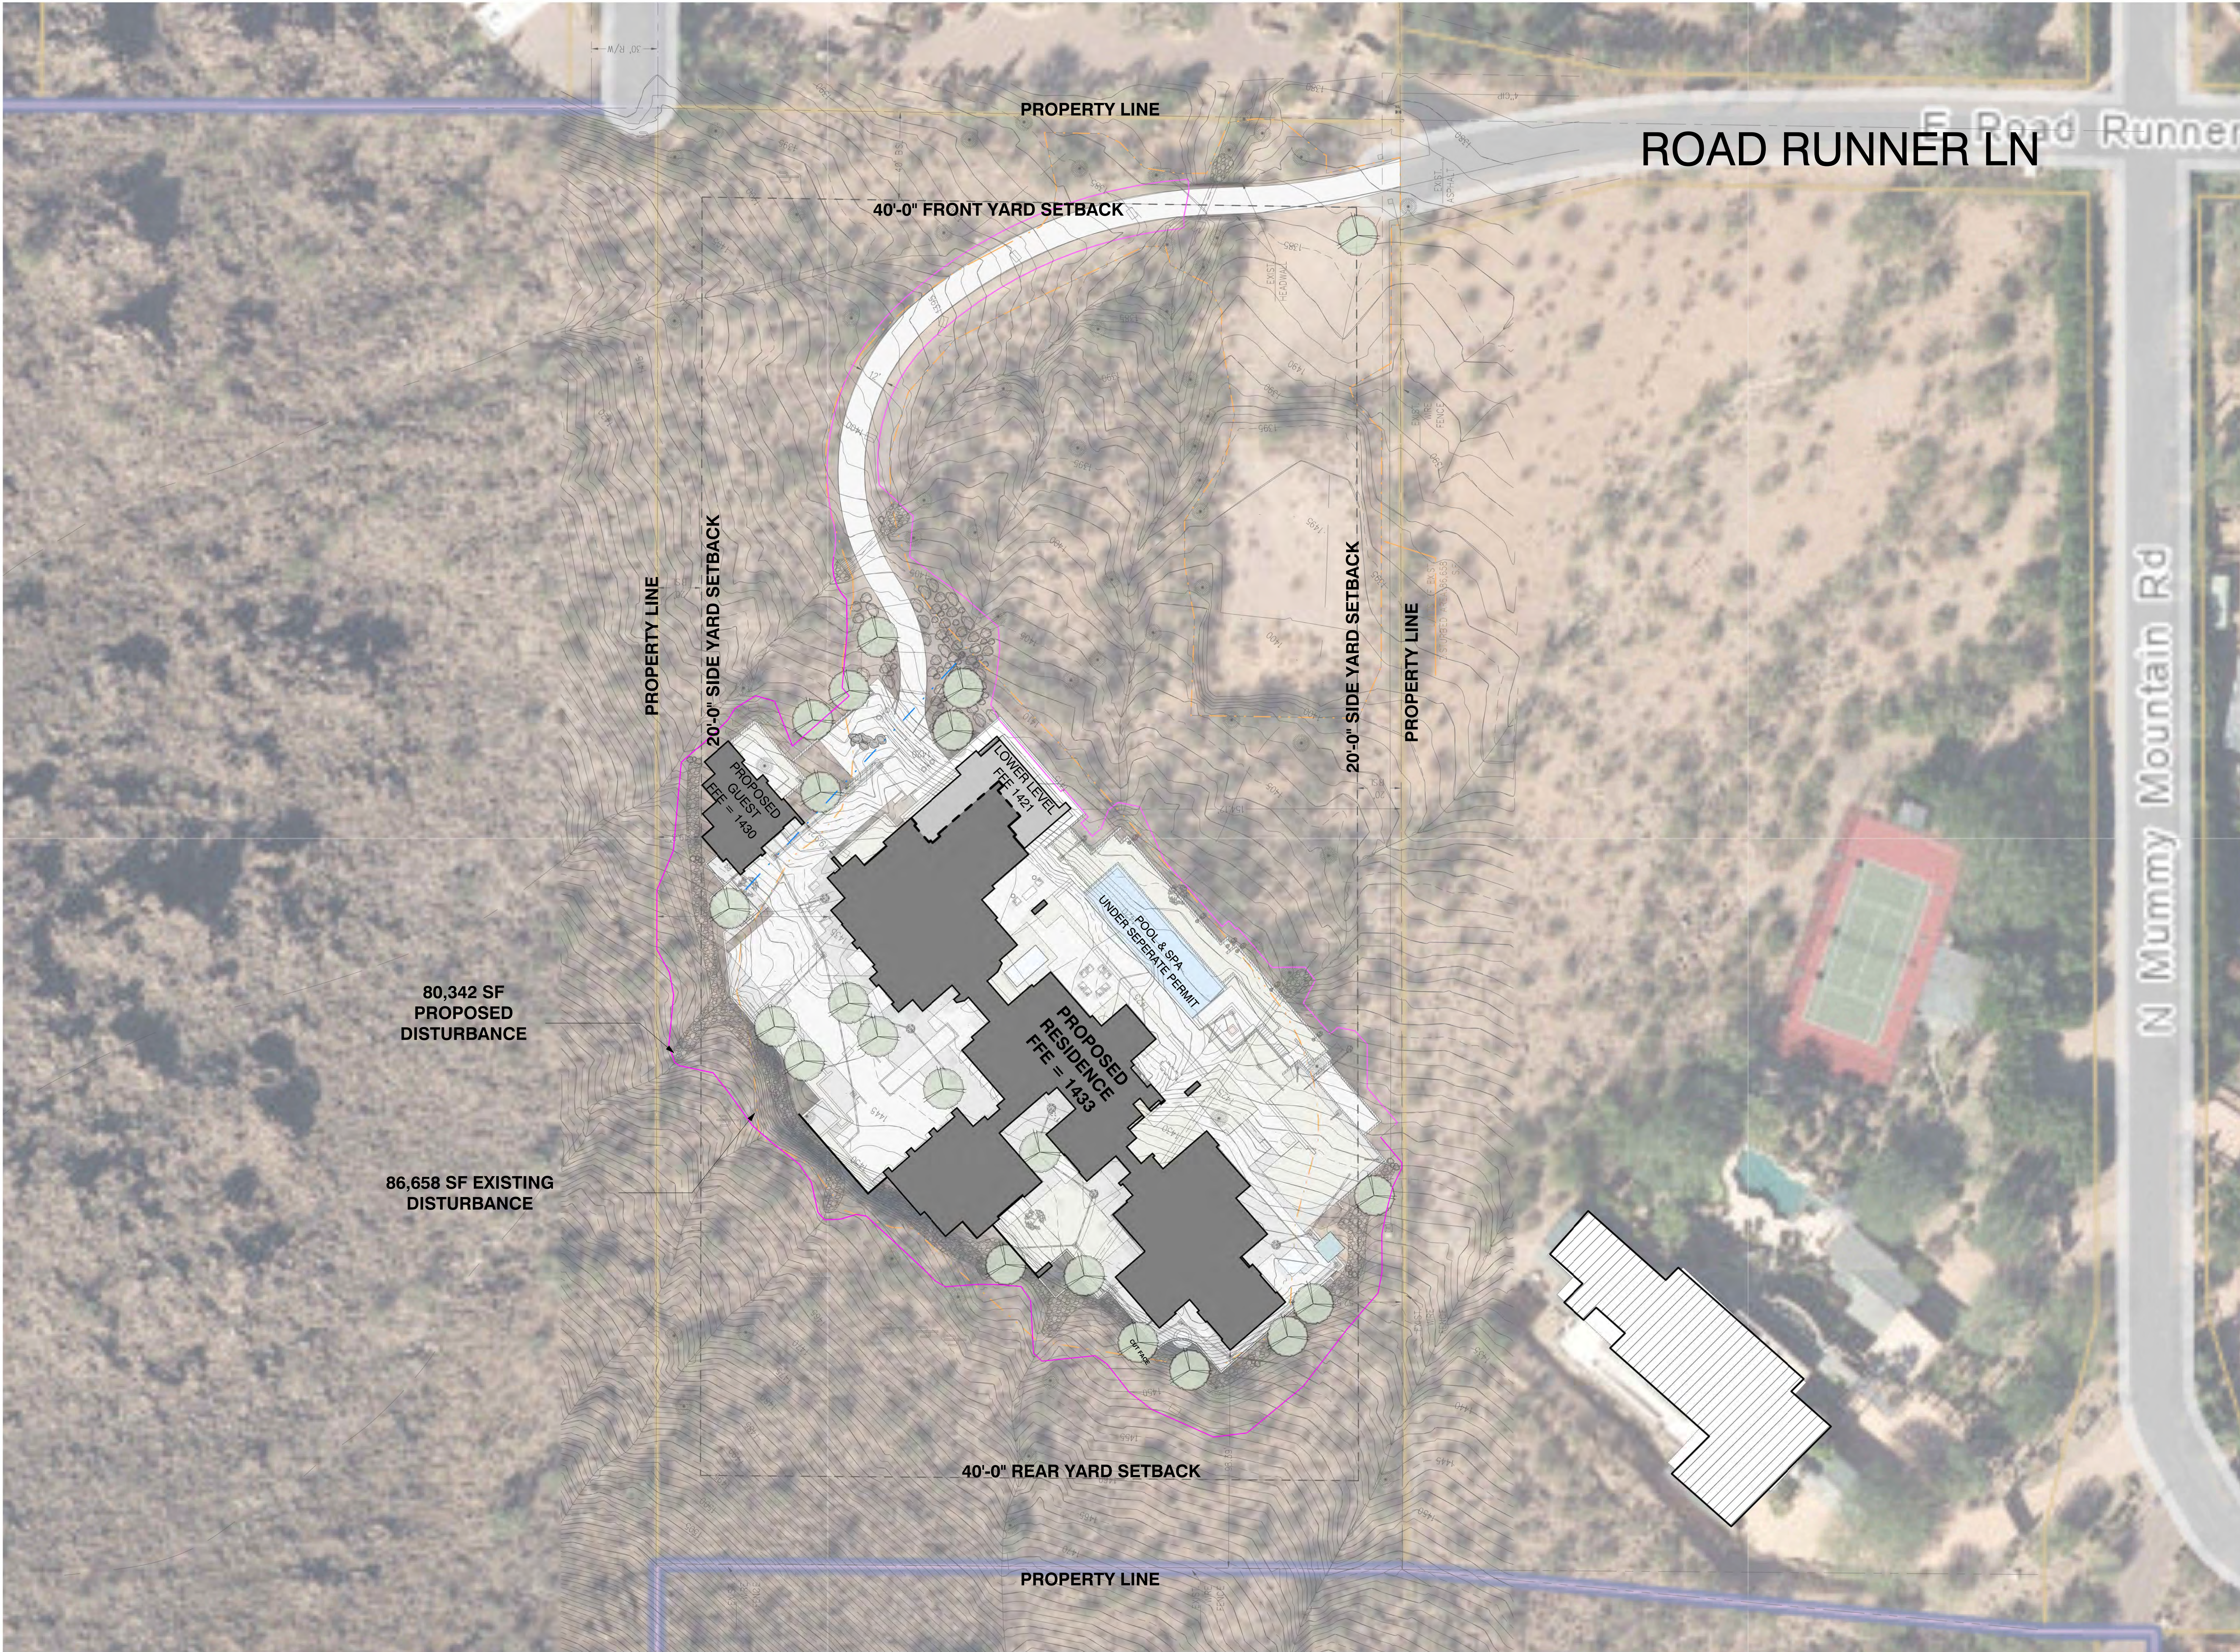

ARCHITECTURAL SITE PLAN

1" = 30'-0"

LOT SIZE:	=221,685 SF
ALLOWABLE FAR -25%	=55,421 SF
PROPOSED FAR	=28,882 SF
BUILDING PAD SLOPE	=18.6%
EXISTING DISTURBED	=86,658 SF
PROPOSED DISTURBANCE AREA	=80,342 SF

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FDR FINAL HILLSIDE

DATE 4.21.2026


REV.

AERIAL OVERLAY

HS-2

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No.25-16

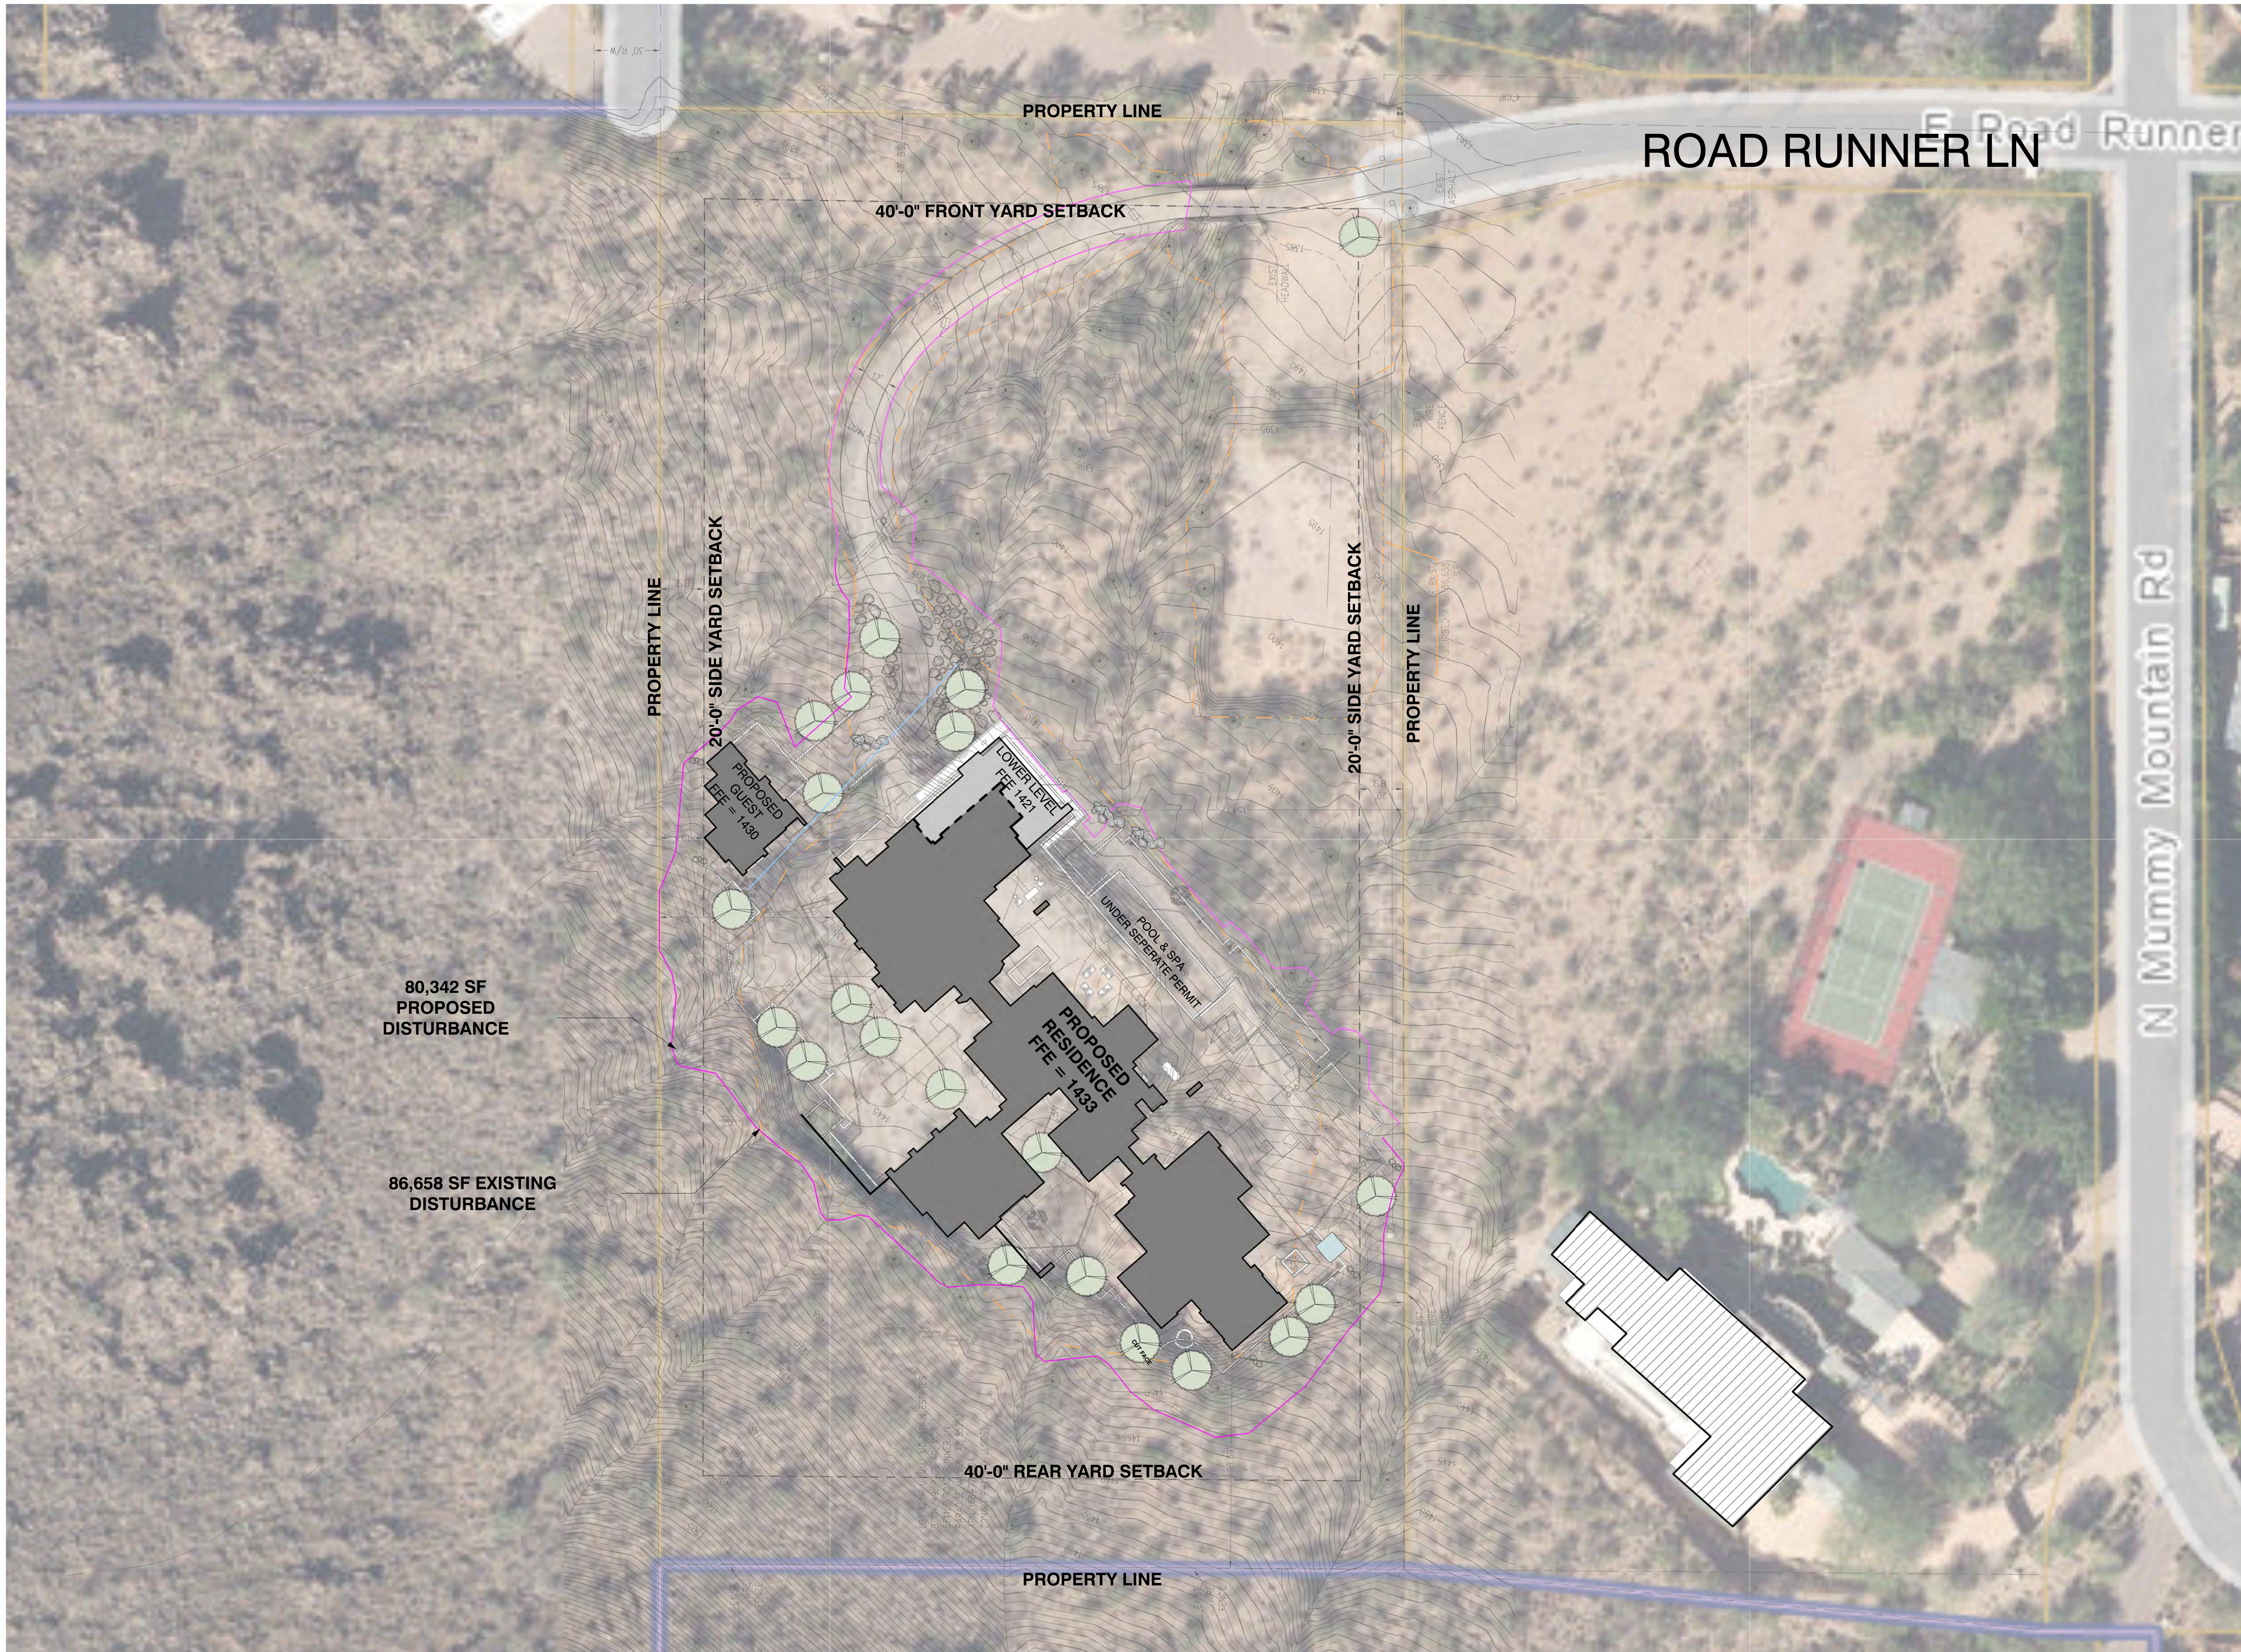

ARCHITECTURAL SITE PLAN

1" = 30'-0"

LOT SIZE:	=221,685 SF
ALLOWABLE FAR -25%	=55,421 SF
PROPOSED FAR	=28,882 SF
BUILDING PAD SLOPE	=18.6%
EXISTING DISTURBED	=86,658 SF
PROPOSED DISTURBANCE AREA	=80,342 SF

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FDR FINAL HILLSIDE

DATE 4.21.2026


REV.

AERIAL OVERLAY

HS-3

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No.25-16

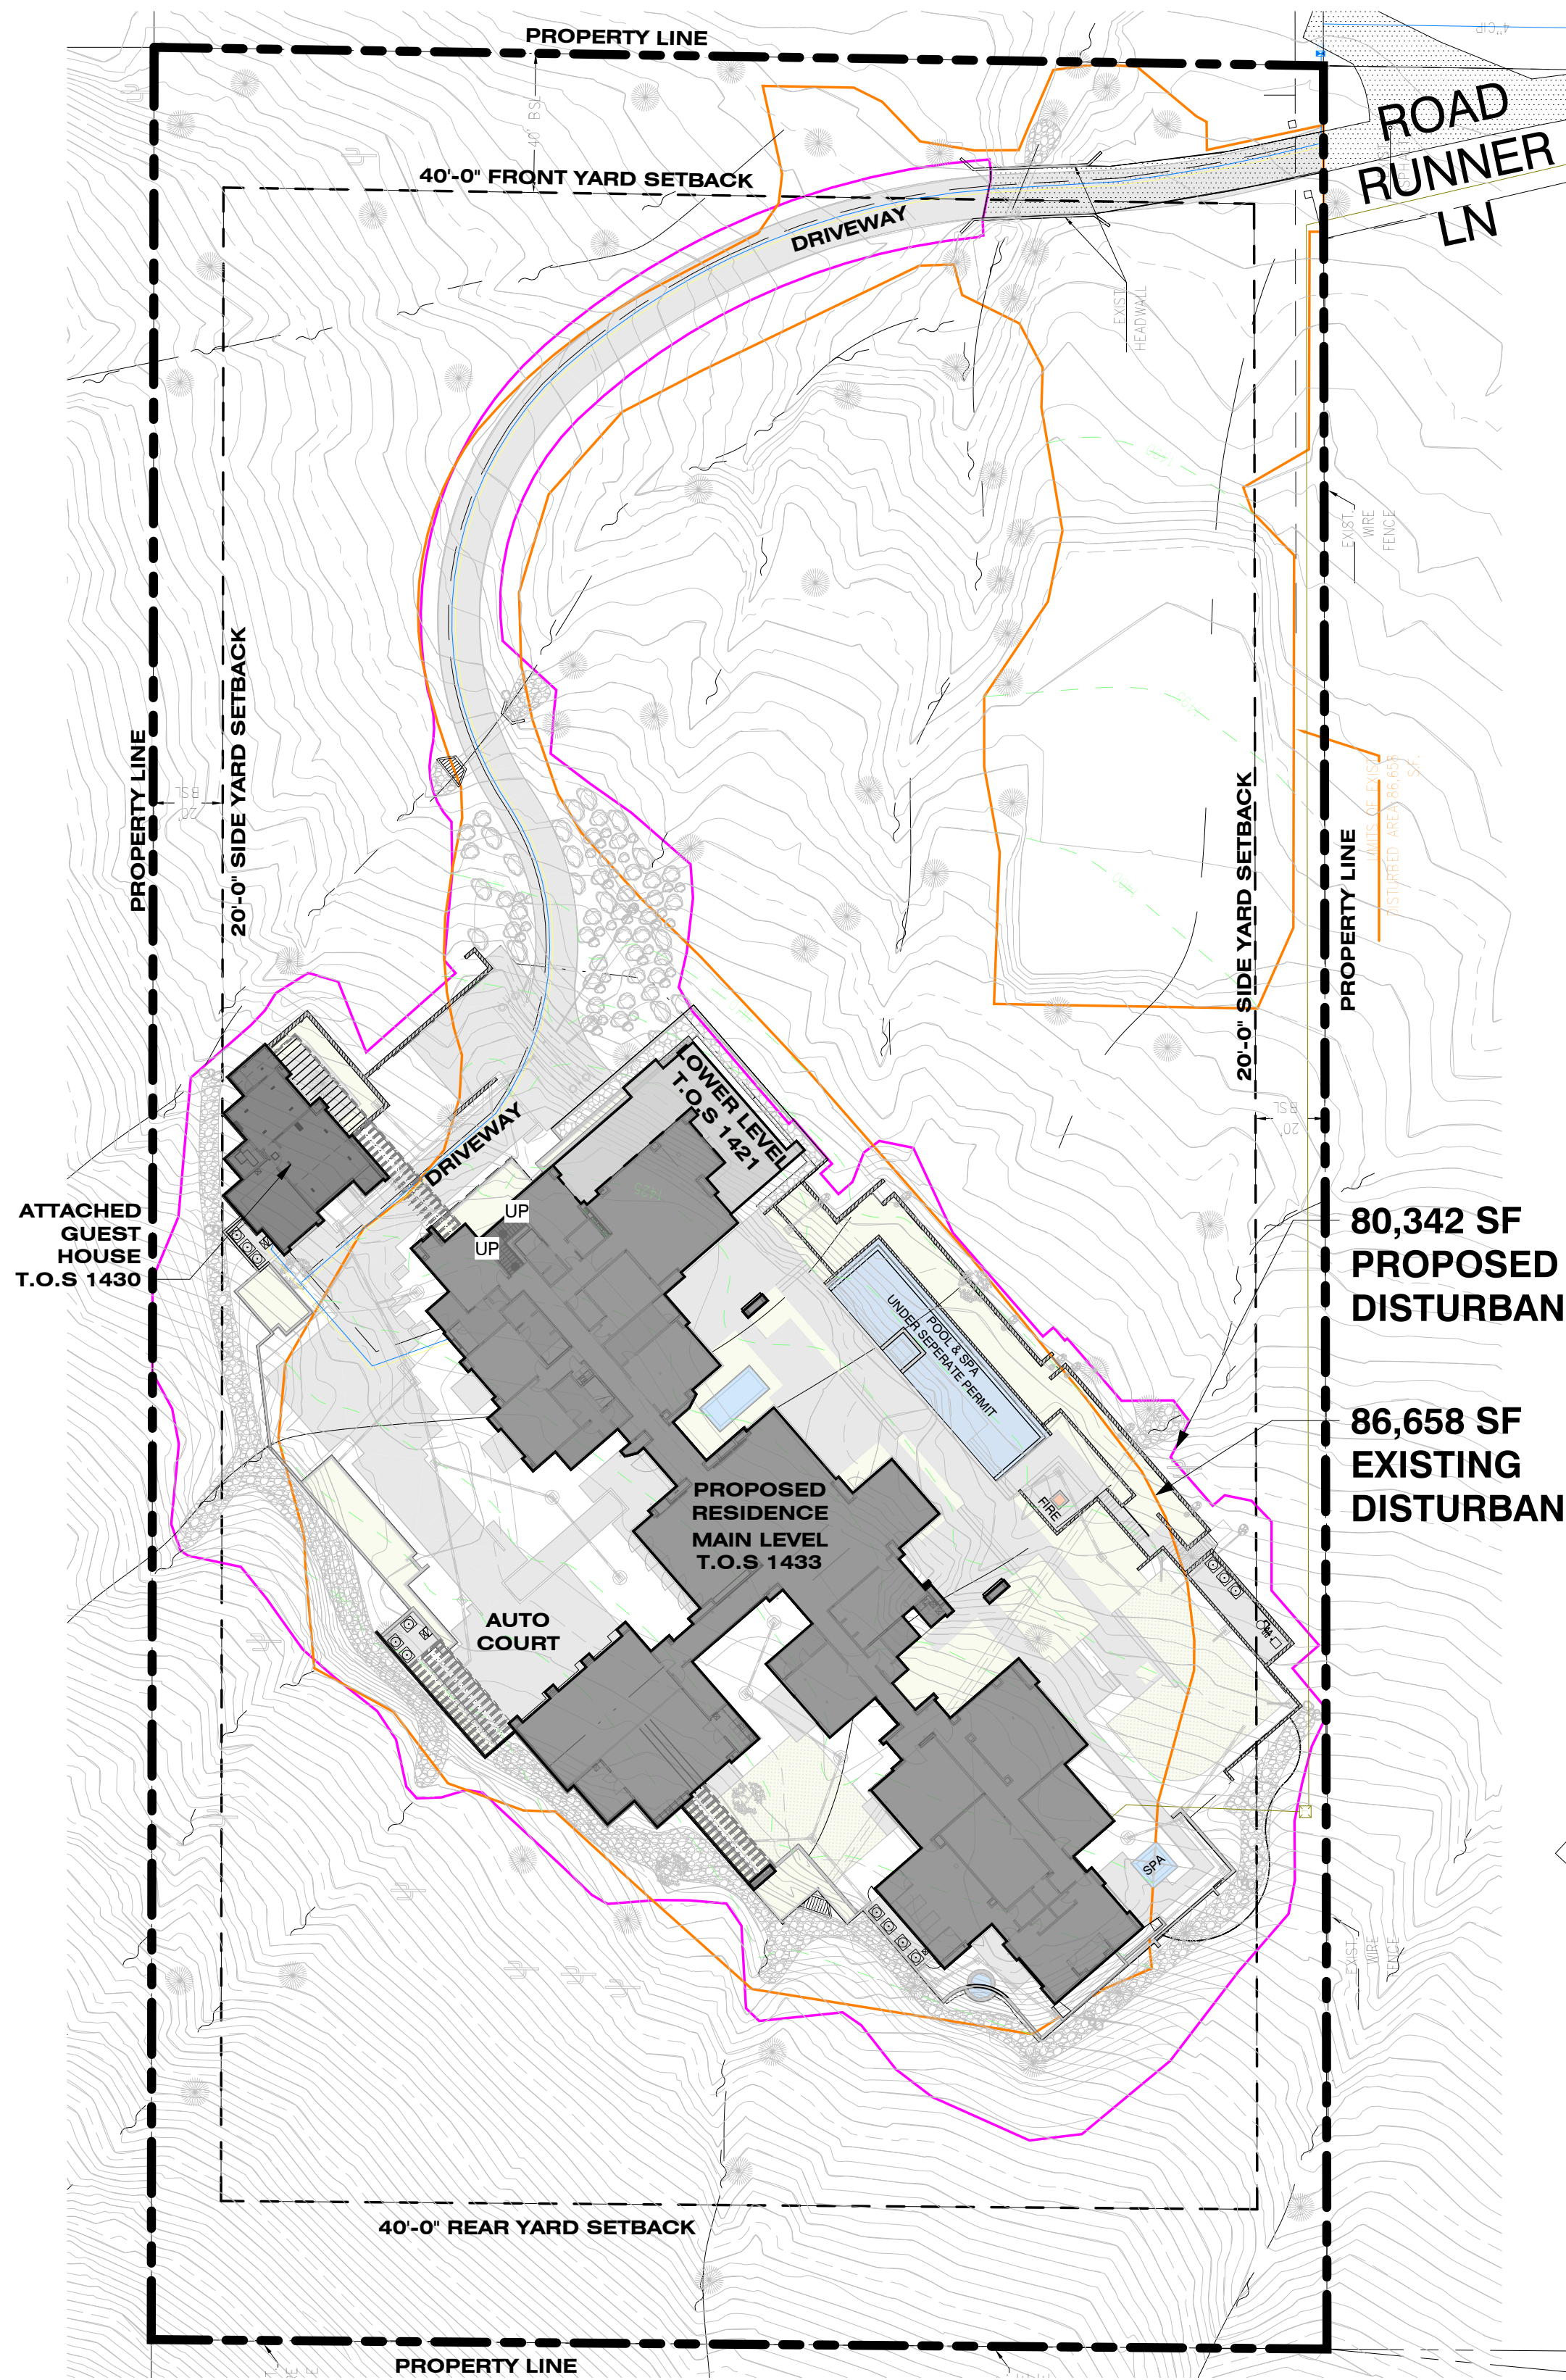


ARCHITECTURAL SITE PLAN

1" = 40'-0"



LOT SIZE: =221,685 SF
ALLOWABLE FAR -25% =55,421 SF
PROPOSED FAR =28,882 SF
BUILDING PAD SLOPE =18.6%
EXISTING DISTURBED =86,658 SF
PROPOSED DISTURBANCE AREA =80,342 SF

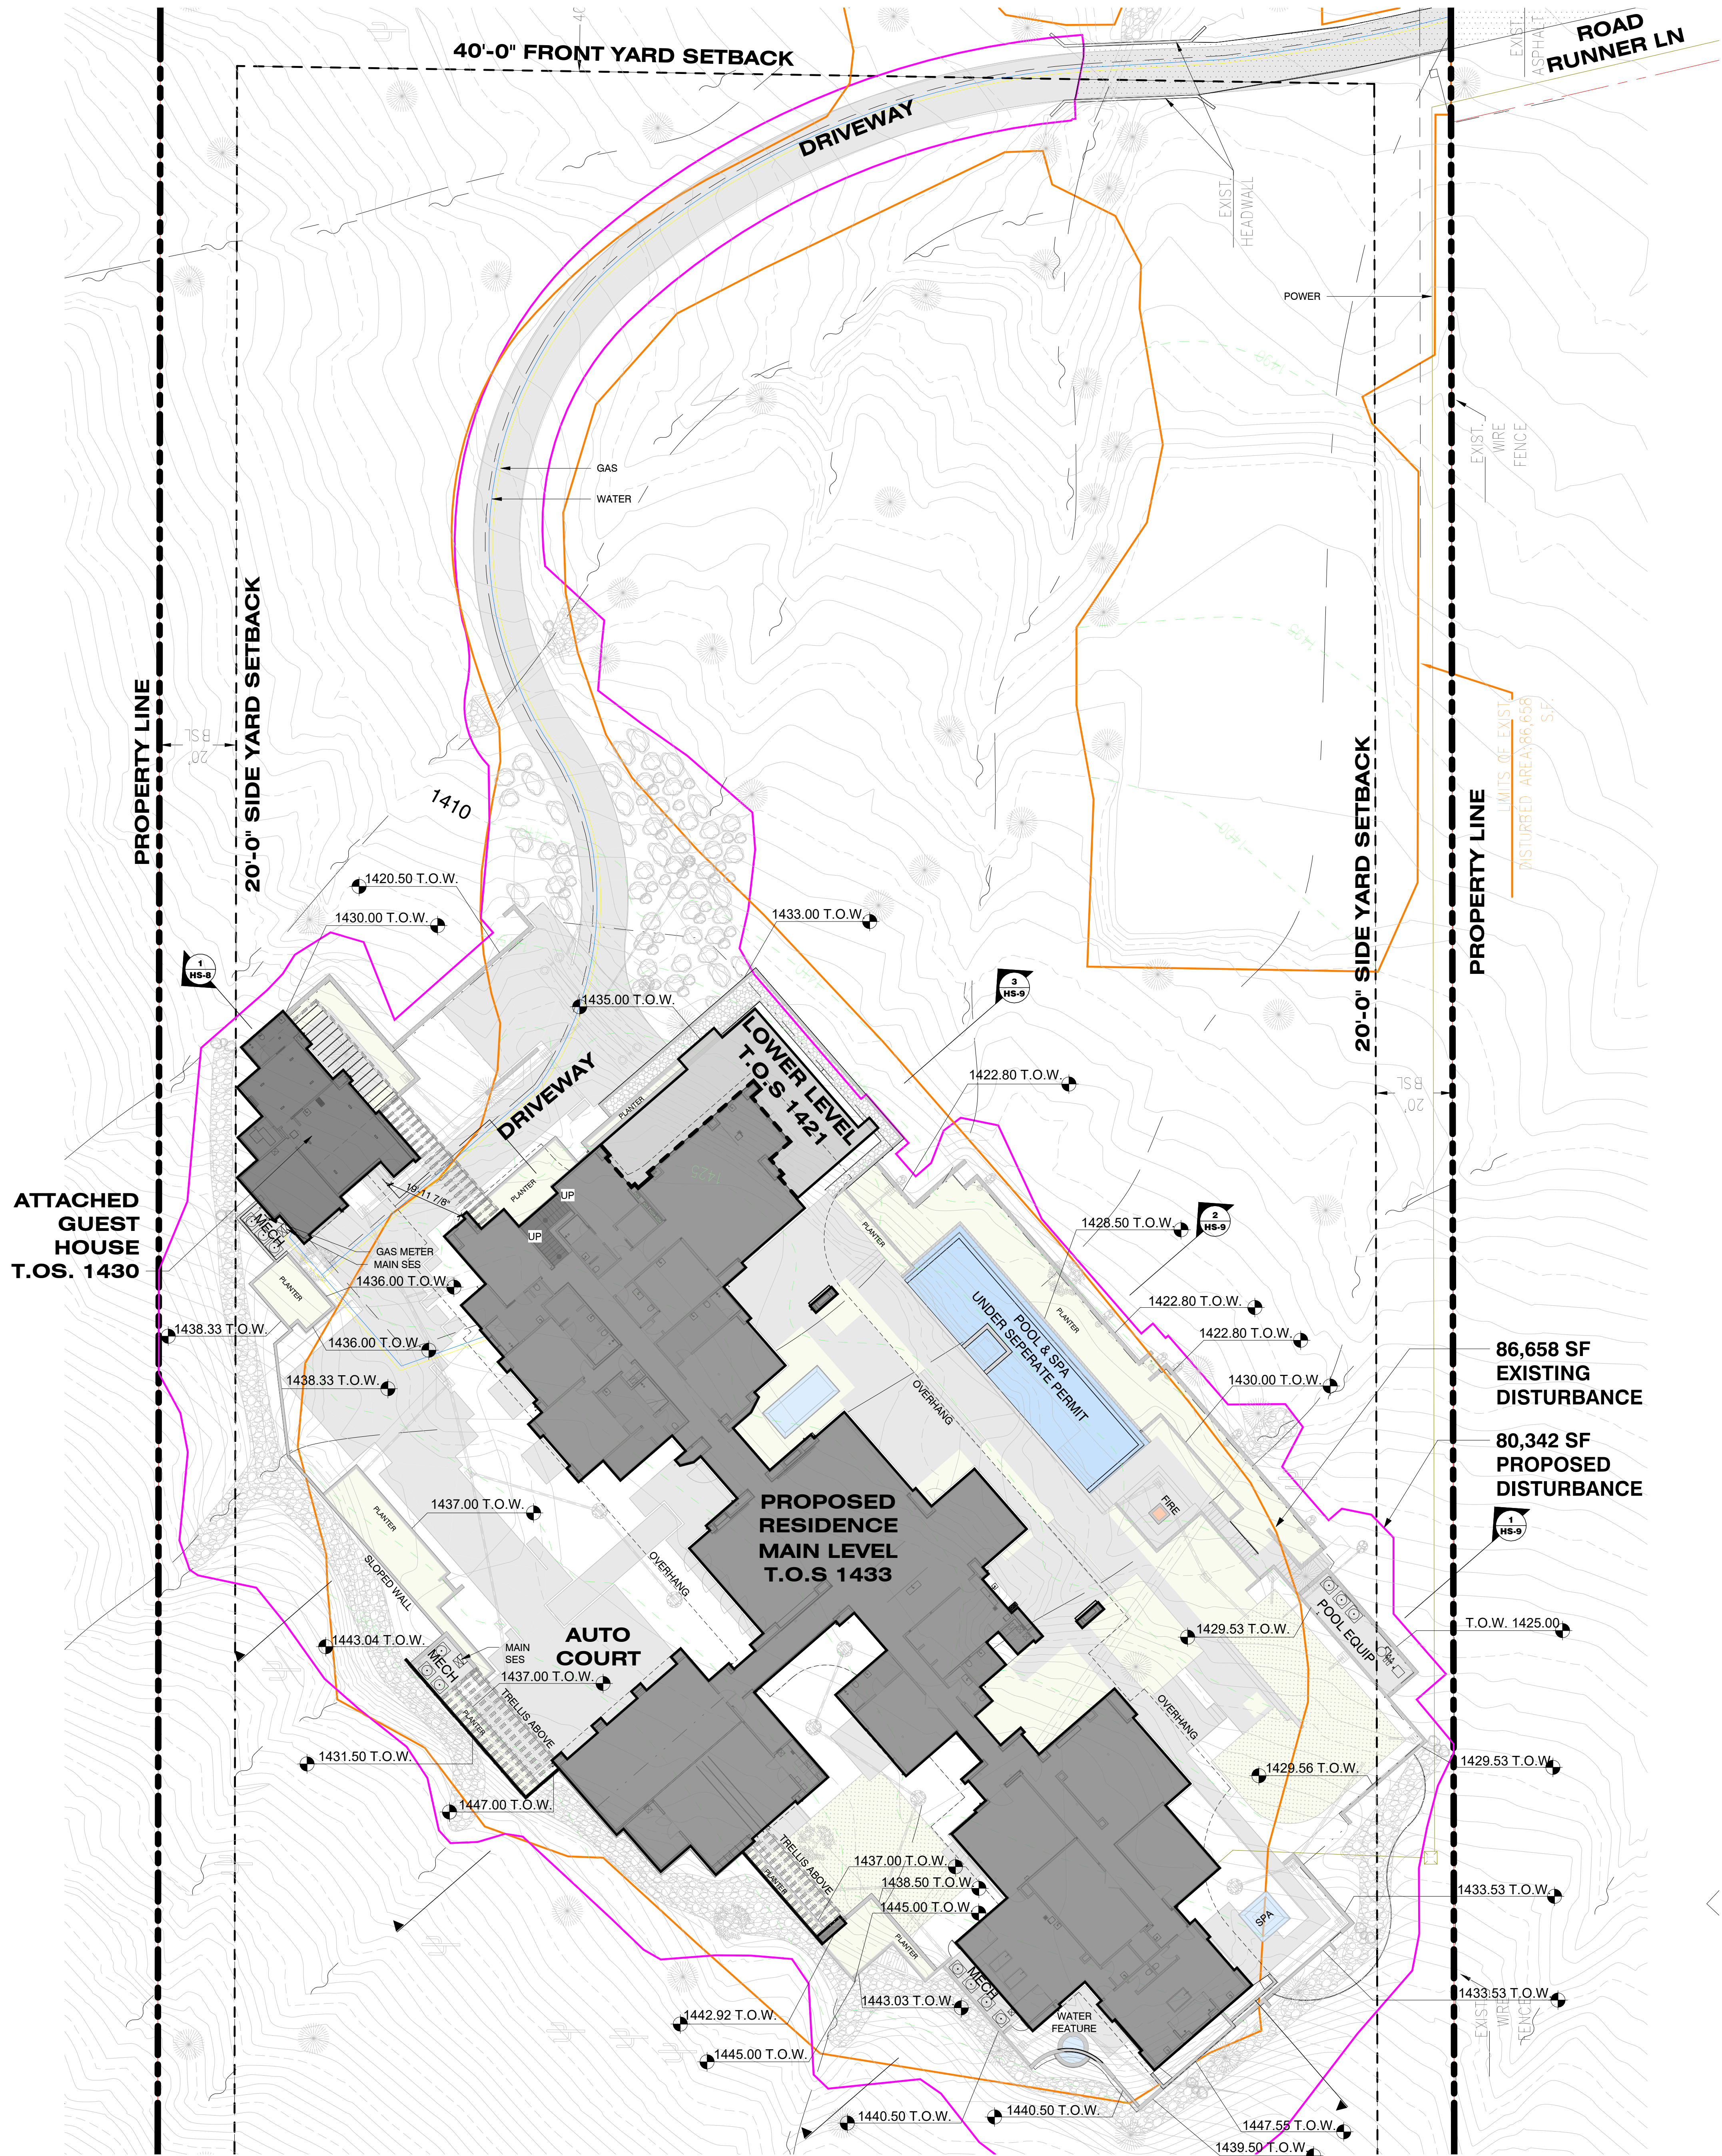

ARCHITECTURAL SITE PLAN

1" = 20'-0"



ROAD RUNNER RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No.25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FDR CD SET

DATE 5.20.2026

REV.

ARCHITECTURAL
SITE PLAN

HS-4

OF SHEETS



WEST ELEVATION

3/32" = 1'-0"



EAST ELEVATION

3/32" = 1'-0"

HIGHEST P.O.I.
+1,452.81
LEVEL 2 T.O.S.
+1,445
LEVEL 1 T.O.S.
+1,433
GUEST LEVEL
+1,430
BASEMENT
+1,421
LOWEST P.O.I.
+1,419

POINT OF IMPROVEMENT

HIGHEST P.O.I.
+1,452.81
LEVEL 2 T.O.S.
+1,445
LEVEL 1 T.O.S.
+1,433
GUEST LEVEL
+1,430
BASEMENT
+1,421
LOWEST P.O.I.
+1,419

POINT OF IMPROVEMENT

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701




This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR	FINAL HILLSIDE
DATE	4.21.2026
REV.	

ELEVATIONS

HS-5

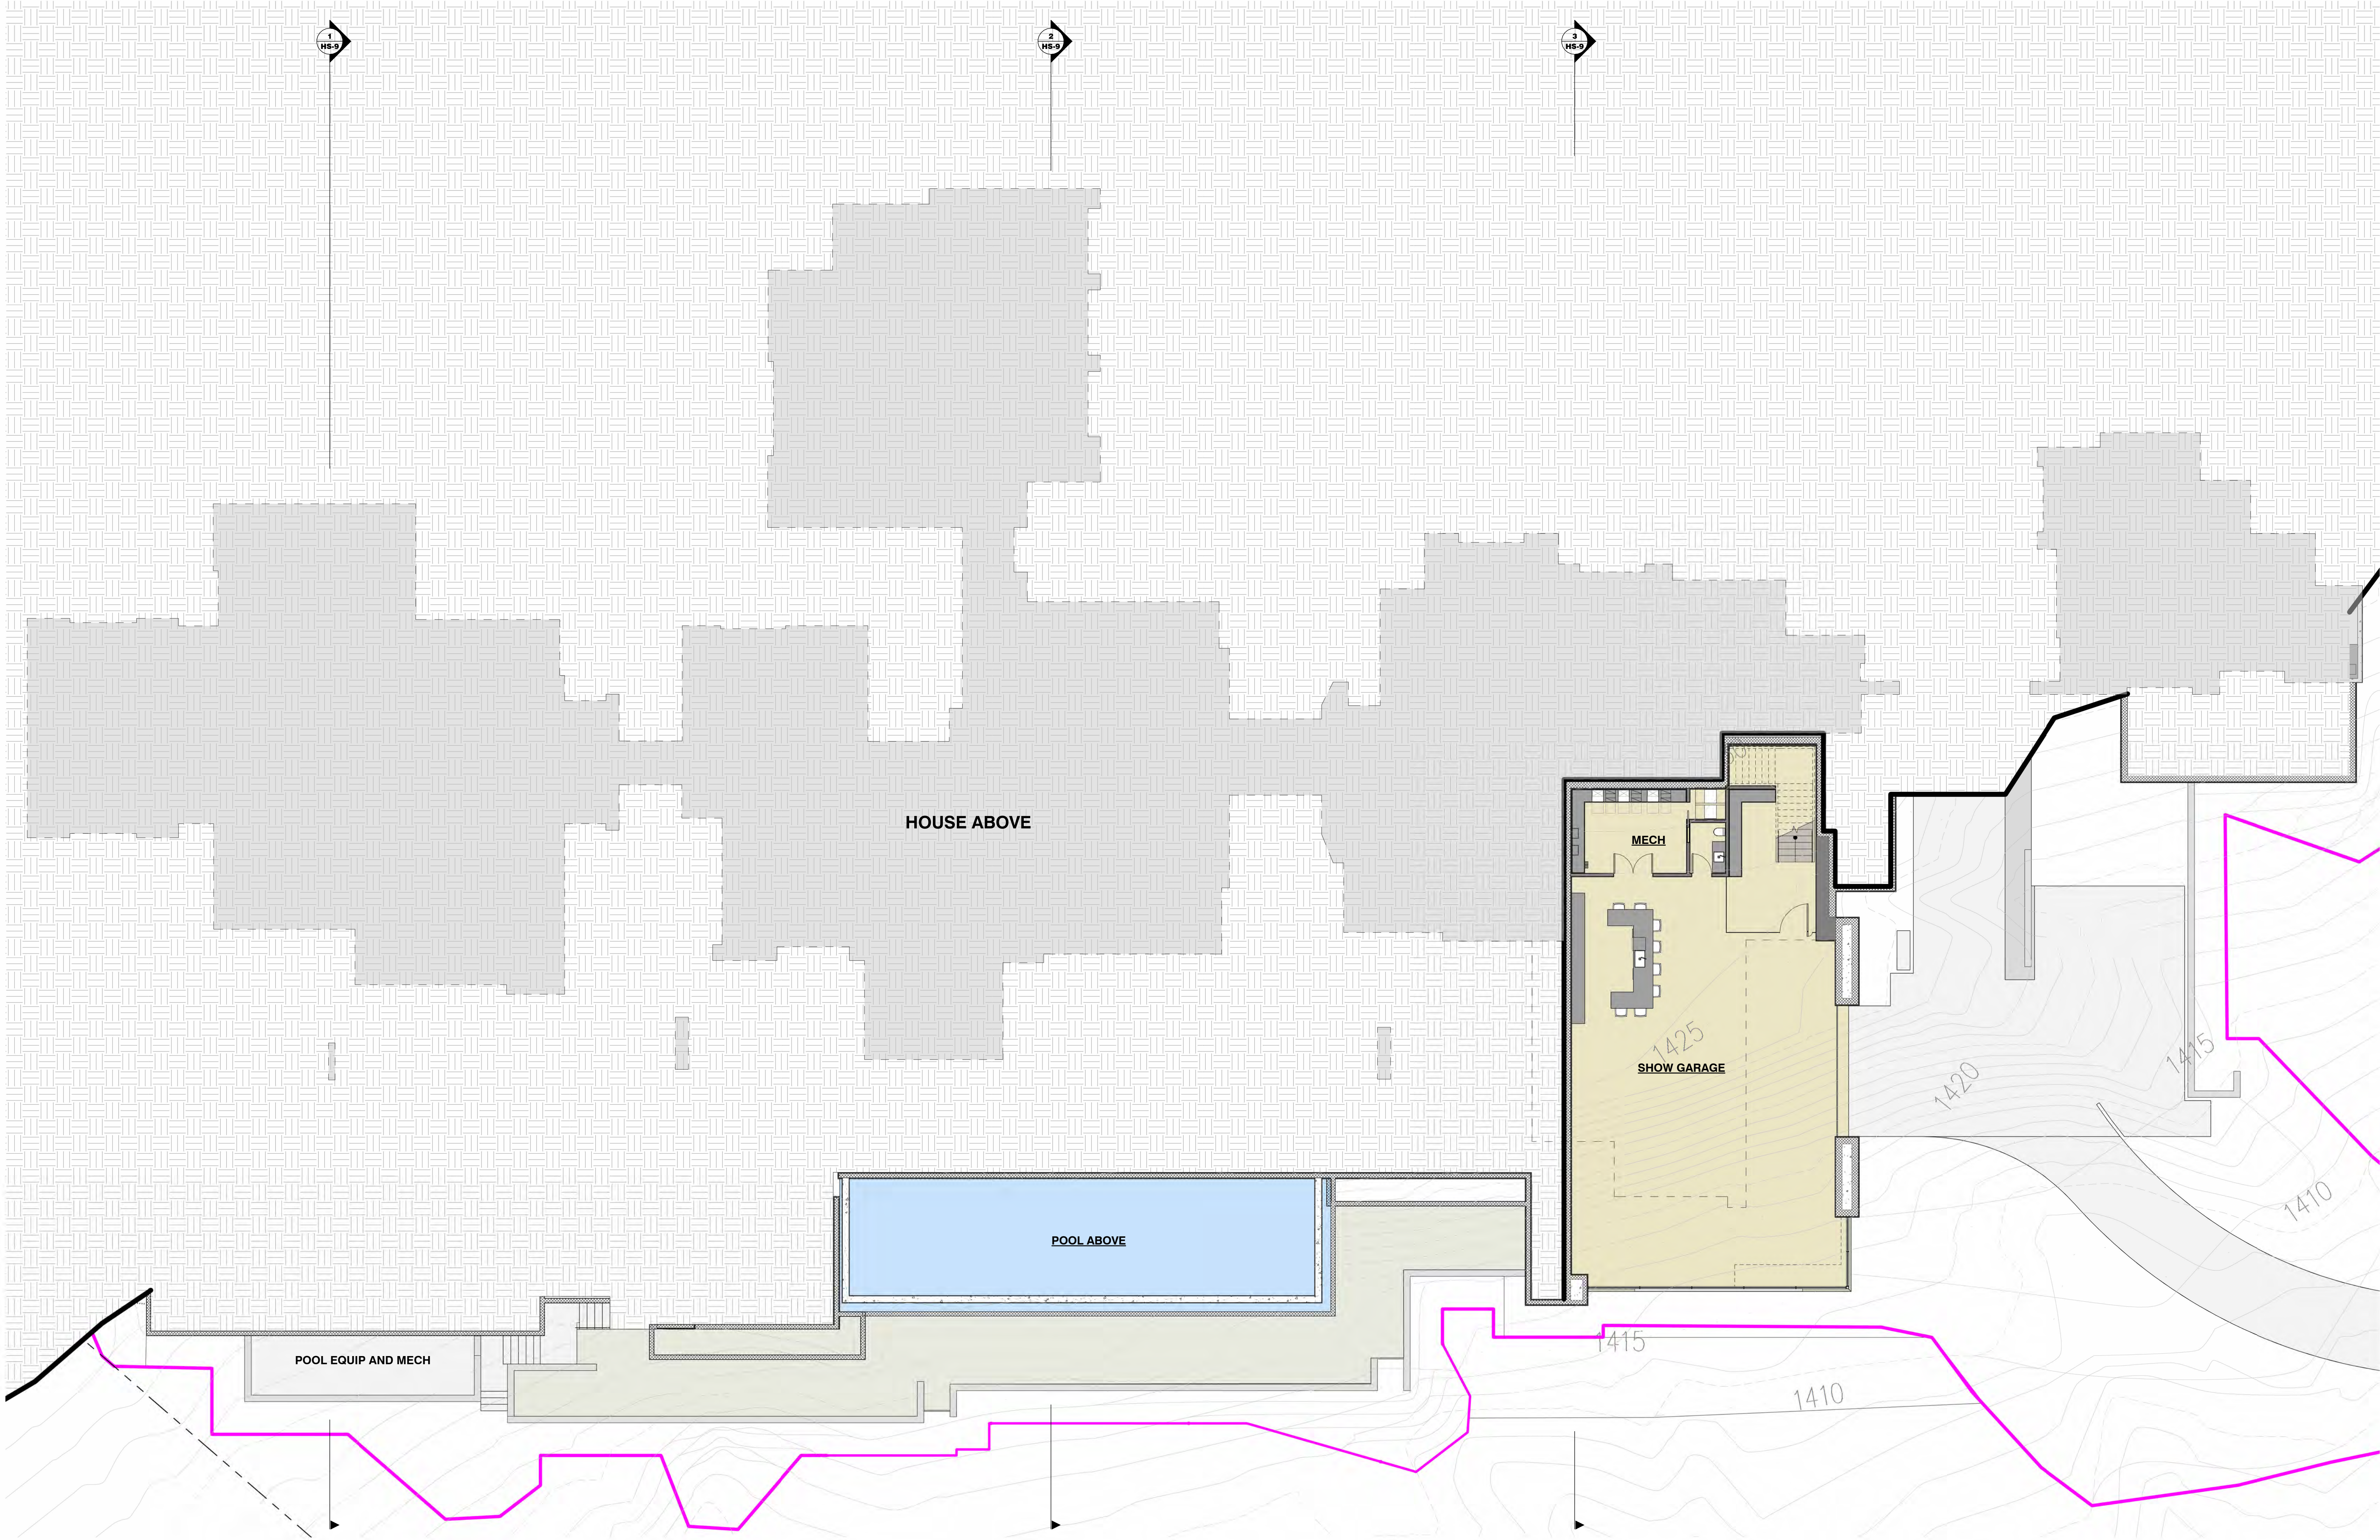

LOWER LEVEL FLOOR PLAN

1" = 10'-0"



ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

LOWER LEVEL
FLOOR PLAN

HS-6

OF SHEETS

MAIN LEVEL FLOOR PLAN

3/32" = 1'-0"



ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FDR CD SET


DATE 5.20.2026

REV.

MAIN LEVEL FLOOR
PLAN

HS-7

OF SHEETS

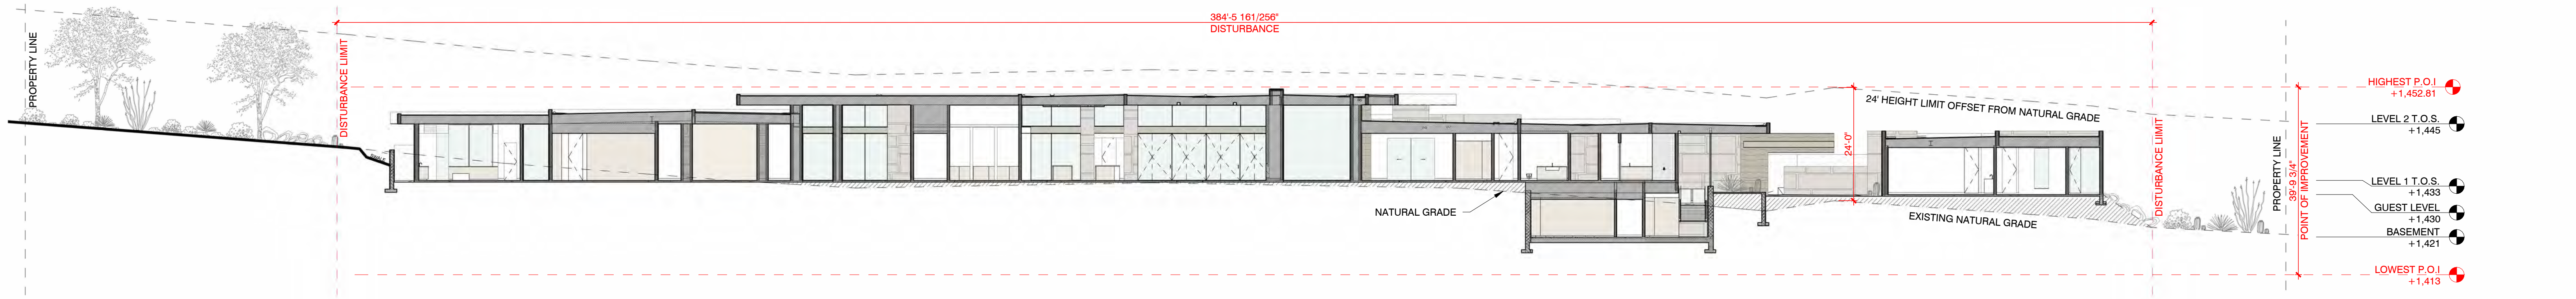

SITE SECTION 1 OVERALL

1/16" = 1'-0"




SITE SECTION 1 - PARTIAL A

1/8" = 1'-0"

MATERIAL LEGEND

- STUCCO TO COMPLY WITH HILLSIDE LRV
COLOR SHERWIN WILLIAMS SW7507 STONE LION
- METAL FASCIA, FINISH OCM BRONZE ORE
MATTE ESR #2048
- ACCENT STEEL - PURE + FREEFORM
DECO BRONZE 2 (STOCKED FINISH) #FA098
- GLASS
- HOUSE STONE - COLMAR - ECO OUTDOOR
- HOUSE ACCENT STONE - PACIFIC BLACK
FLAMED - SOLSTICE STONE
- SITE STONE - BERKSHIRE RUBBLE - SOLSTICE
STONE
- FRAME CONSTRUCTION
- CMU CONSTRUCTION
- STONE OR TILE VENEER

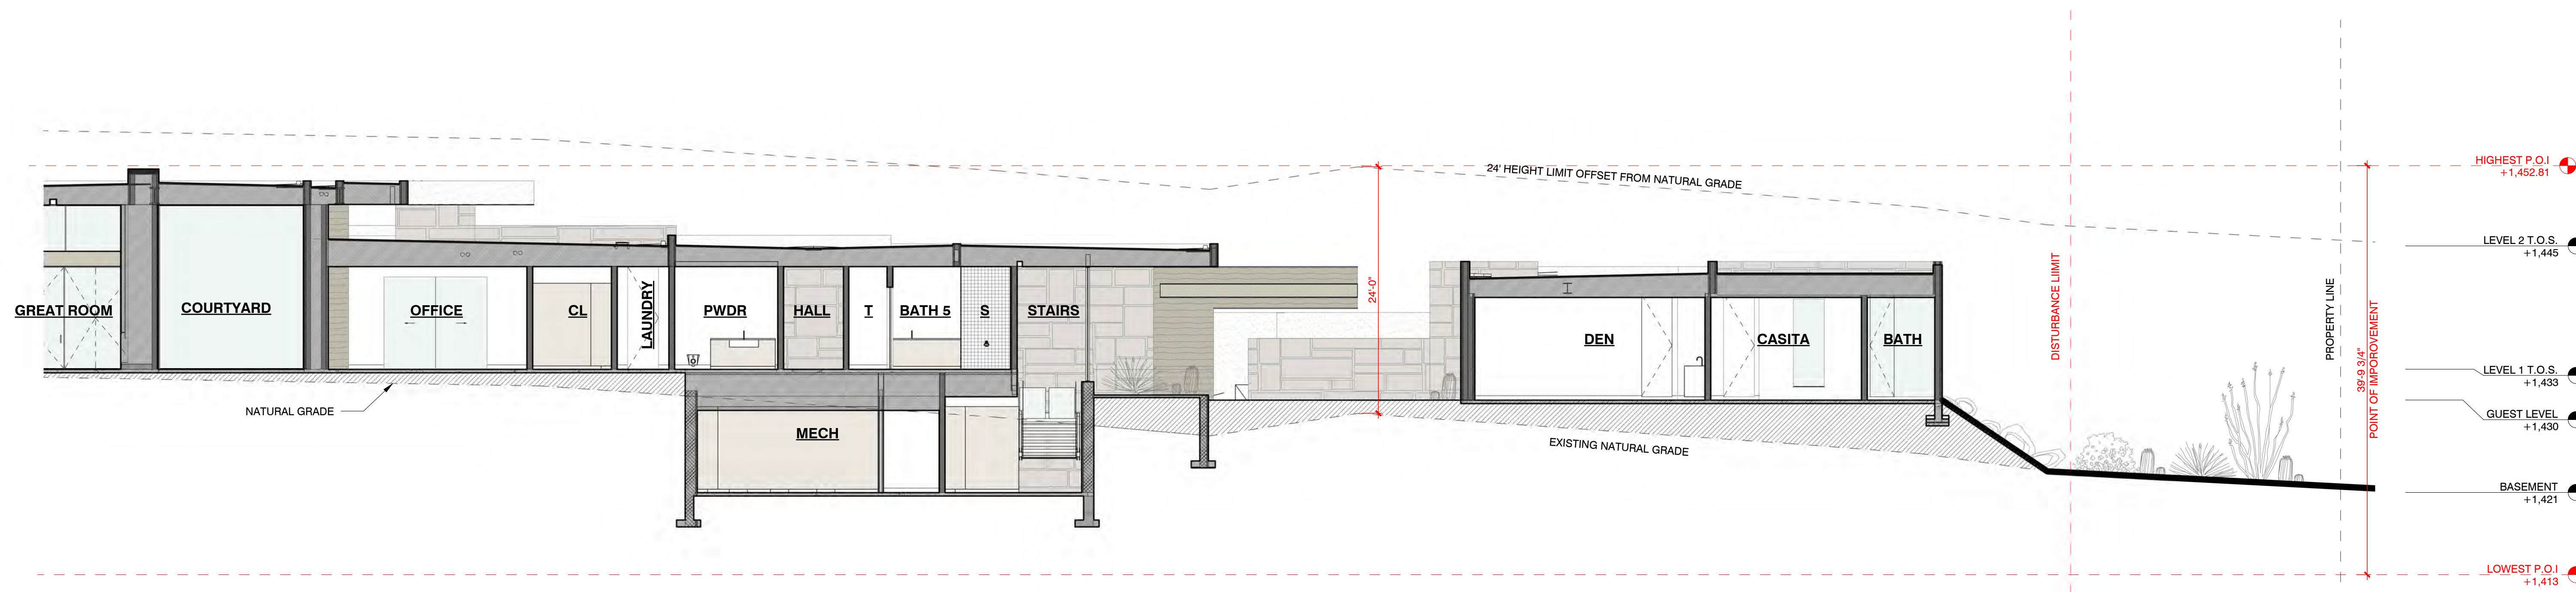

SITE SECTION 1 - PARTIAL B

1/8" = 1'-0"

ROAD RUNNER RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

SITE SECTIONS

HS-8



OF SHEETS


5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No.25-16

7026 N Longlook Way, Paradise Valley, Arizona 85253
(860) 331-0701



11C This discussion may not be reproduced or reproduced hereof used without the written permission of STATTON ACQUISITION
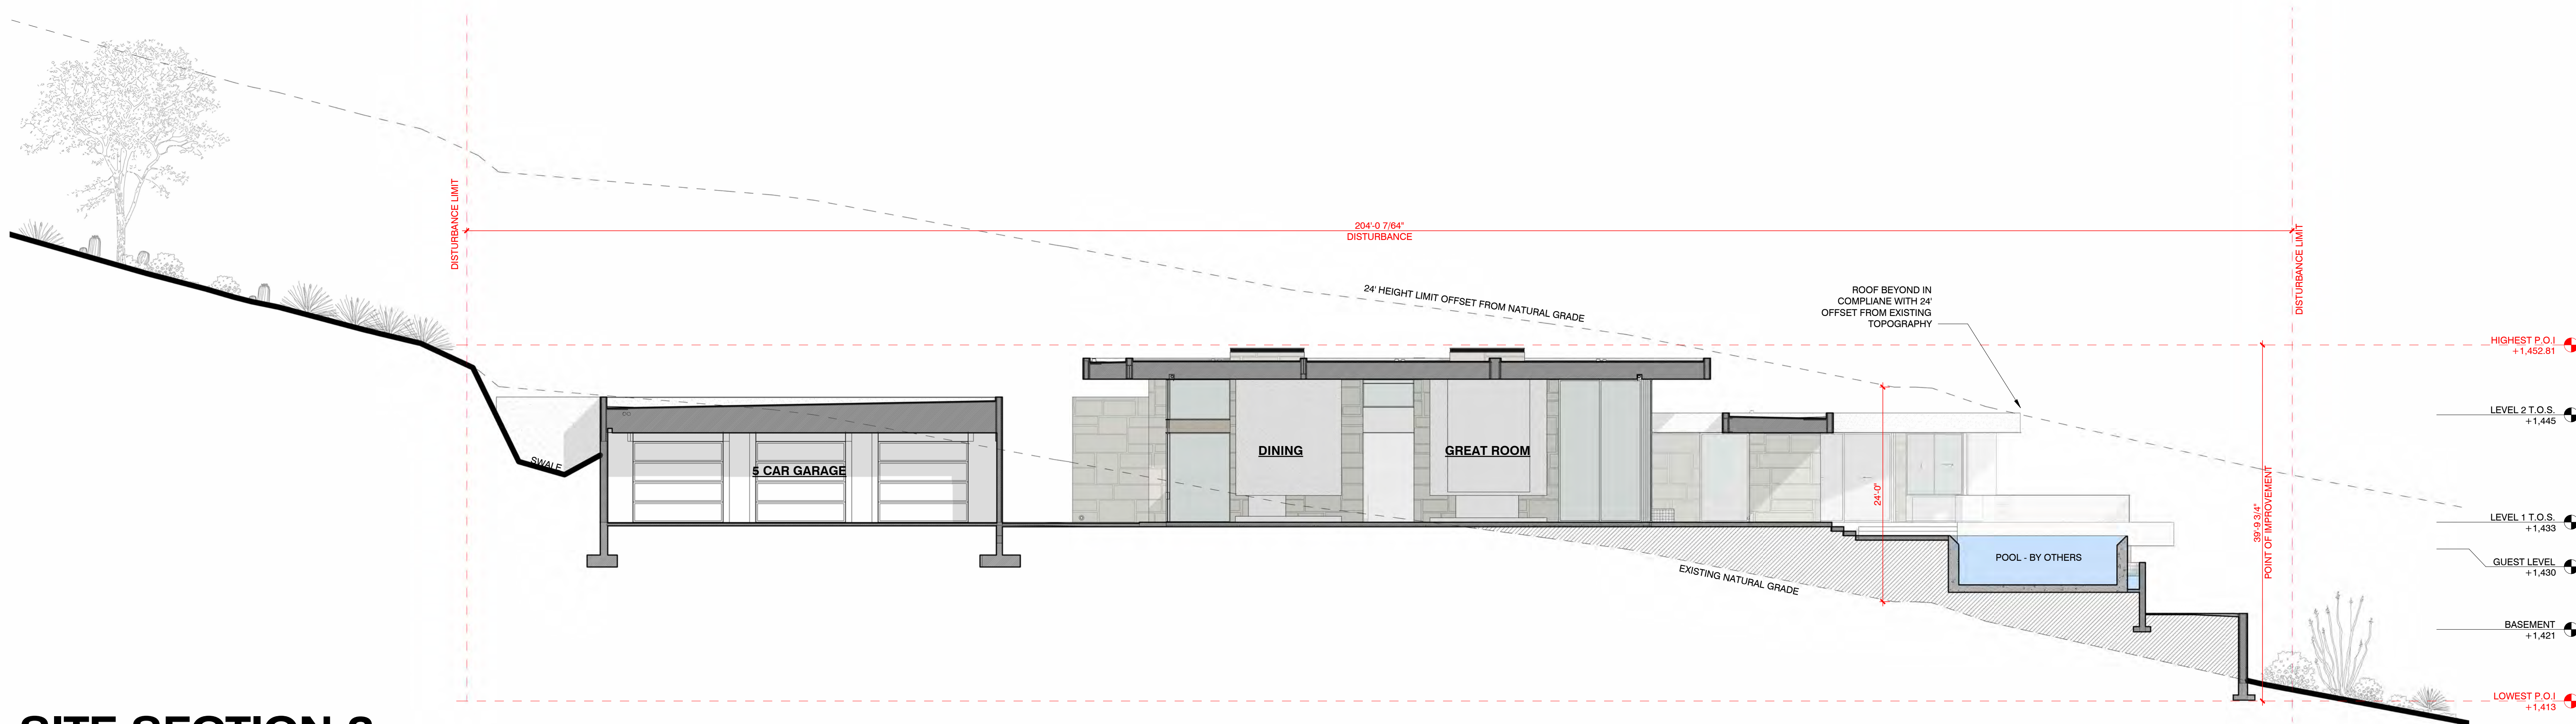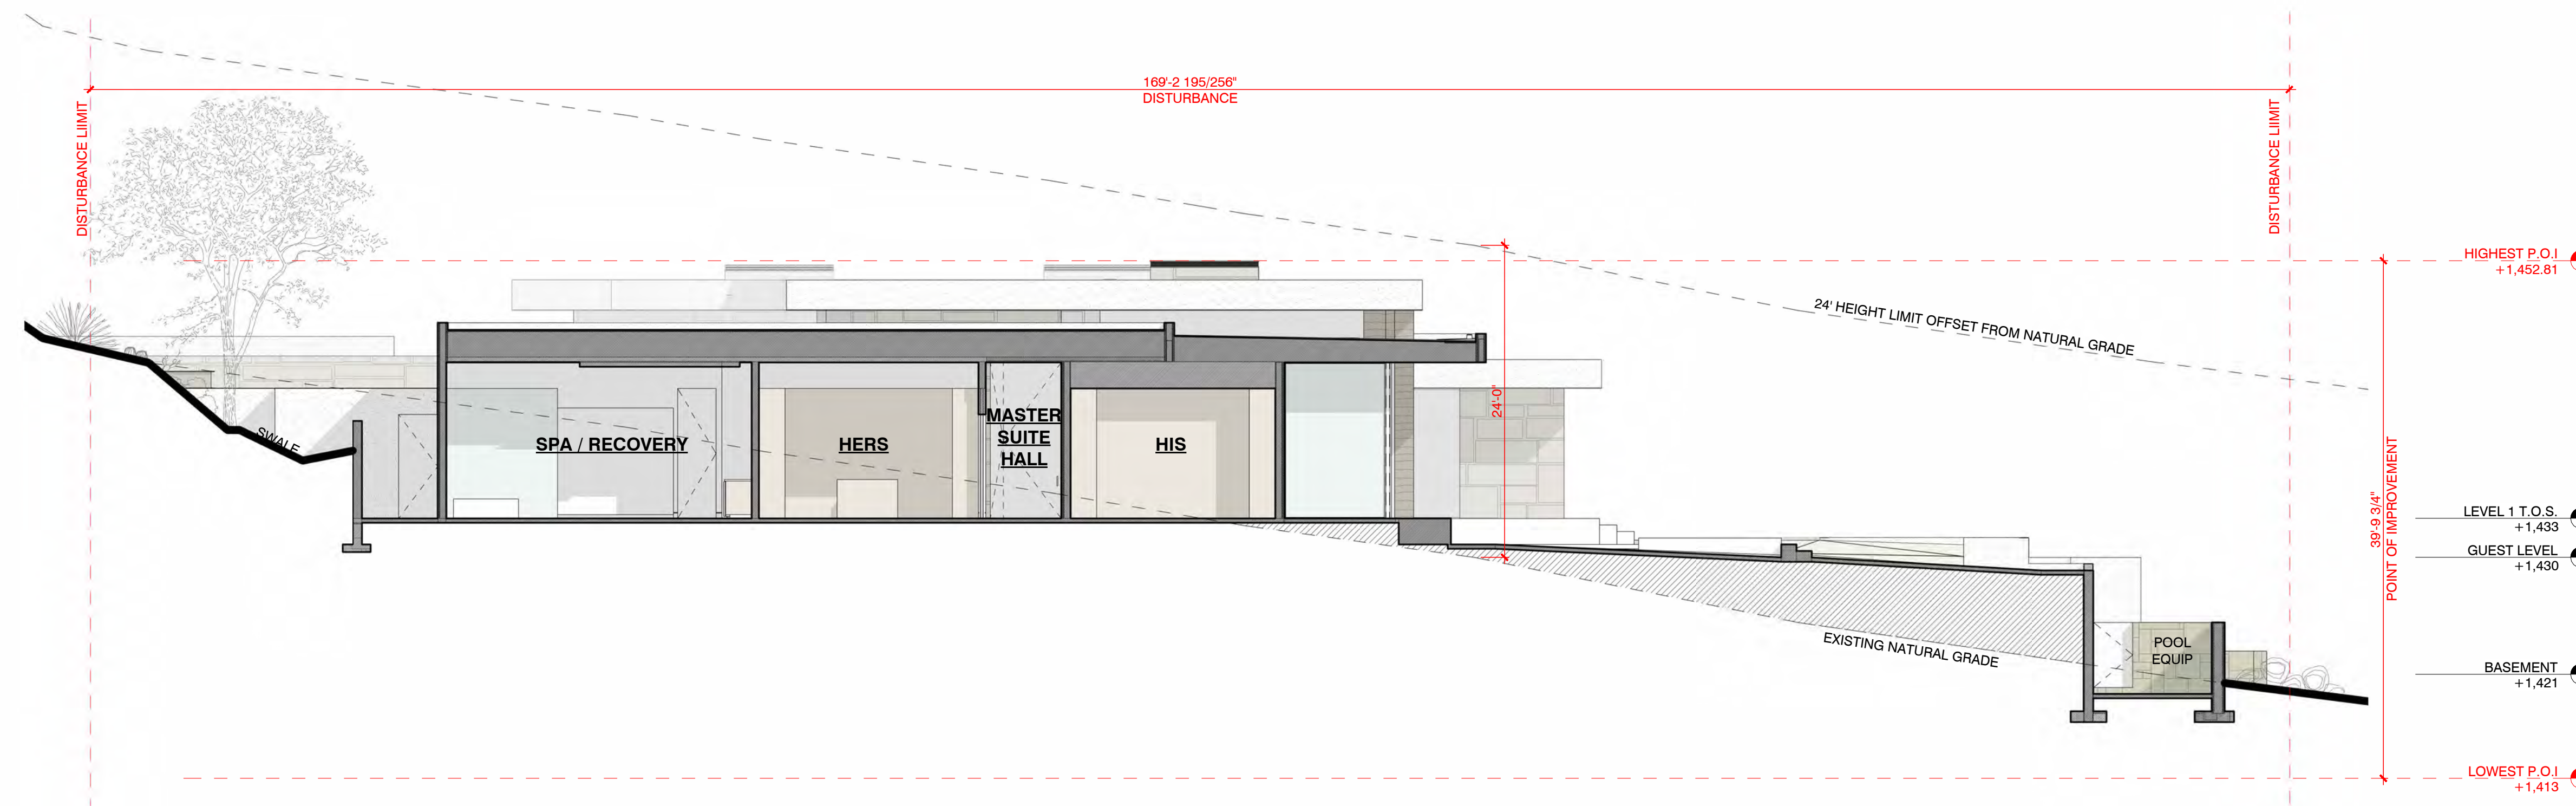
$$1/8'' = 1'-0''$$
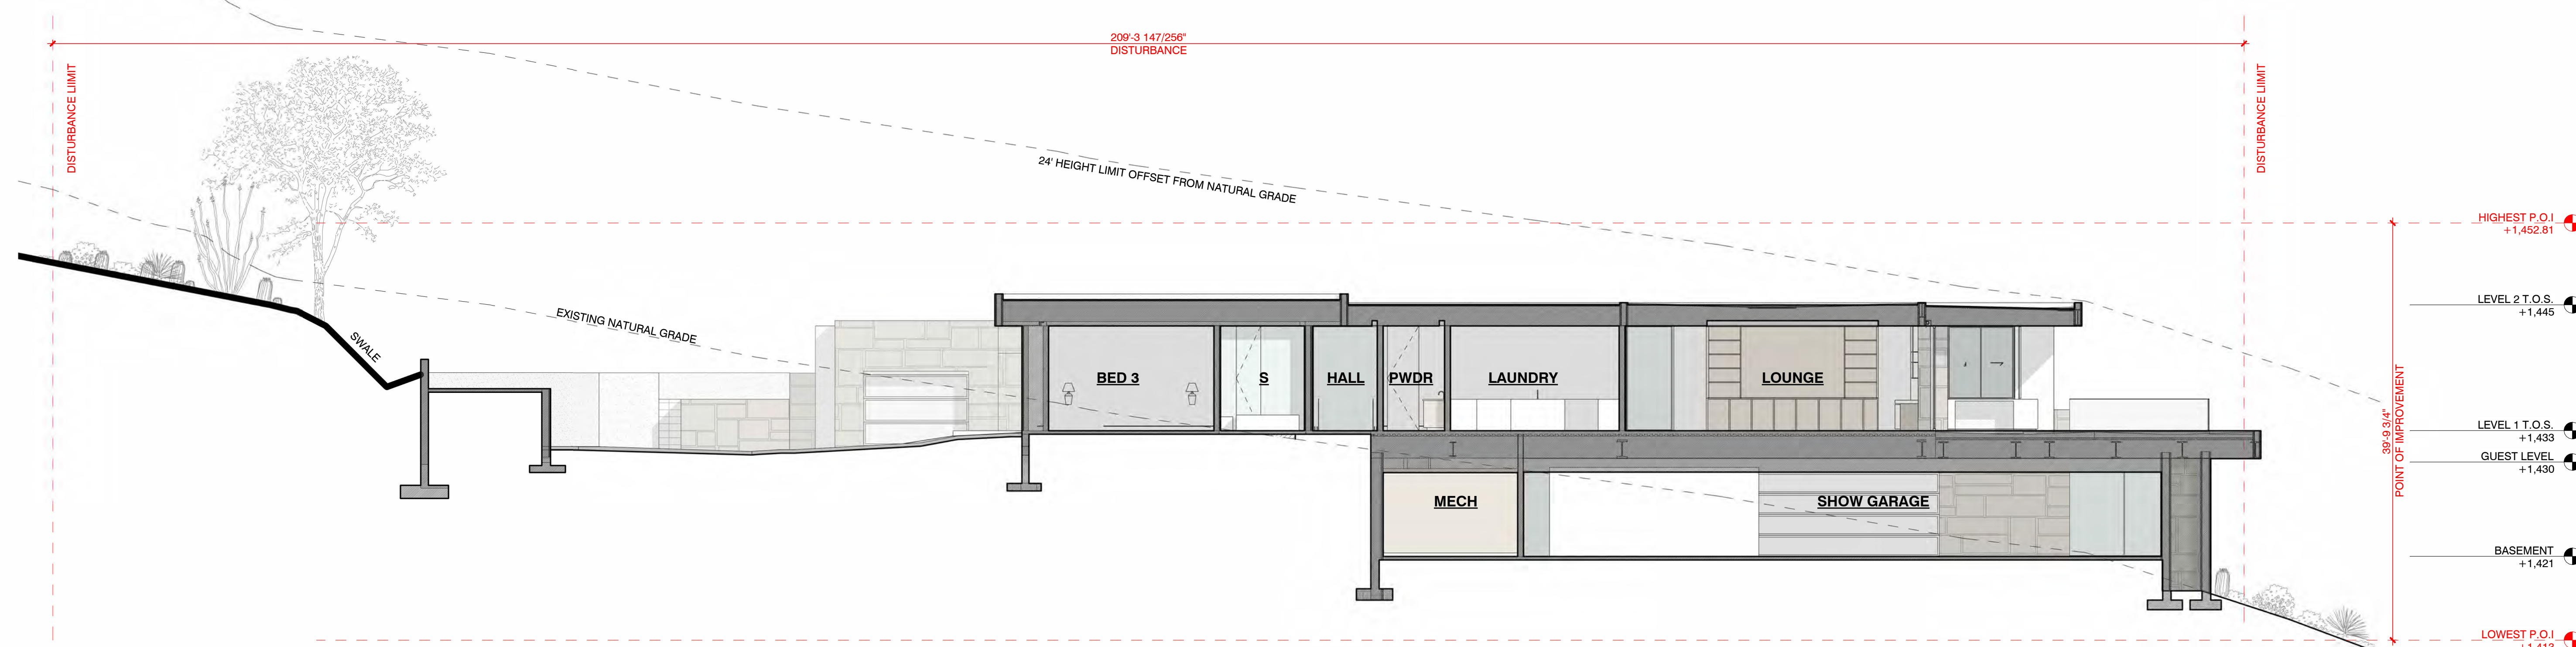
$$1/8'' = 1'-0''$$


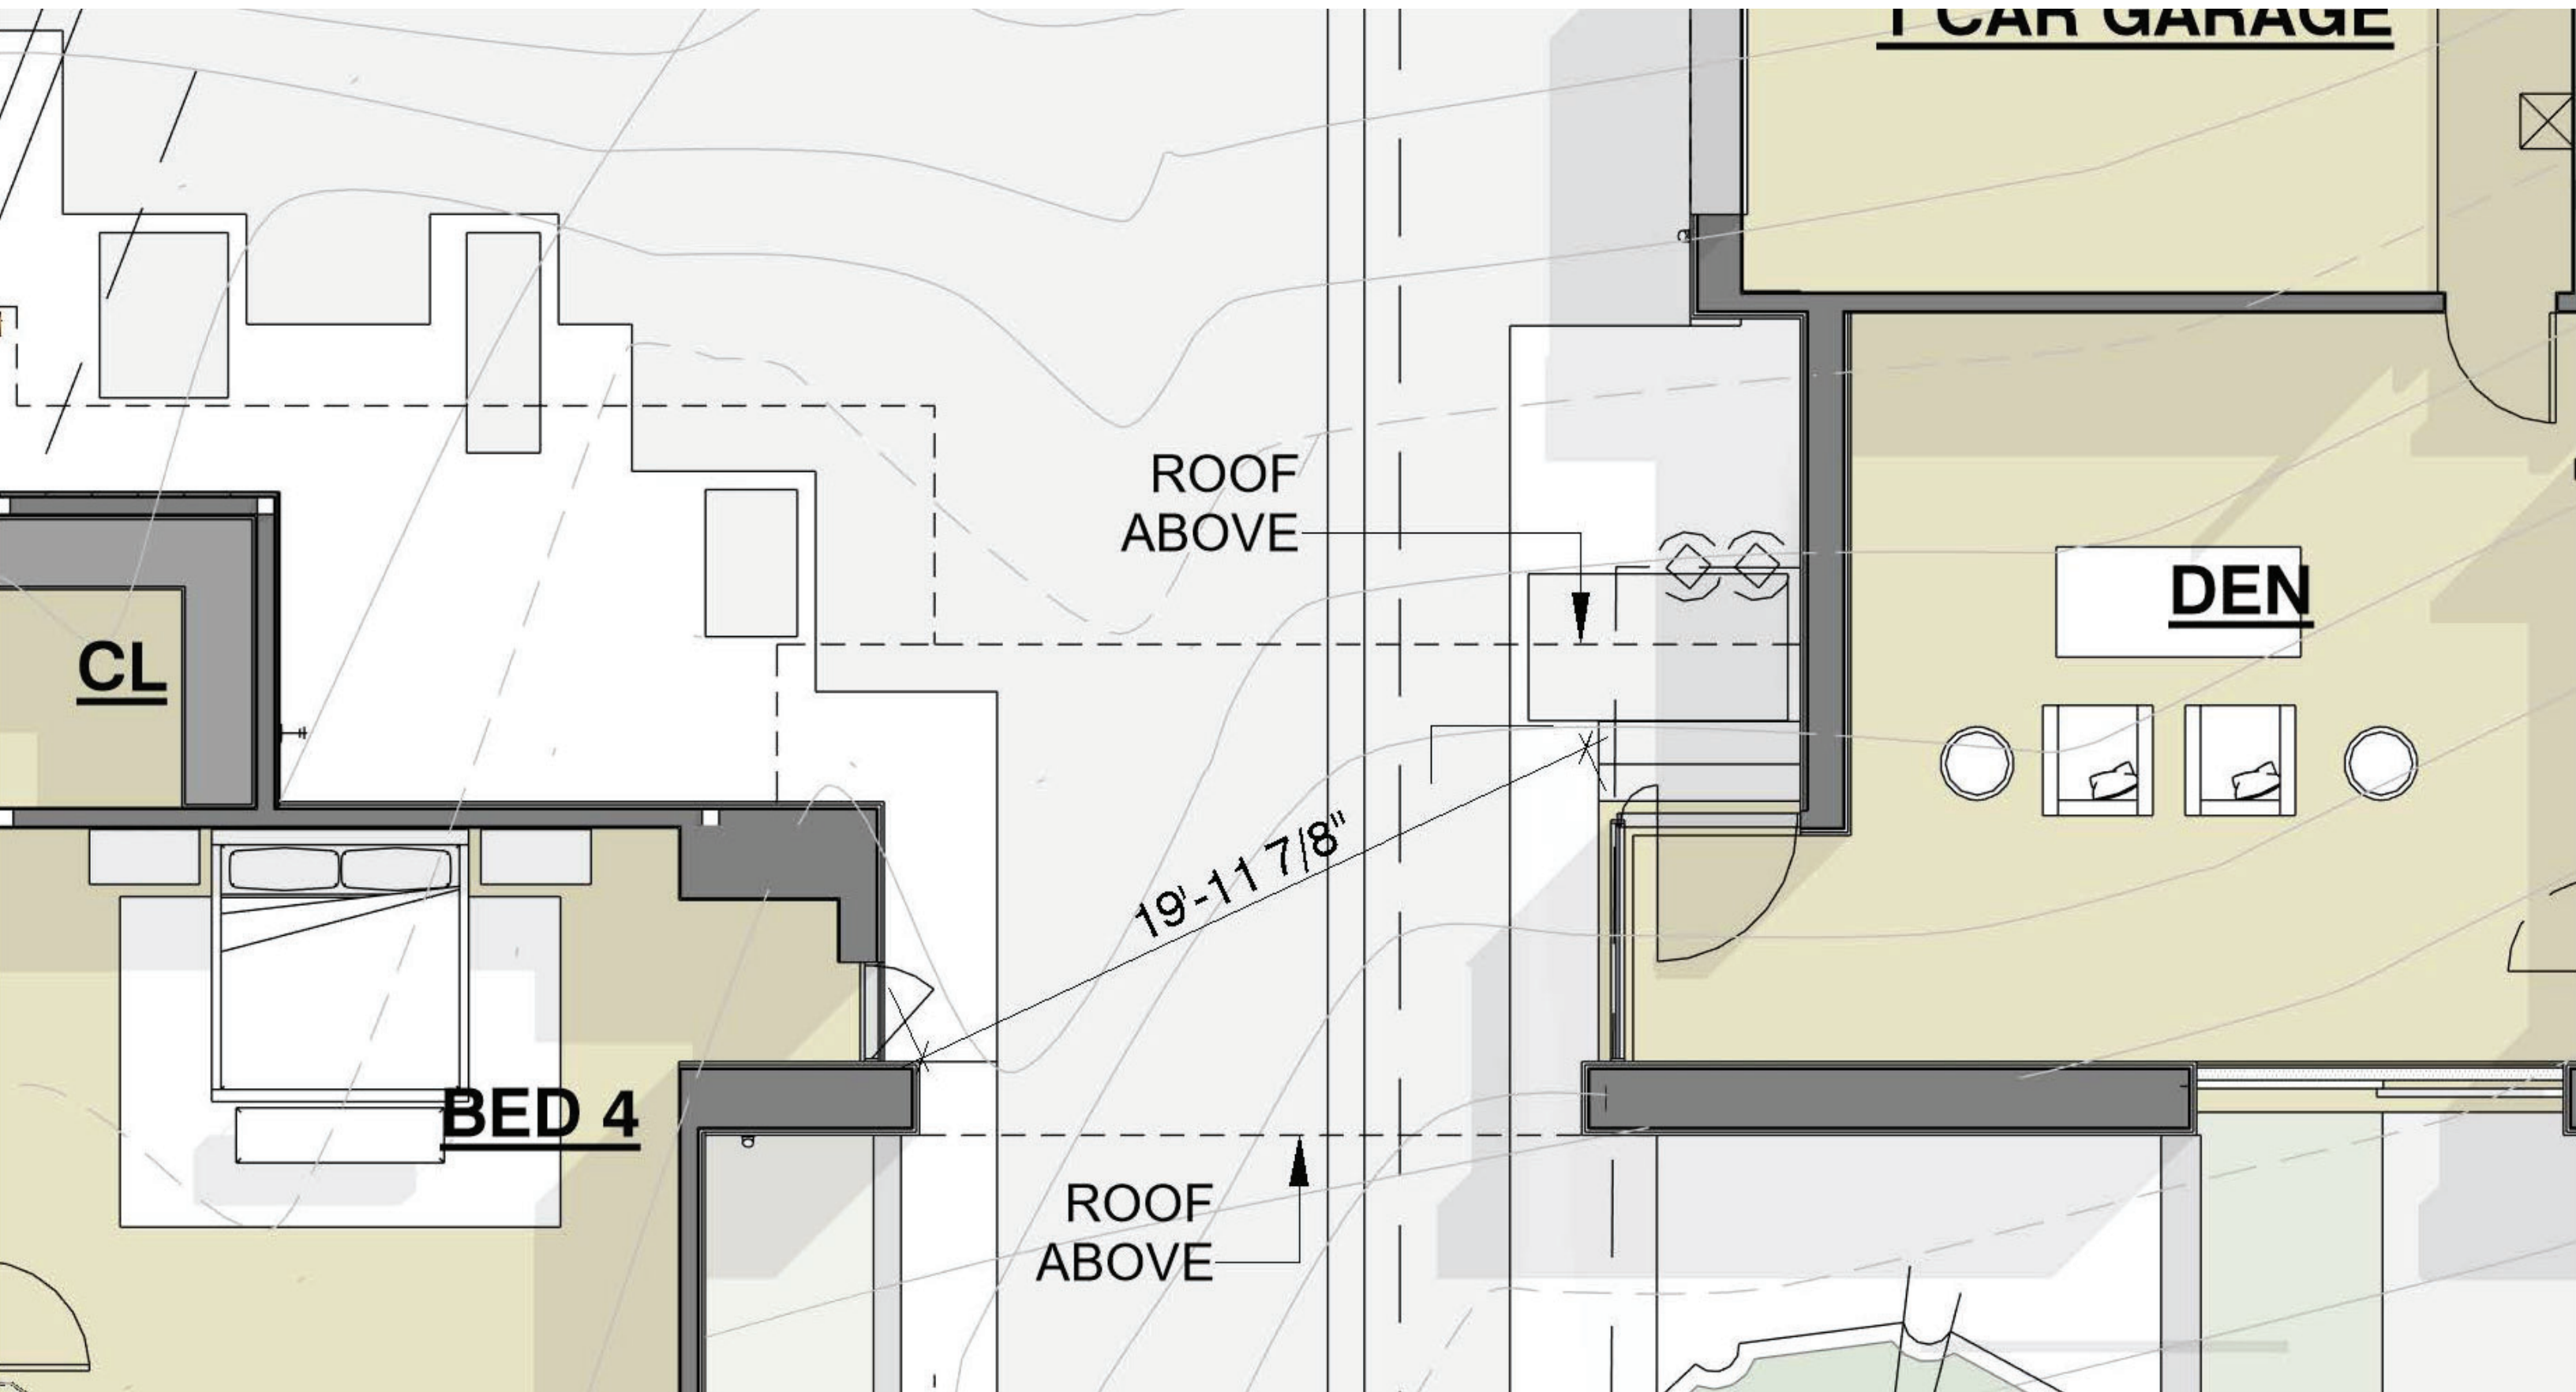
$$1/8'' = 1'-0''$$


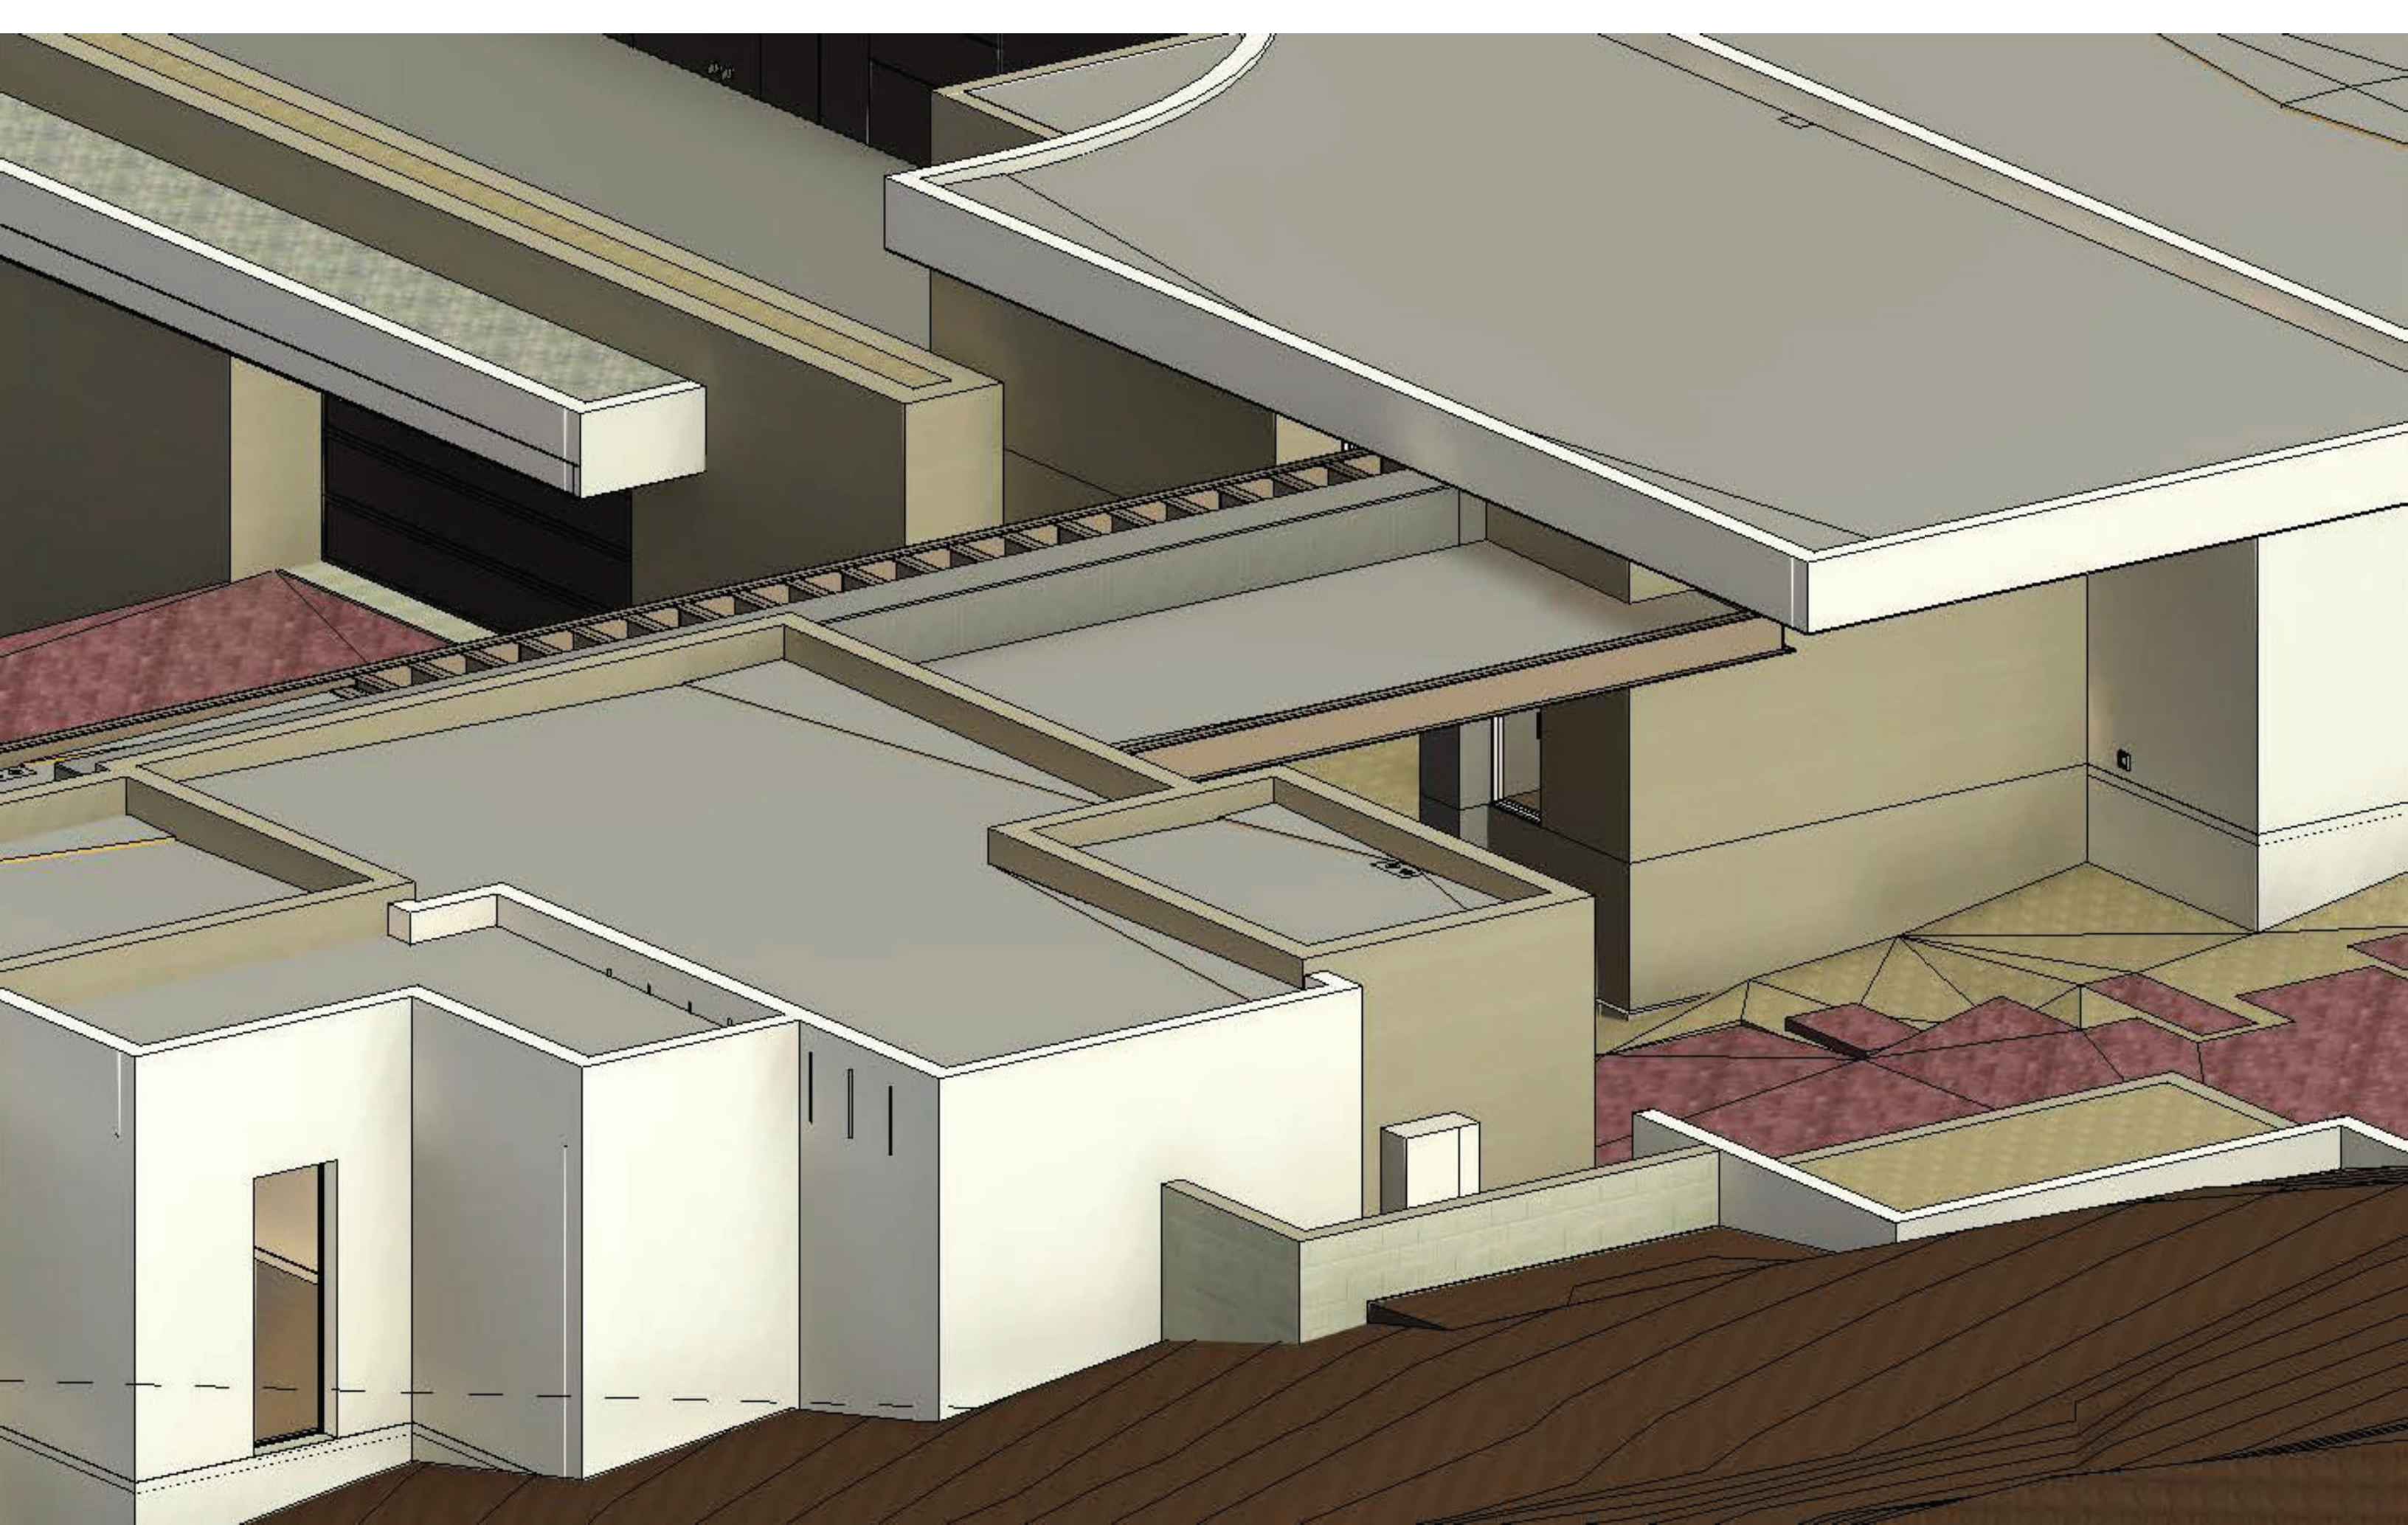
ARCHITECTS


SITE SECTIONS

HS-9

OF SHEETS





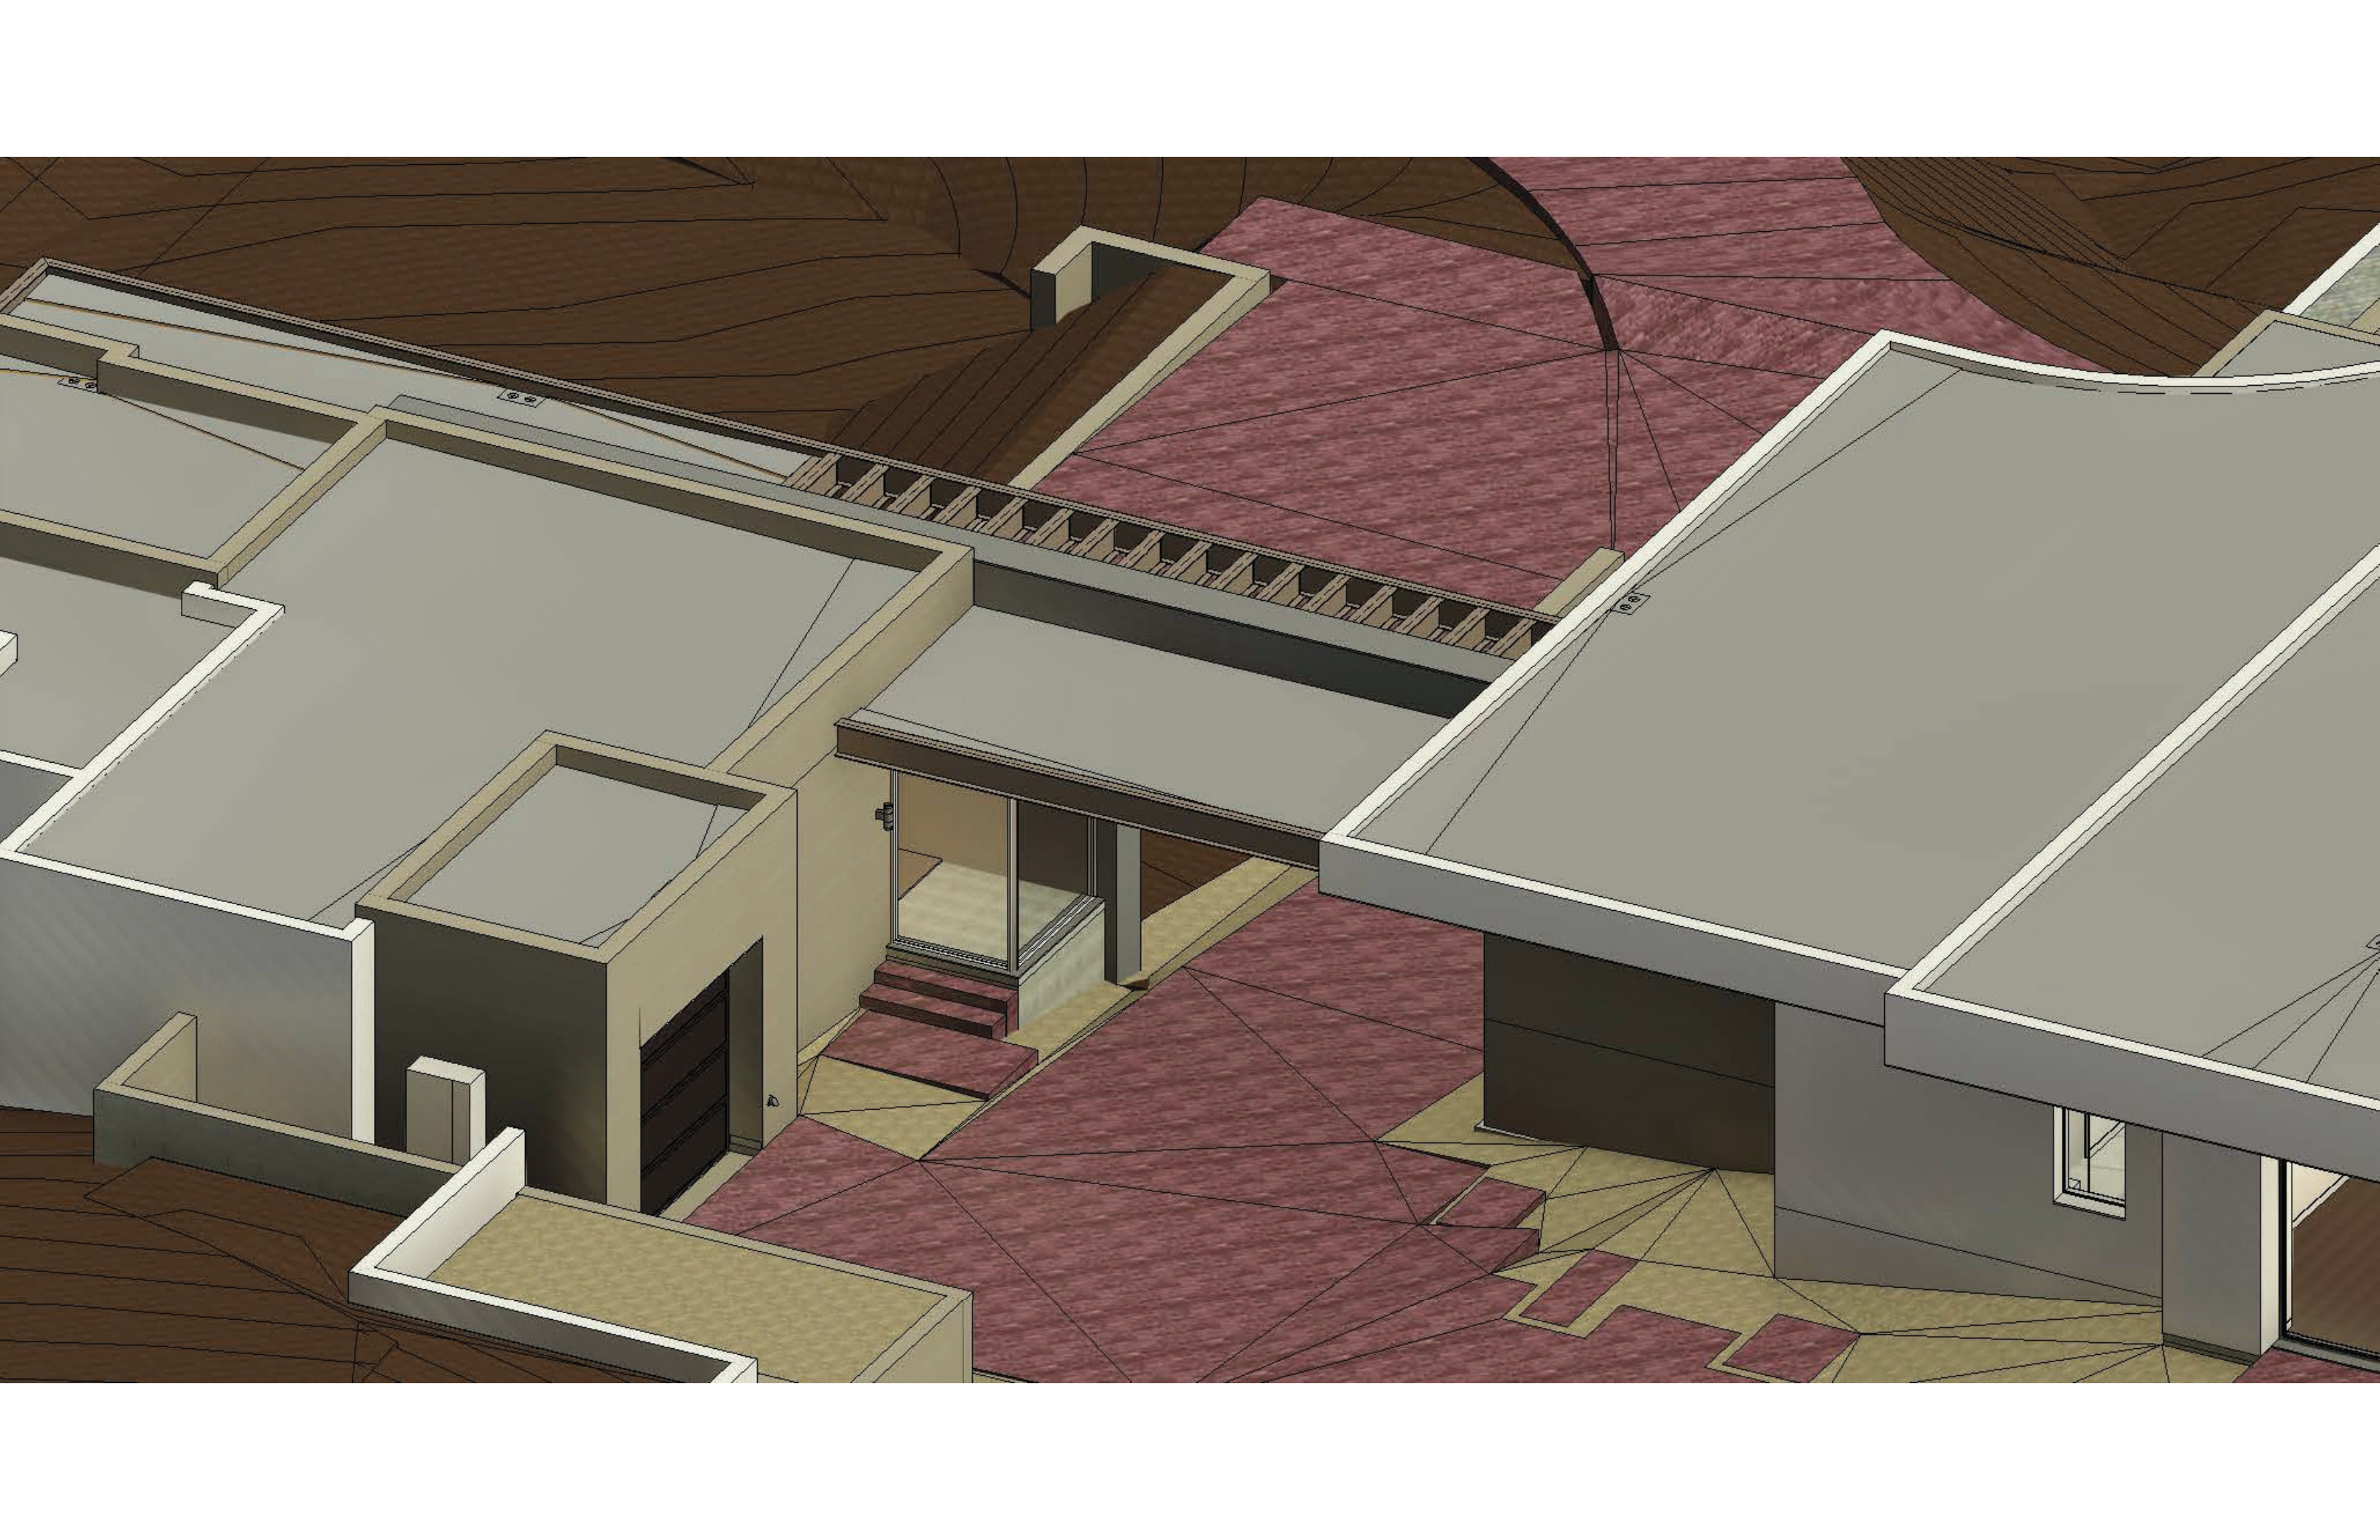



AERIAL VIEW

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

EXTERIOR
RENDERING

HS-10



DRIVEWAY APPROACH

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

EXTERIOR
RENDERING

HS-11



AERIAL VIEW

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

EXTERIOR
RENDERING

HS-12



YARD VIEW

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

EXTERIOR
RENDERING

HS-13



AERIAL VIEW

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

EXTERIOR
RENDERING

HS-14



FRONT APPROACH

**ROAD RUNNER
RESIDENCE**

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

EXTERIOR
RENDERING

HS-15



AERIAL VIEW

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



This Drawing is an instrument of service and is the sole property of STRATTON ARCHITECTS, LLC. This drawing may not be reproduced or reproduction hereof used without the written permission of STRATTON ARCHITECTS, LLC.

FOR FINAL HILLSIDE

DATE 4.21.2026

REV.

EXTERIOR
RENDERING

HS-16

POV 'S



1



2



3



4



5



6



7



8

AERIALS



9



10



ARCHITECTURAL SITE PLAN

1" = 60'-0"

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FOR FINAL HILLSIDE


DATE 4.21.2026

REV.


SITE PHOTOS

HS-17

OF SHEETS




HOUSE STUCCO
SW7507 STONE LION
LRV 38

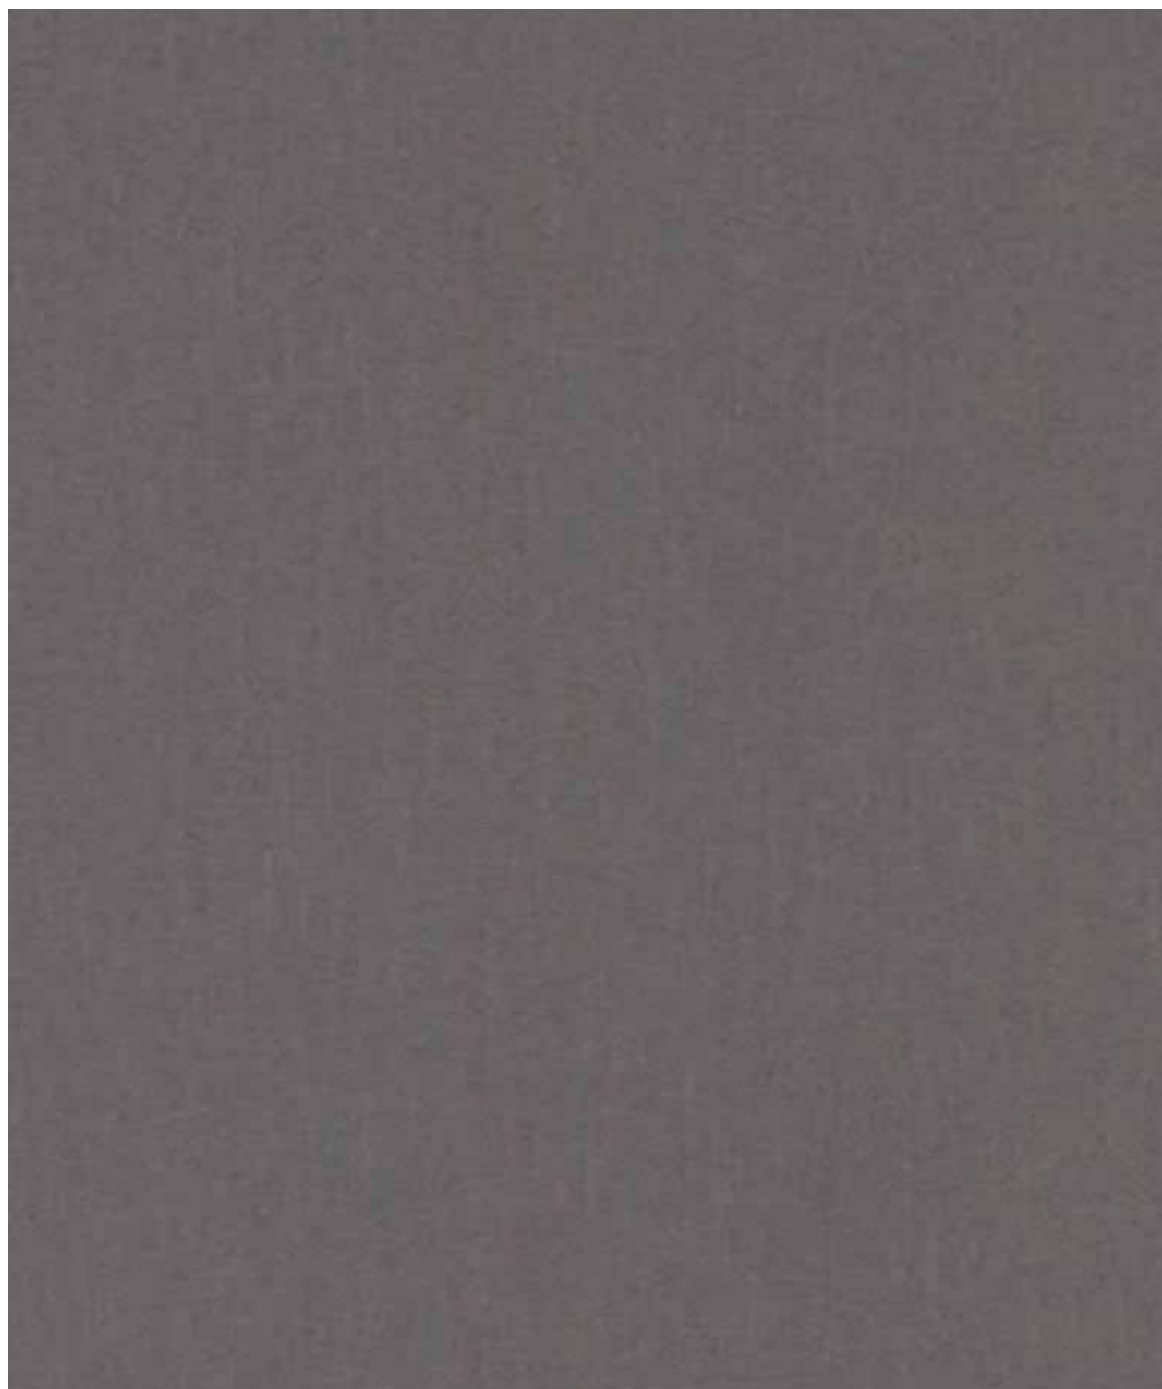

METAL FASCIA, FINISH
OCM BRONZE ORE MATTE
ESR #2048



CARDINAL GLASS
CLEAR GLASS
LOW-E COATING ON
SURFACE
DOOR & WINDOW FRAME
POWDER COAT CUSTOM COLOR

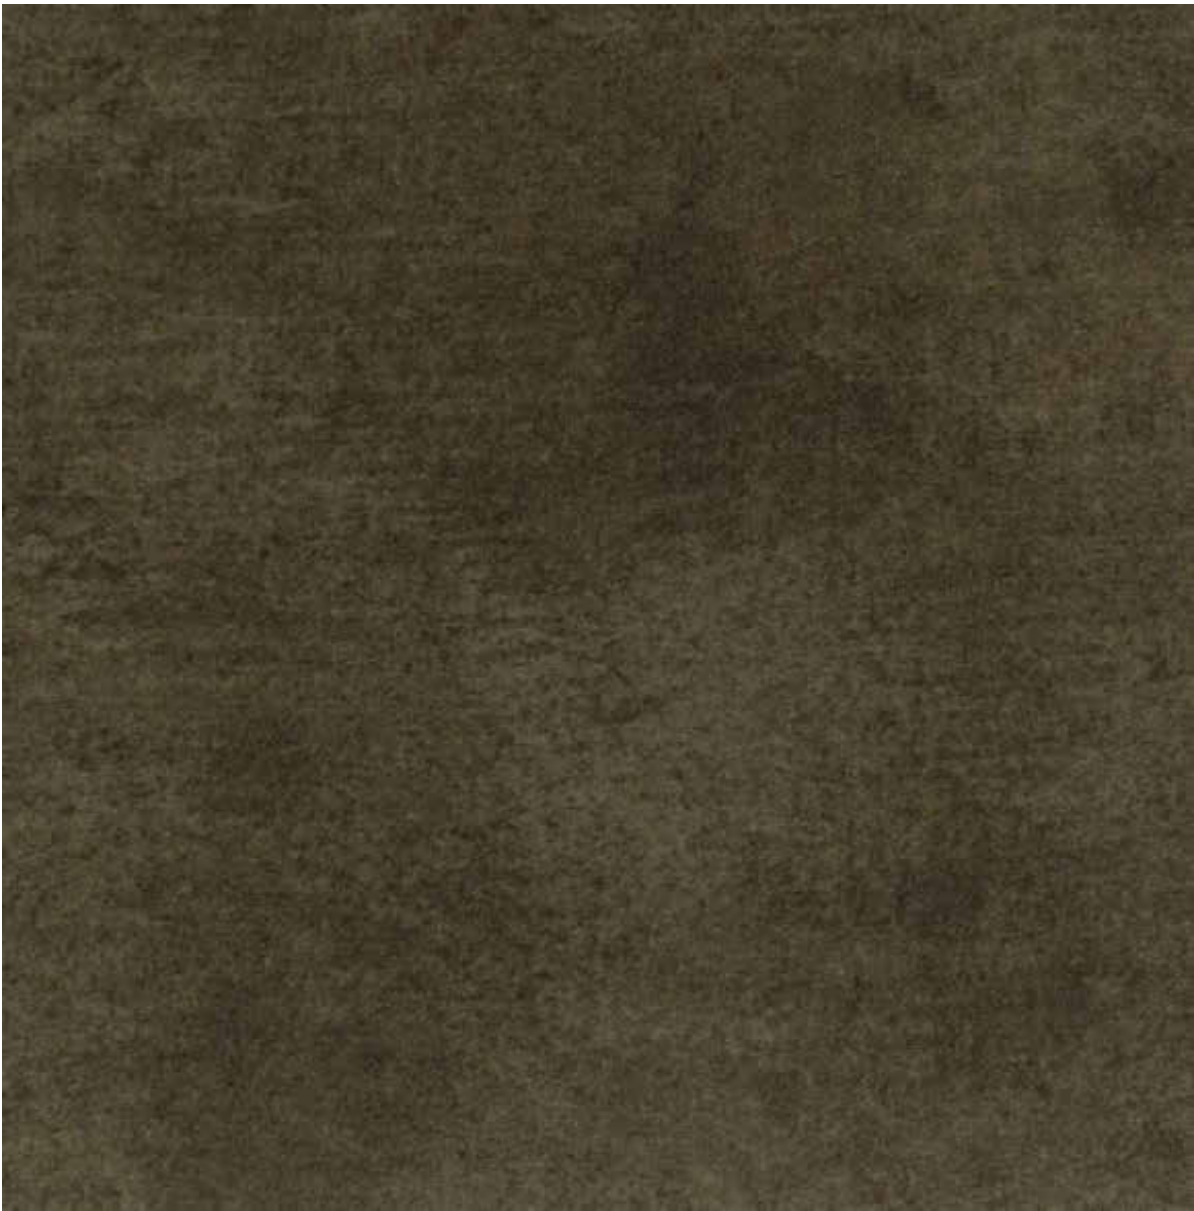


ACCENT STEEL
PURE+FREEFORM
DECO BRONZE 2 (STOCKED FINISH) #FA098



STUCCO CEILING
SW7507 STONE LION
LRV 38




MAIN HOUSE STONE
COLMAR - ECO OUTDOOR
LRV 36.7

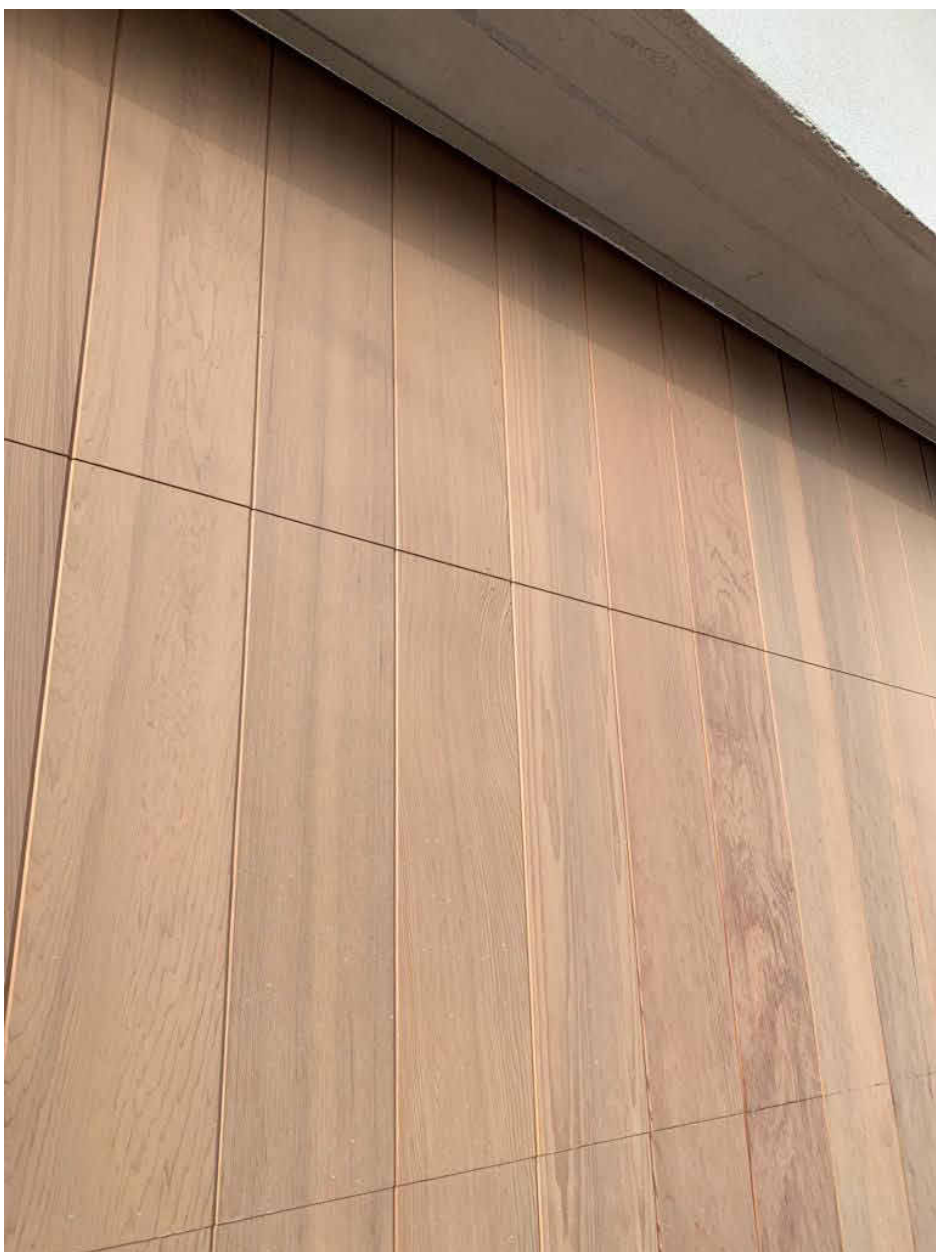

CUSTOM GARAGE DOORS
SOUTHWEST GARAGE DOORS




HOUSE ACCENT STONE
PACIFIC BLACK FLAMED
SOLSTICE STONE
9.5 LRV

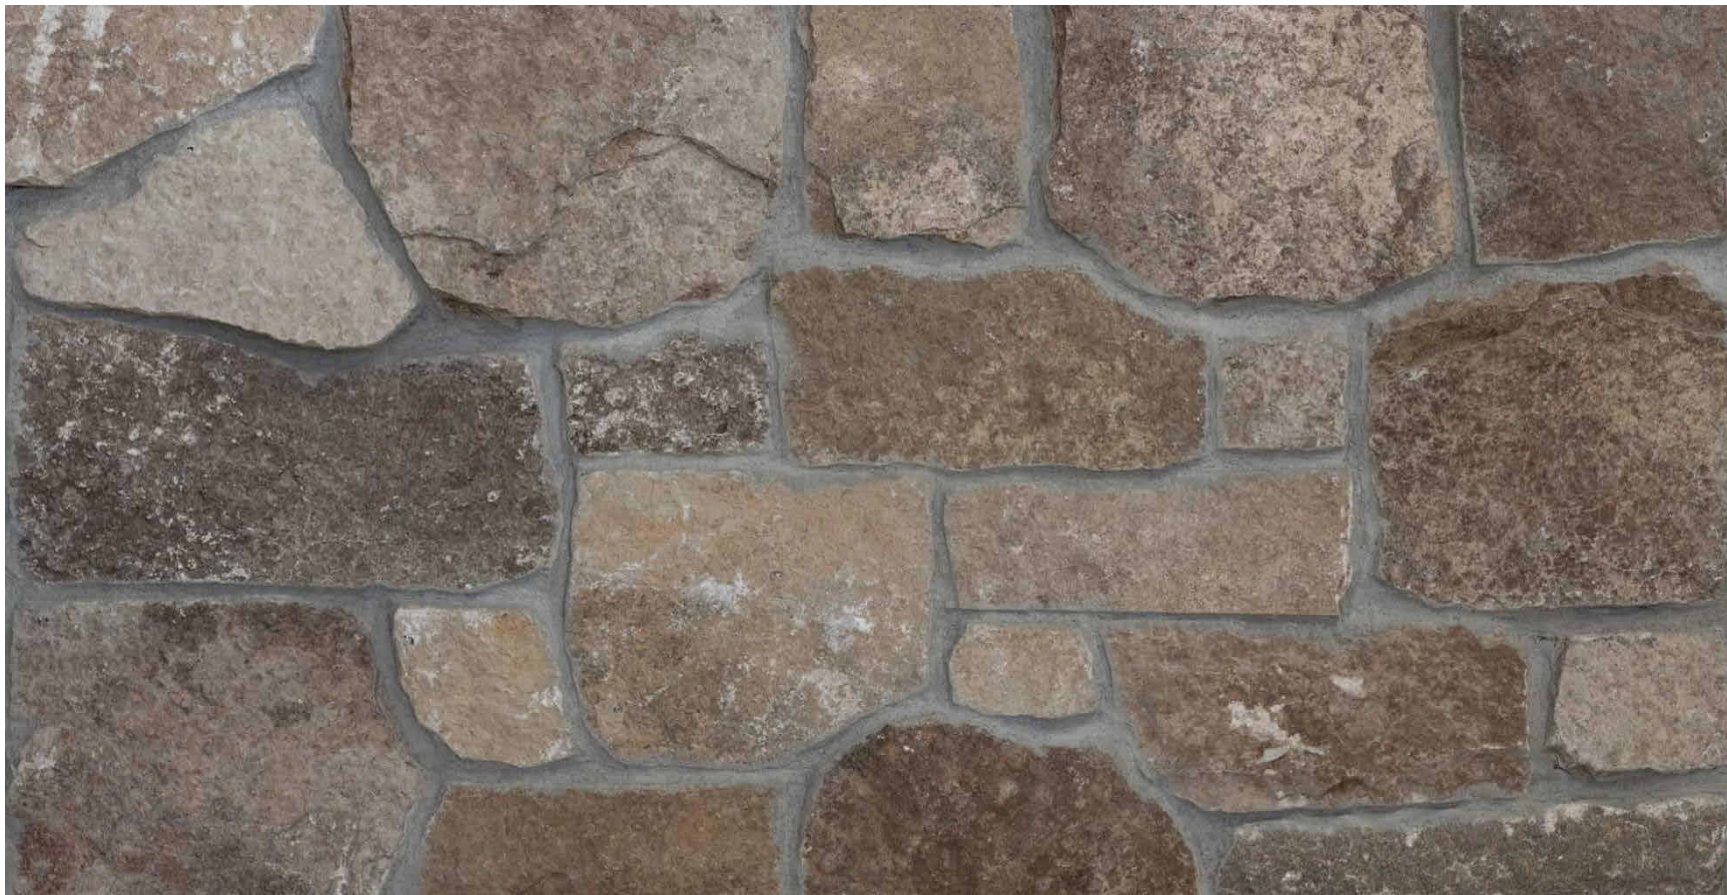

BERKSHIRE RUBBLE
SOLSTICE STONE
22.47 LRV




DRIVEWAY - COLORED CONCRETE,
LIGHT SAND FINIHS. 3/8" MIX, COLOR
TBD, SAW CUT JOINTS. 1/4" RADIUS
EDGE

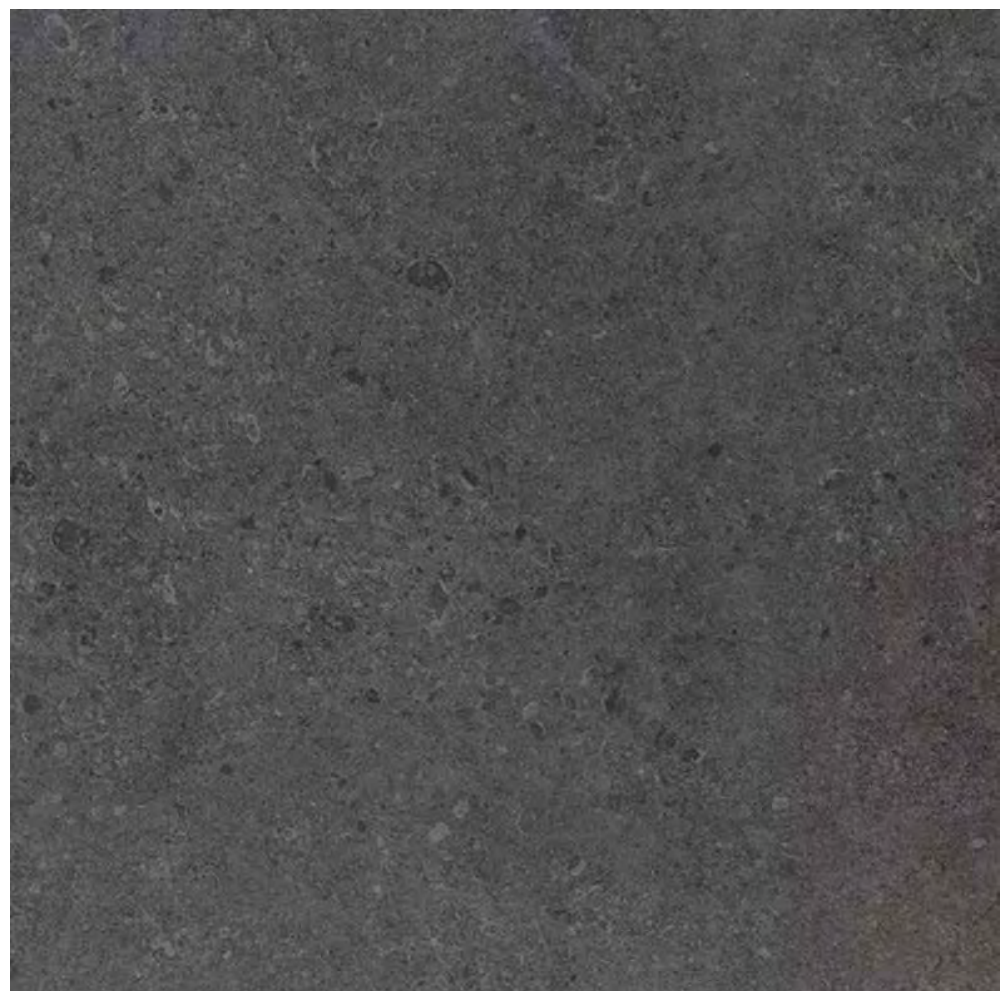

WATERLINE TILE - GOVERNOR
BLACK 12x24 MATTE FINISH



PATIO PAVERS - 3D SILVER
TRAVERTINE HONED &
FILLED - SOLSTICE STONE
LRV 37.29

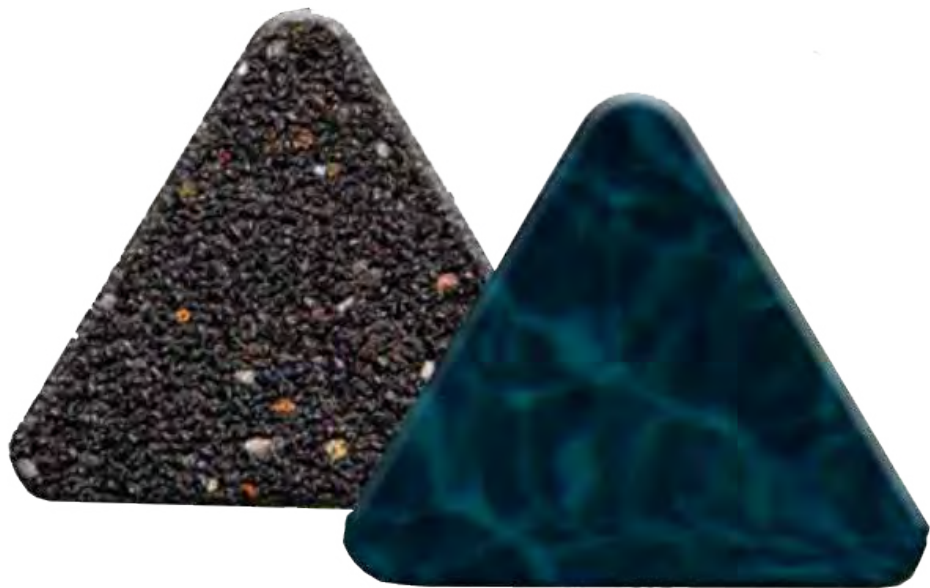

POOL INTERIOR - PEBBLESHEEN -
BLACK ECLIPSE



SYNTHETIC TURF - ARTIFICIAL LAWNS
CO - CORONADO

ROAD RUNNER
RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No.25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701




FDR FINAL HILLSIDE

DATE 4.21.2026

REV.

MATERIALS BOARD

HS-18

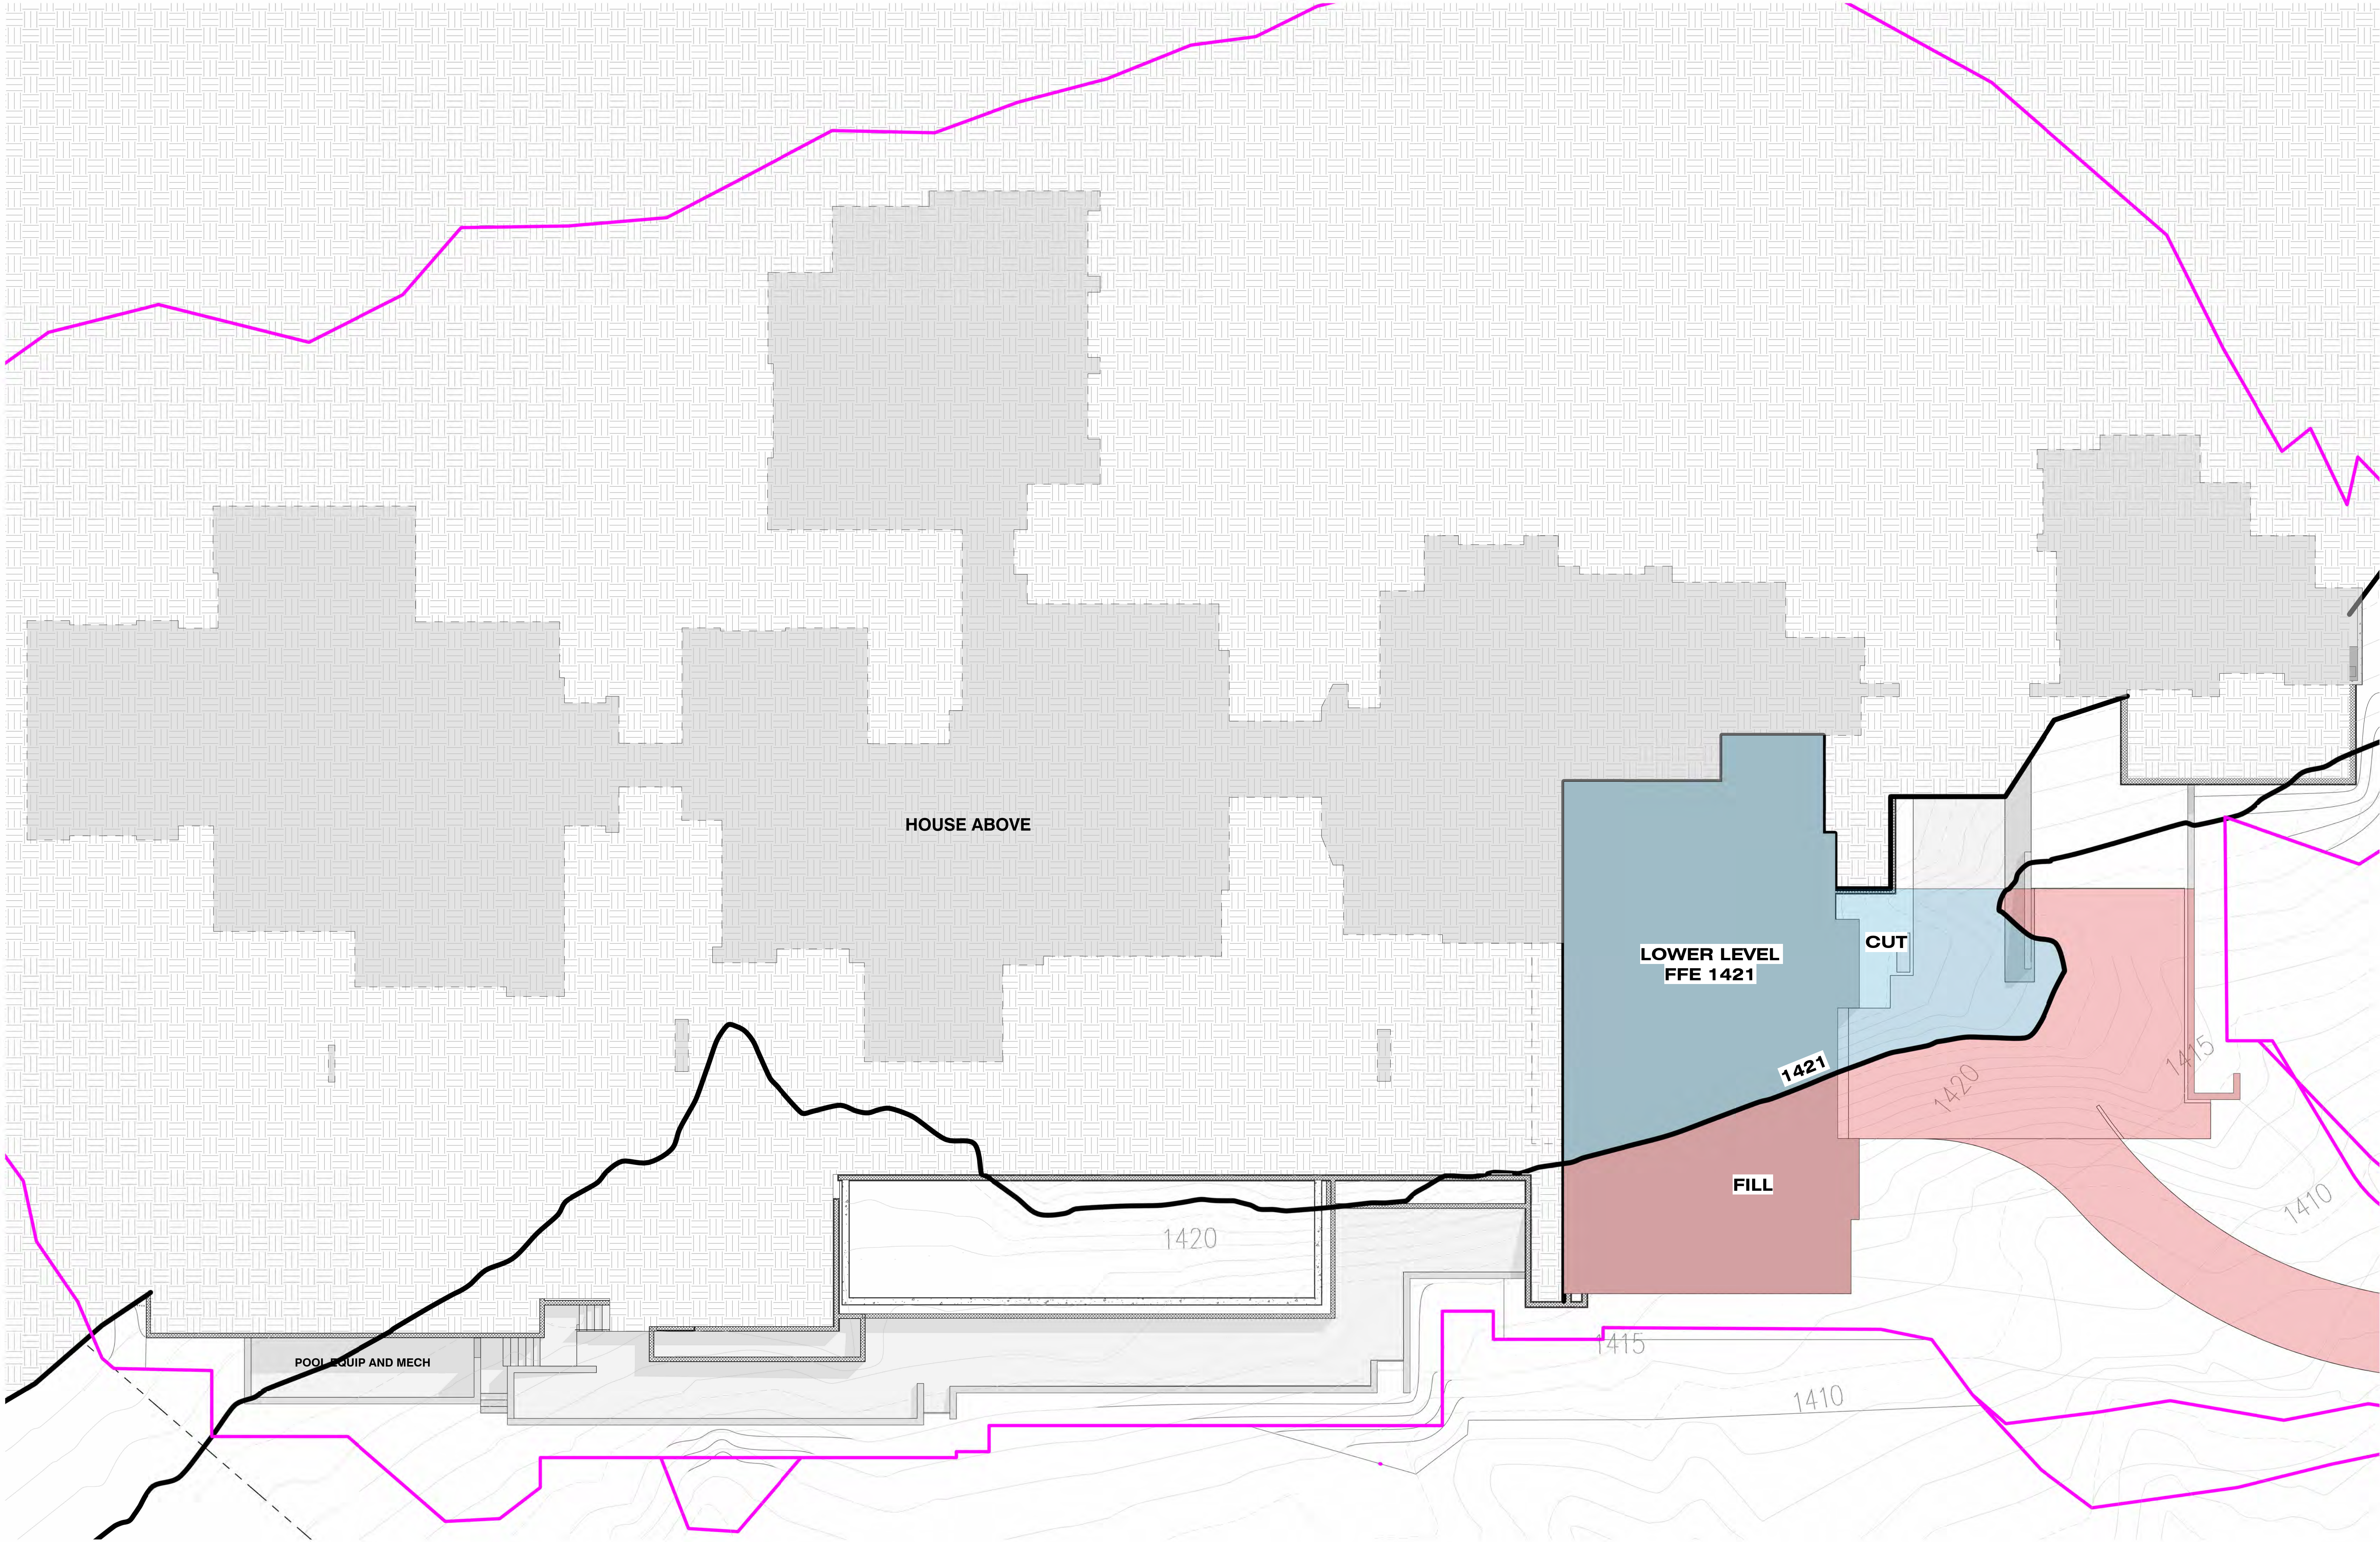

CUT:
FILL:
TOTAL CUT & FILL

=3,644 C.Y.
=6,122 C.Y.
=9,766 C.Y.

ROAD RUNNER RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No. 25-16

STRATTON
ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FOR FINAL HILLSIDE


DATE 4.21.2026

REV.

LOWER LEVEL
CUT/FILL

HS-19

OF SHEETS

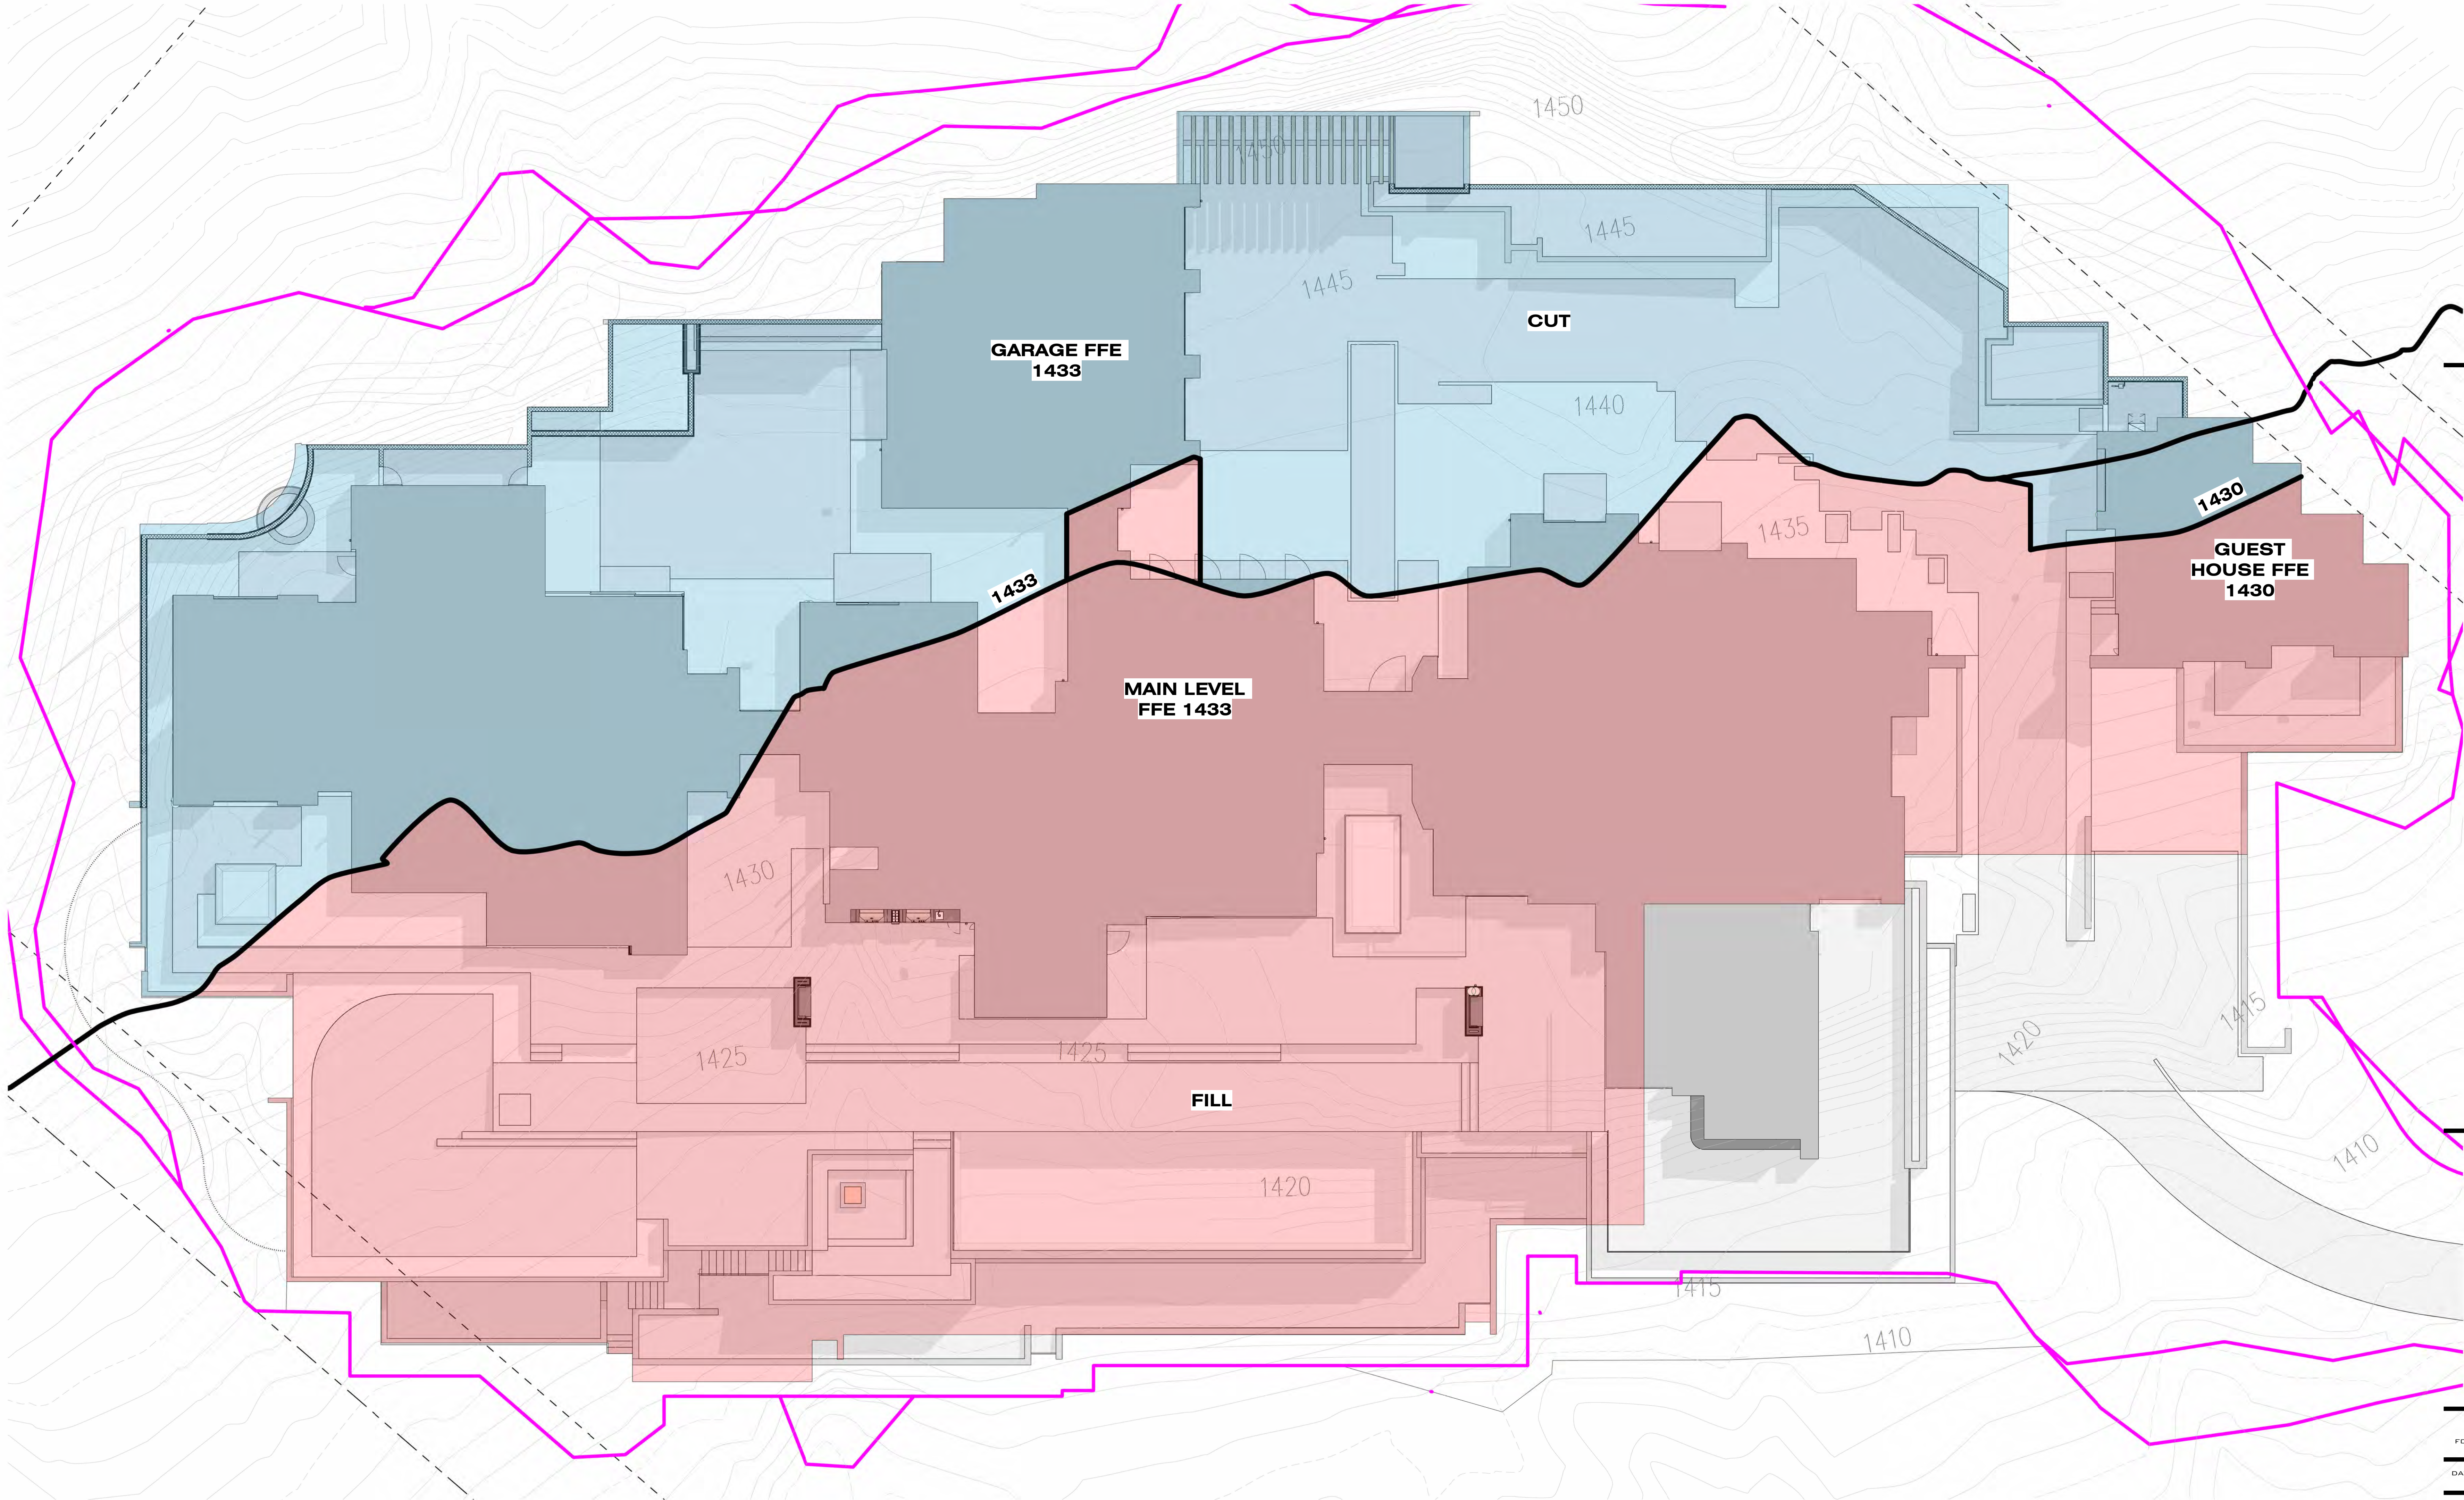

CUT: -3,644 C.Y.
FILL: -6,122 C.Y.
TOTAL CUT & FILL: -9,766 C.Y.

ROAD RUNNER RESIDENCE

5611 E Road Runner Lane
Paradise Valley AZ 85253
Project No.25-16

STRATTON ARCHITECTS

7026 N Longlook Way, Paradise Valley, Arizona 85253
(800) 331-0701



FDR FINAL HILLSIDE


DATE 4.21.2026

REV.


MAIN LEVEL CUT/FILL

HS-20

OF SHEETS

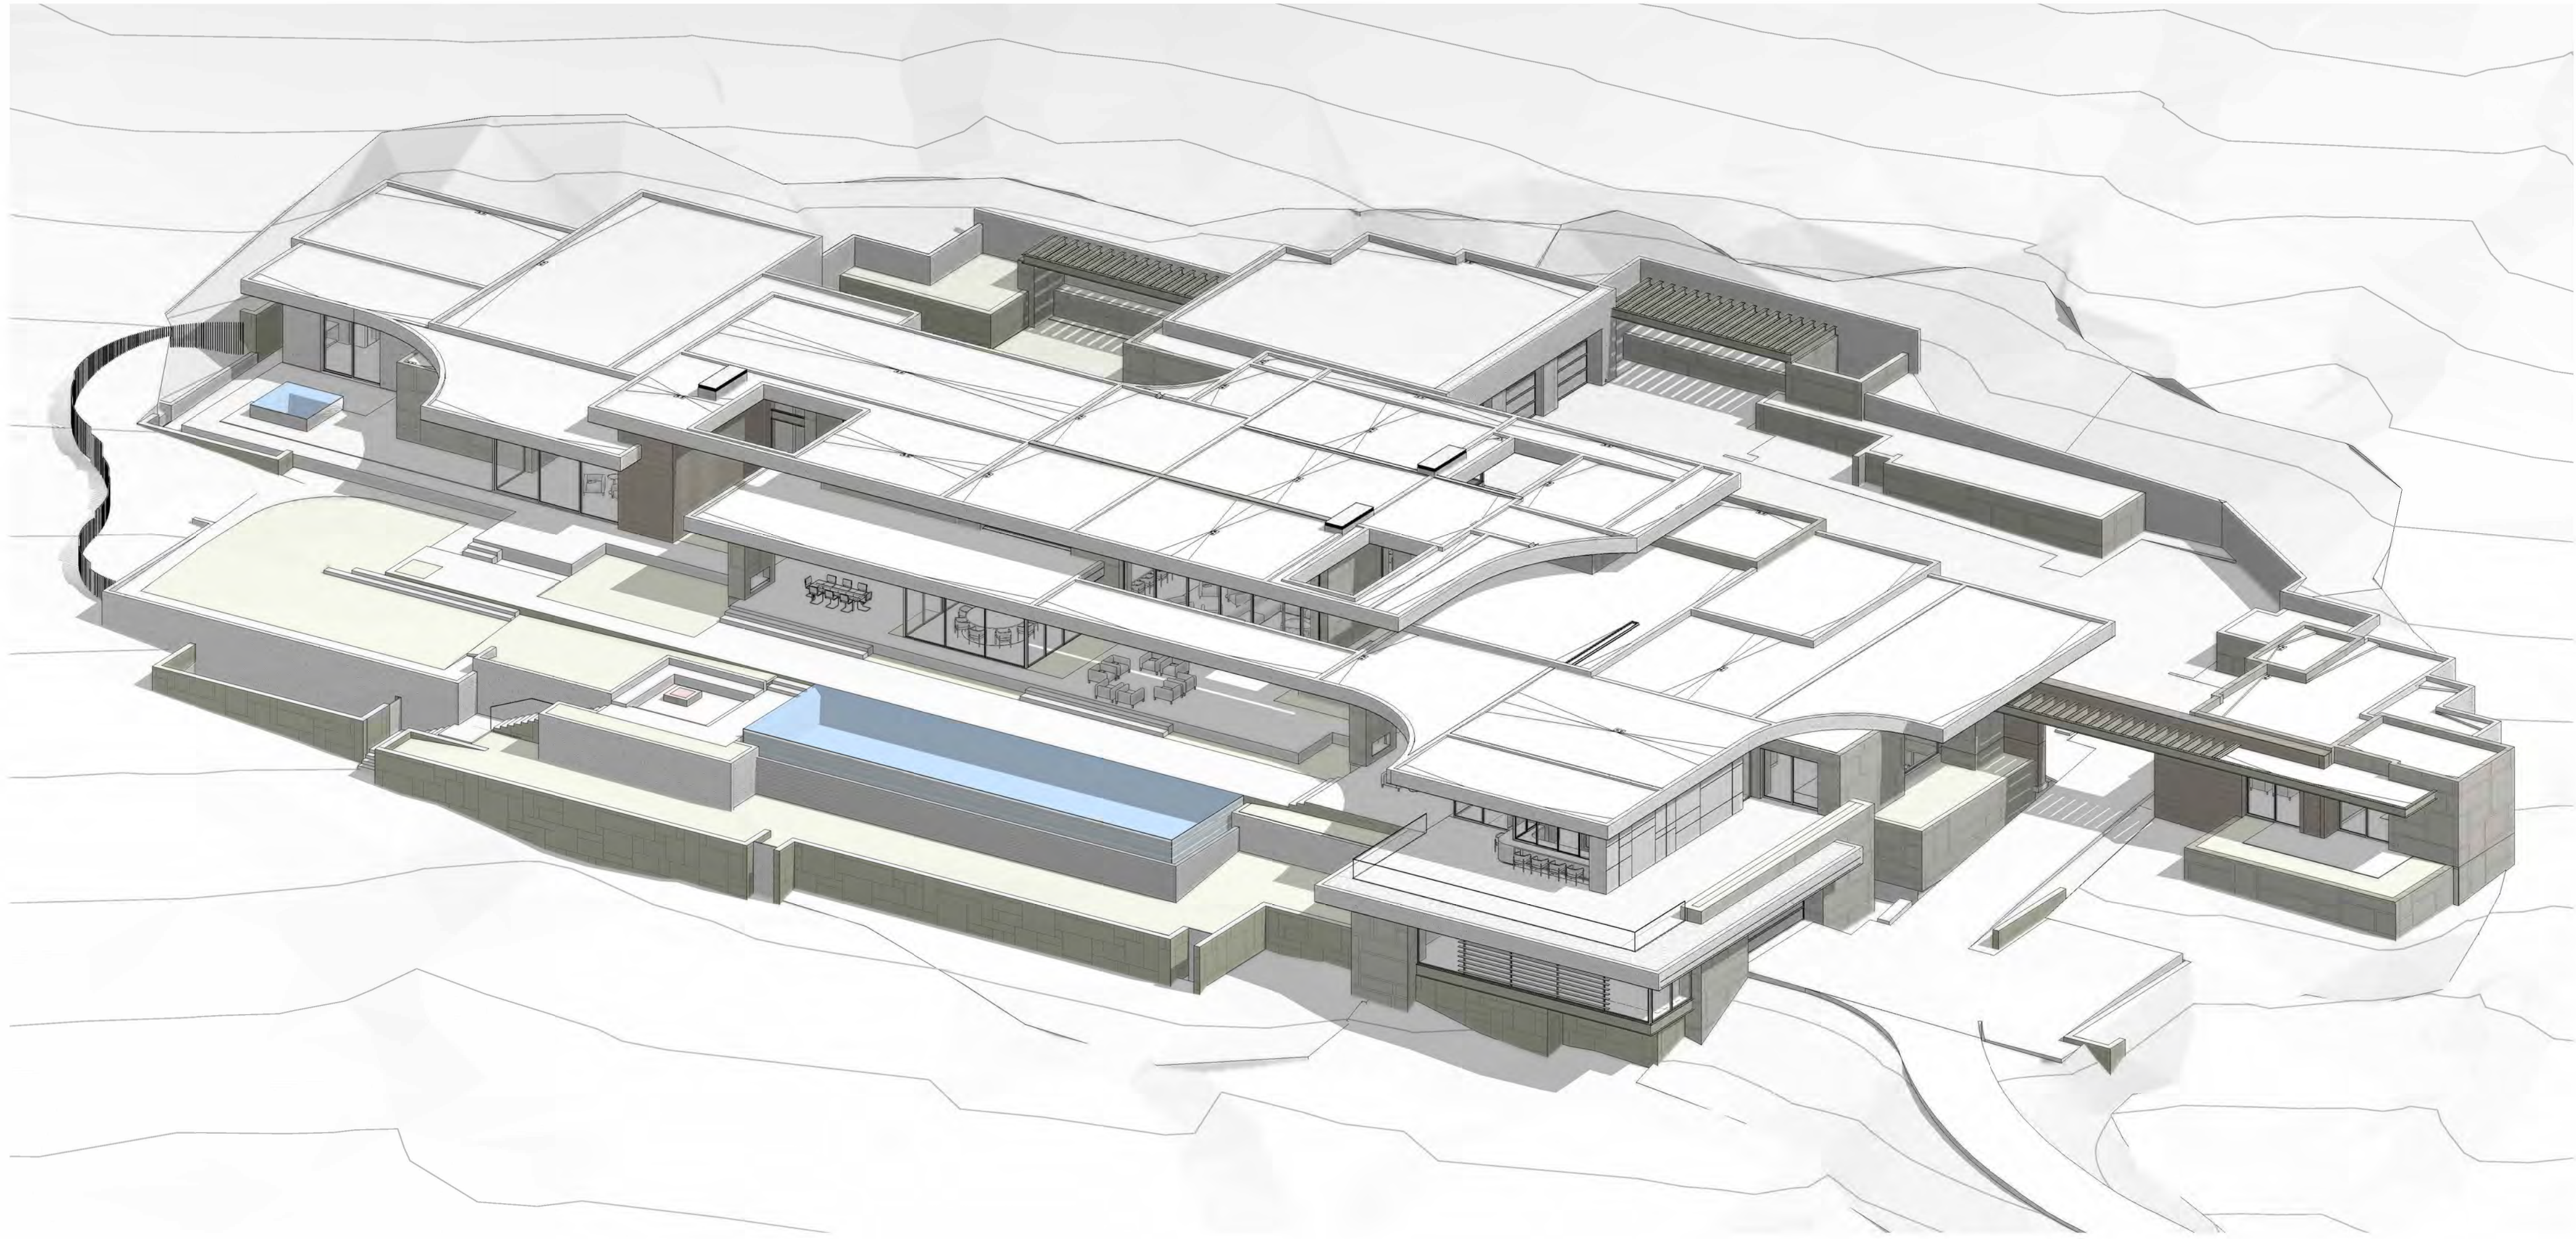

TOPO 3D NO OFFSET

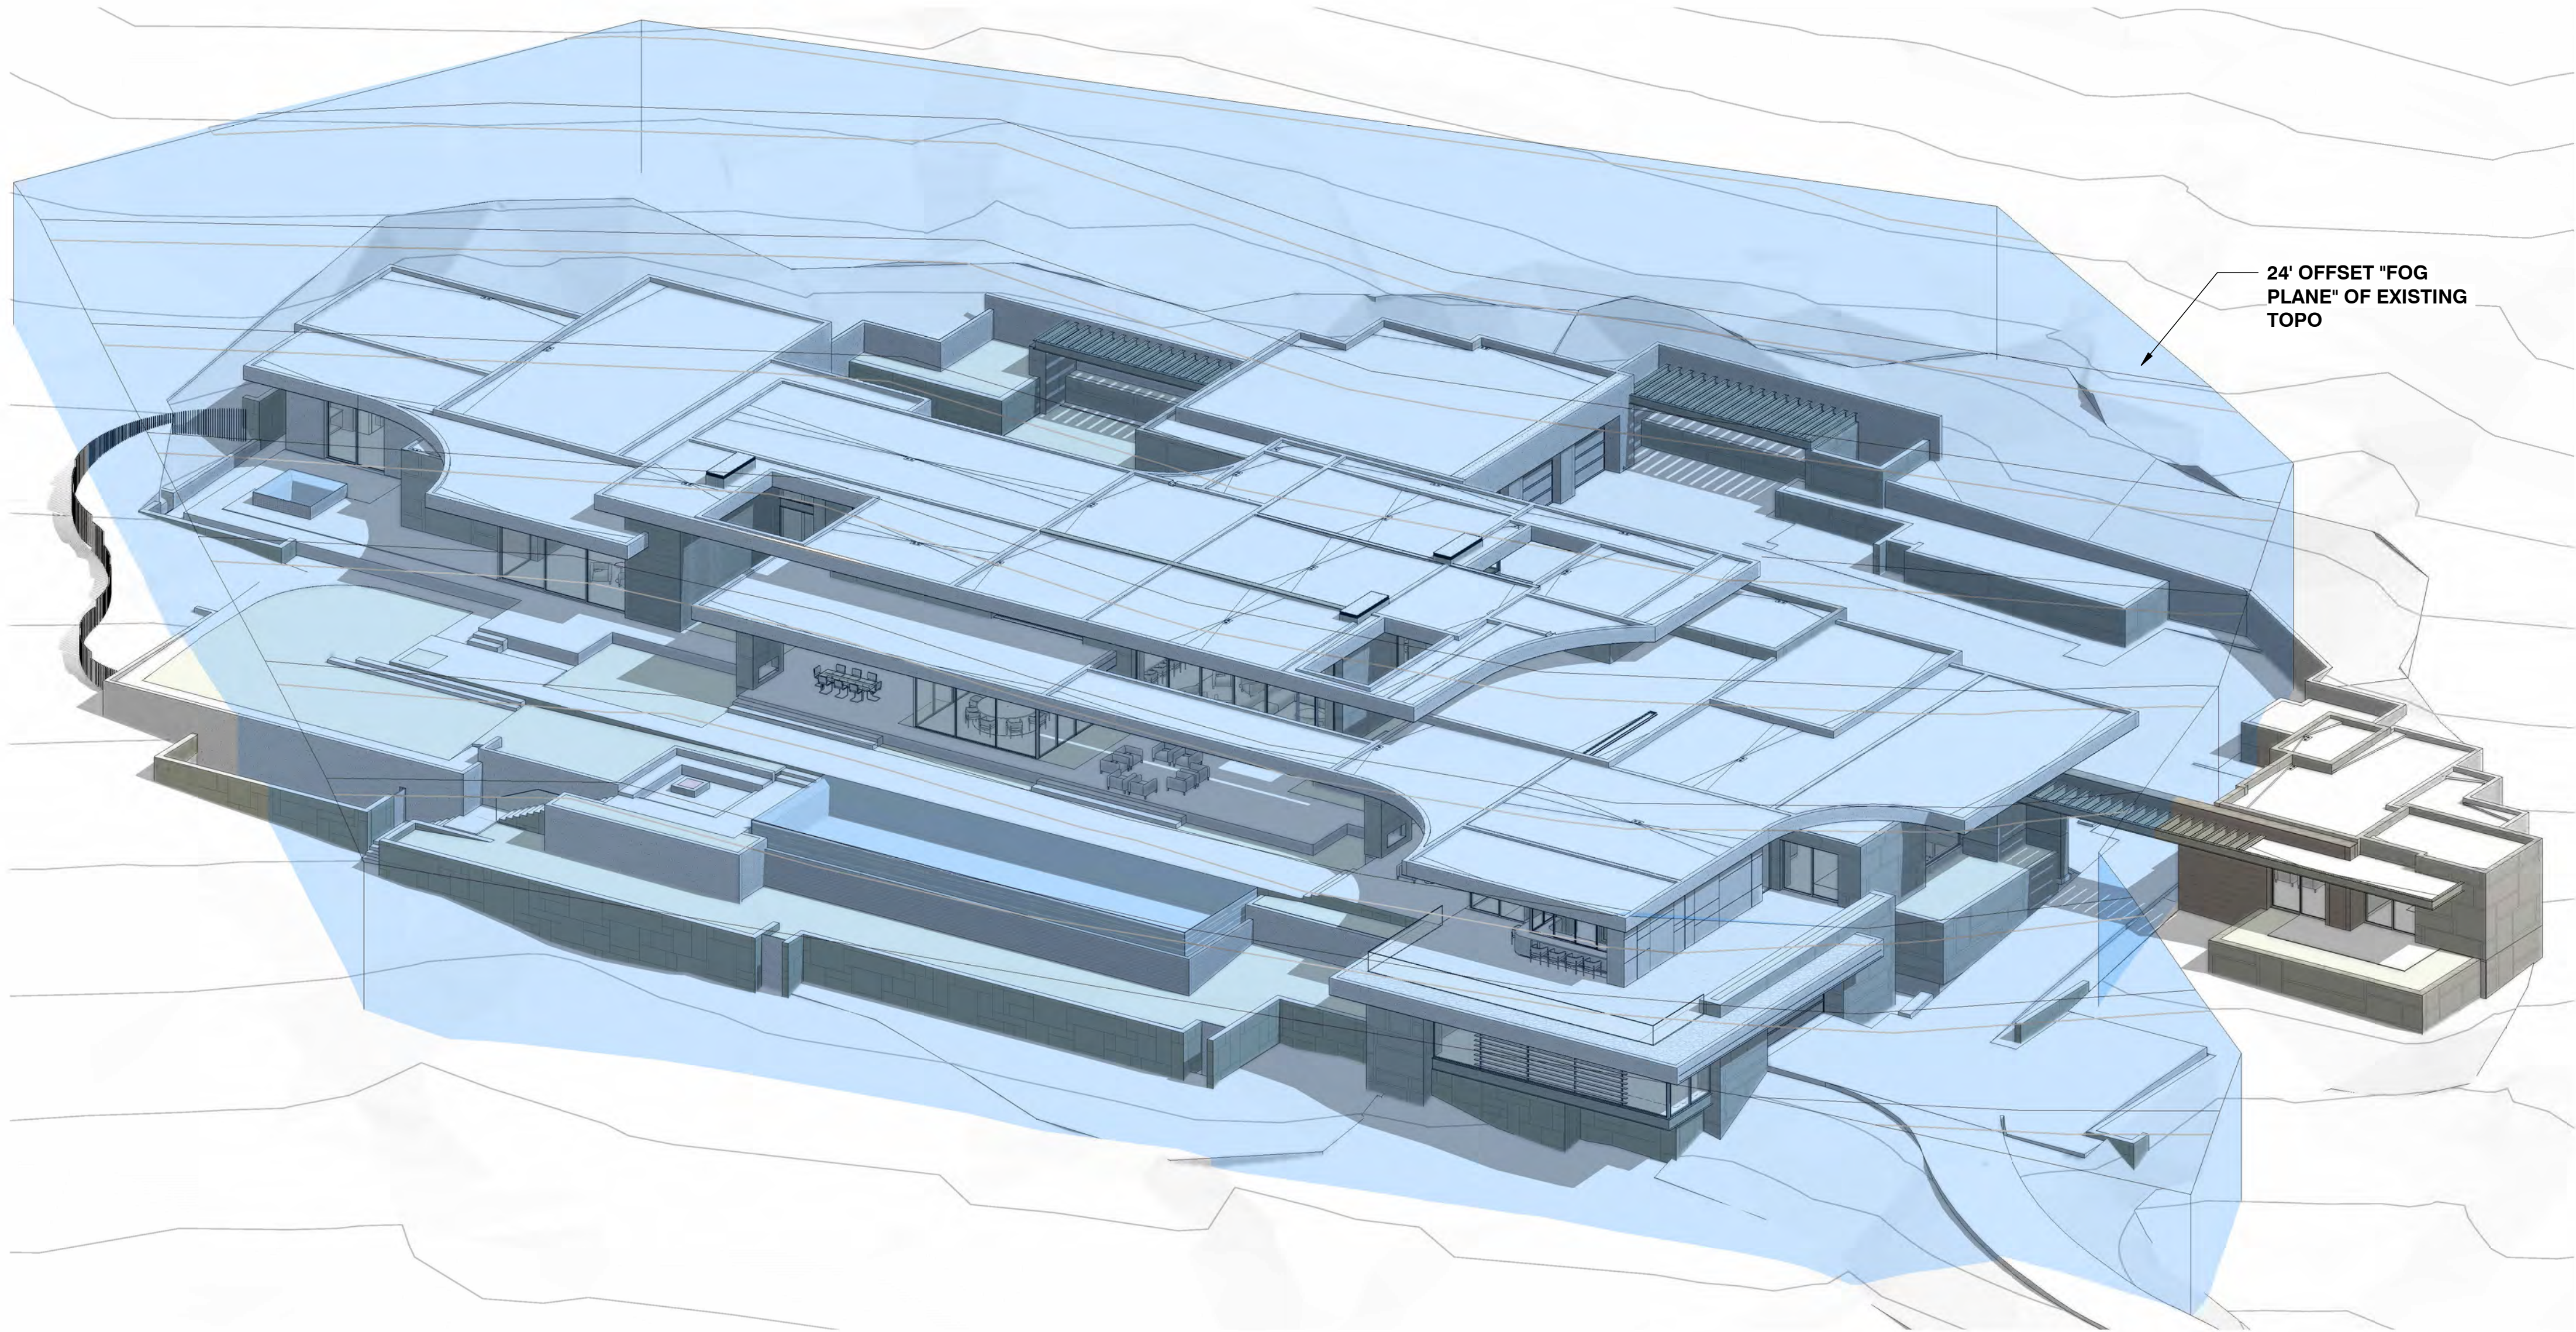

TOPO 3D 24' OFFSET

GENERAL NOTES

- IT IS THE INTENT OF THESE DRAWINGS TO PROVIDE A COMPREHENSIVE LIGHTING PLAN WHICH SHOWS LIGHT FIXTURE LOCATIONS, FIXTURE SPECIFICATIONS, AND CIRCUITRY FOR THE PURPOSE OF A LICENSED ELECTRICAL CONTRACTOR TO BID AND INSTALL A COMPLETE LIGHTING SYSTEM.
- THE ELECTRICAL CONTRACTOR SHALL FOLLOW AND ADHERE TO THE CURRENT NATIONAL ELECTRICAL CODE (NEC). IN THE EVENT OF A CONFLICT BETWEEN THIS DRAWING AND THE APPLICABLE CODE, THE CODE SHALL PREVAIL, AND THE INSTALLATION SHALL BE MADE IN COMPLIANCE WITH THE CODE.
- ALL EMERGENCY EGRESS LIGHTING IS THE RESPONSIBILITY OF THE ELECTRICAL ENGINEER OR ELECTRICAL CONTRACTOR.
- ALL WALL AND FLOOR OUTLETS SHOWN ON LIGHTING PLAN ARE FOR CONTROL OF LIGHTING EQUIPMENT. ALL OTHER OUTLETS AND LOCATIONS ALONG WITH CIRCUIT BREAKER AND/OR DETAILED ELECTRICAL WIRING PLEASE REFER TO THE ELECTRICAL SHEETS.
- ALL DIMMING CIRCUITS ARE TWO-WIRE UNLESS NOTED DIFFERENTLY. NO COMMON NEUTRALS SHALL BE USED.
- FIELD PAINT ALL CONDUIT, JUNCTION BOXES, LIGHTING TRIM AND HARDWARE TO MATCH ADJACENT SURFACES.
- ELECTRICAL CONTRACTOR SHALL VERIFY ALL MOUNTING HEIGHTS OF ALL DECORATIVE FIXTURES WITH INTERIOR DESIGNER PRIOR TO INSTALLATION.
- ALL STEP LIGHTS SHALL BE MOUNTED AT +1'4" A.F.F. TO CENTER OF FIXTURE UNLESS OTHERWISE NOTED.
- ALL WIRE USED SHALL BE COPPER.
- IN ORDER TO MAINTAIN THE INTEGRITY OF OUR LIGHTING DESIGN, KJF LIGHTING DESIGN WILL REQUIRE SITE VISITS DURING ELECTRICAL ROUGH AND ELECTRICAL TRIM STAGES. THE ELECTRICAL CONTRACTOR MAY BE HELD LIABLE FOR EXPENSES INCURRED IN A RESULT OF MOVING LIGHT FIXTURES INSTALLED PRIOR TO CLIENT OR KJF LIGHTING DESIGN'S APPROVAL.
- THE ELECTRICAL CONTRACTOR SHALL ALLOW TWO EVENINGS (4 HOUR MINIMUM EACH) AND PROVIDE ALL NECESSARY LADDERS AND MAN LIFTS TO ASSIST KJF LIGHTING DESIGN DURING THE FINAL AIM AND FOCUS OF ALL ADJUSTABLE LIGHTING FIXTURES.
- IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR TO REVIEW ALL INFORMATION ON THESE PLANS. IF THERE ARE ERRORS, OMISSIONS, OR QUESTIONS CONCERNING THESE PLANS PLEASE CONTACT KJF LIGHTING DESIGN - 602.448.5007 FOR CLARIFICATION.

PROJECT NOTES

- ALL PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL CONTAIN ONLY HIGH-EFFICACY LAMPS. (N1104.1)
- ALL PERMANENTLY INSTALLED INTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER A DIMMER, AN OCCUPANT SENSOR CONTROL, OR OTHER CONTROL SUCH AS AN AUTOMATIC TIMER SHUT-OFF SWITCH. EXCEPTIONS INCLUDE BATHROOMS AND HALLWAYS. (N1104.2)
- EXTERIOR LIGHTING OVER 30 WATTS SHALL INCLUDE AN AUTOMATIC SHUT-OFF. (N1104.3)
- RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES. ALL RECESSED LUMINAIRES SHALL BE IC-RATED AND LABELED AS HAVING AN AIR LEAKAGE RATE NOT MORE THAN 2.0 CFM. ALL RECESSED LUMINAIRES SHALL BE SEALED WITH A GASKET OR CAULK BETWEEN THE HOUSING AND THE INTERIOR WALL OR CEILING COVERING. (N1102.4.4)
- FIXTURES LOCATED IN DAMP OR WET LOCATIONS SUCH AS SHOWER/TUB AREA AND FIXTURES/LIGHTS INSTALLED OUTSIDE SHALL BE "LISTED" TO BE SUITABLE FOR DAMP / WET LOCATION.
- ALL LINEAR LED STRIP TAPE LIGHT TO BE FED EVERY 16'-0". CONSULT KJF LIGHTING DESIGN FOR WIRING DIAGRAMS.

LIGHT CONTROL SYMBOL LEGEND

- S SINGLE POLE SWITCH
- S¹ SINGLE POLE JAMB SWITCH
- S² SINGLE POLE MOTION SWITCH
- S³ SINGLE POLE TIMER SWITCH
- D SINGLE POLE DIMMER
- 1/2 SWITCHED DUPLEX RECEPTACLE
- SWITCHED RECESSED CLOCK RECEPTACLE
- FP 1/2 SWITCHED FLOOR PLUG RECEPTACLE
- TF REMOTE LOW VOLTAGE TRANSFORMER
- CEILING MOUNTED EXHAUST FAN
- ELECTRIC FIREPLACE IGNITOR
- LIGHTING CONTROL KEYPAD
- XXX LIGHTING CONTROL SWITCH/LEG
- ENCLOSURE LIGHTING CONTROL ENCLOSURE

1 MAIN FLOOR PLAN (CONT'D)
LIGHTING PLAN

SCALE: 3/16"=1'-0"

GENERAL NOTES

1. IT IS THE INTENT OF THESE DRAWINGS TO PROVIDE A COMPREHENSIVE LIGHTING PLAN WHICH SHOWS LIGHT FIXTURE LOCATIONS, FIXTURE SPECIFICATIONS, AND CIRCUITRY FOR THE PURPOSE OF A LICENSED ELECTRICAL CONTRACTOR TO BID AND INSTALL A COMPLETE LIGHTING SYSTEM.
2. THE ELECTRICAL CONTRACTOR SHALL FOLLOW AND ADHERE TO THE CURRENT NATIONAL ELECTRICAL CODE (NEC). IN THE EVENT OF A CONFLICT BETWEEN THIS DRAWING AND THE APPLICABLE CODE, THE CODE SHALL PREVAIL AND THE INSTALLATION SHALL BE MADE IN COMPLIANCE WITH THE CODE.
3. ALL EMERGENCY EGRESS LIGHTING IS THE RESPONSIBILITY OF THE ELECTRICAL ENGINEER OR ELECTRICAL CONTRACTOR.
4. ALL WALL AND FLOOR OUTLETS SHOWN ON LIGHTING PLAN ARE FOR CONTROL OF LIGHTING EQUIPMENT. ALL OTHER OUTLETS AND LOCATIONS ALONG WITH CIRCUIT BREAKER AND/OR DETAILED ELECTRICAL WIRING PLEASE REFER TO THE ELECTRICAL SHEETS.
5. ALL DIMMING CIRCUITS ARE TWO-WIRE UNLESS NOTED DIFFERENTLY. NO COMMON NEUTRALS SHALL BE USED.
6. FIELD PAINT ALL CONDUIT, JUNCTION BOXES, LIGHTING TRIM AND HARDWARE TO MATCH ADJACENT SURFACES.
7. ELECTRICAL CONTRACTOR SHALL VERIFY ALL CEILING TYPES, RECESS CONDITIONS, AND MOUNTING HARDWARE REQUIRED PRIOR TO PURCHASE OF ANY LIGHTING FIXTURES.
8. ELECTRICAL CONTRACTOR SHALL VERIFY MOUNTING HEIGHTS OF ALL DECORATIVE FIXTURES WITH INTERIOR DESIGNER PRIOR TO INSTALLATION.
9. ALL STEP LIGHTS SHALL BE MOUNTED AT +1'-4" A.F.F. TO CENTER OF FIXTURE UNLESS OTHERWISE NOTED.
10. ALL WIRE USED SHALL BE COPPER.
11. IN ORDER TO MAINTAIN THE INTEGRITY OF OUR LIGHTING DESIGN, KJF LIGHTING DESIGN, WILL REQUIRE SITE VISITS DURING ELECTRICAL ROUGH AND ELECTRICAL TRIM STAGES. THE ELECTRICAL CONTRACTOR MAY BE HELD LIABLE FOR EXPENSES INCURRED IN A RESULT OF MOVING LIGHT FIXTURES INSTALLED PRIOR TO CLIENT OR KJF LIGHTING DESIGN'S APPROVAL.
12. THE ELECTRICAL CONTRACTOR SHALL ALLOW TWO EVENINGS (4 HOUR MINIMUM EACH) AND PROVIDE ALL NECESSARY LADDERS AND MAN LIFTS TO ASSIST KJF LIGHTING DESIGN DURING THE FINAL AIM AND FOCUS OF ALL ADJUSTABLE LIGHTING FIXTURES.
13. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR TO REVIEW ALL INFORMATION ON THESE PLANS. IF THERE ARE ERRORS, OMISSIONS, OR QUESTIONS CONCERNING THESE PLANS PLEASE CONTACT KJF LIGHTING DESIGN - 602-448-5007 FOR CLARIFICATION.

PROJECT NOTES

1. ALL PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL CONTAIN ONLY HIGH-EFFICACY LAMPS. (N1104.1)
2. ALL PERMANENTLY INSTALLED INTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER A DIMMER, AN OCCUPANT SENSOR CONTROL OR OTHER CONTROL SUCH AS AN AUTOMATIC TIMER SHUT-OFF SWITCH. EXCEPTIONS INCLUDE BATHROOMS AND HALLWAYS. (N1104.2)
3. EXTERIOR LIGHTING OVER 30 WATTS SHALL INCLUDE AN AUTOMATIC SHUT-OFF. (N1104.3)
4. RECESSED LUMINARIES INSTALLED IN THE BUILDING THERMAL ENVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES. ALL RECESSED LUMINARIES SHALL BE IC-RATED AND LABELED AS HAVING AN AIR LEAKAGE RATE NOT MORE THAN 2.0 CFM. ALL RECESSED LUMINARIES SHALL BE SEALED WITH A GASKET OR CAULK BETWEEN THE HOUSING AND THE INTERIOR WALL OR CEILING COVERING. (N1102.4.4)
5. FIXTURES LOCATED IN DAMP OR WET LOCATIONS SUCH AS SHOWER/TUB AREA AND FIXTURES/LIGHTS INSTALLED OUTSIDE SHALL BE "LISTED" TO BE SUITABLE FOR DAMP / WET LOCATION.
6. ALL LINEAR LED STRIP TAPE LIGHT TO BE FED EVERY 16'-0". CONSULT KJF LIGHTING DESIGN FOR WIRING DIAGRAMS

LIGHT CONTROL SYMBOL LEGEND

- \$ SINGLE POLE SWITCH
- \$ SINGLE POLE JAMB SWITCH
- \$ SINGLE POLE MOTION SWITCH
- \$ SINGLE POLE TIMER SWITCH
- \$ SINGLE POLE DIMMER
- 1/2 SWITCHED DUPLEX RECEPTACLE
- SWITCHED RECESSED CLOCK RECEPTACLE
- 1/2 SWITCHED FLOOR PLUG RECEPTACLE
- TF REMOTE LOW VOLTAGE TRANSFORMER
- CEILING MOUNTED EXHAUST FAN
- ELECTRIC FIREPLACE IGNITOR
- LIGHTING CONTROL KEYPAD
- XXXX LIGHTING CONTROL SWITCH/LEG
- LIGHTING CONTROL ENCLOSURE

KEVIN J.
FLOWER
LIGHTING DESIGN

20650 N. 29th Place Suite 106
PHOENIX, AZ 85050
WWW.KVINJFLOWER.COM
T 602.341.3667

This drawing is an instrument of service and the property of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC. It shall not be reproduced, copied, or published in any form without the written consent of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC.

DRAWN BY:
JOHNNY ANGUIZ

DATE: MARCH 25, 2026

SCALE: AS NOTED

REVISIONS:

- 1
- 2
- 3

RUKAVINA RESIDENCE
5611 E ROAD RUNNER LANE
PARADISE VALLEY, AZ

HILLSIDE
REVIEW

EL 2

SHEET NUMBER:

1 MAIN FLOOR PLAN (CONT'D)
LIGHTING PLAN

SCALE: 3/16"=1'-0"

GENERAL NOTES

1. IT IS THE INTENT OF THESE DRAWINGS TO PROVIDE A COMPREHENSIVE LIGHTING PLAN WHICH SHOWS LIGHT FIXTURE LOCATIONS, FIXTURE SPECIFICATIONS, AND CIRCUITRY FOR THE PURPOSE OF A LICENSED ELECTRICAL CONTRACTOR TO BID AND INSTALL A COMPLETE LIGHTING SYSTEM.
2. THE ELECTRICAL CONTRACTOR SHALL FOLLOW AND ADHERE TO THE CURRENT NATIONAL ELECTRICAL CODE (NEC). IN THE EVENT OF A CONFLICT BETWEEN THIS DRAWING AND THE APPLICABLE CODE, THE CODE SHALL PREVAIL AND THE INSTALLATION SHALL BE MADE IN COMPLIANCE WITH THE CODE.
3. ALL EMERGENCY EGRESS LIGHTING IS THE RESPONSIBILITY OF THE ELECTRICAL ENGINEER OR ELECTRICAL CONTRACTOR.
4. ALL WALL AND FLOOR OUTLETS SHOWN ON LIGHTING PLAN ARE FOR CONTROL OF LIGHTING EQUIPMENT. ALL OTHER OUTLETS AND LOCATIONS ALONG WITH CIRCUIT BREAKER AND/OR DETAILED ELECTRICAL WIRING PLEASE REFER TO THE ELECTRICAL SHEETS.
5. ALL DIMMING CIRCUITS ARE TWO-WIRE UNLESS NOTED DIFFERENTLY. NO COMMON NEUTRALS SHALL BE USED.
6. FIELD PAINT ALL CONDUIT, JUNCTION BOXES, LIGHTING TRIM AND HARDWARE TO MATCH ADJACENT SURFACES.
7. ELECTRICAL CONTRACTOR SHALL VERIFY ALL CEILING TYPES, RECESS CONDITIONS, AND MOUNTING HARDWARE REQUIRED PRIOR TO PURCHASE OF ANY LIGHTING FIXTURES.
8. ELECTRICAL CONTRACTOR SHALL VERIFY MOUNTING HEIGHTS OF ALL DECORATIVE FIXTURES WITH INTERIOR DESIGNER PRIOR TO INSTALLATION.
9. ALL STEP LIGHTS SHALL BE MOUNTED AT +1'-4" A.F.F. TO CENTER OF FIXTURE UNLESS OTHERWISE NOTED.
10. ALL WIRE USED SHALL BE COPPER.
11. IN ORDER TO MAINTAIN THE INTEGRITY OF OUR LIGHTING DESIGN, KJF LIGHTING DESIGN WILL REQUIRE SITE VISITS DURING ELECTRICAL ROUGH AND ELECTRICAL TRIM STAGES. THE ELECTRICAL CONTRACTOR MAY BE HELD LIABLE FOR EXPENSES INCURRED IN A RESULT OF MOVING LIGHT FIXTURES INSTALLED PRIOR TO CLIENT OR KJF LIGHTING DESIGN'S APPROVAL.
12. THE ELECTRICAL CONTRACTOR SHALL ALLOW TWO EVENINGS (4 HOUR MINIMUM EACH) AND PROVIDE ALL NECESSARY LADDERS AND MAN LIFTS TO ASSIST KJF LIGHTING DESIGN DURING THE FINAL AIM AND FOCUS OF ALL ADJUSTABLE LIGHTING FIXTURES.
13. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR TO REVIEW ALL INFORMATION ON THESE PLANS. IF THERE ARE ERRORS, OMISSIONS, OR QUESTIONS CONCERNING THESE PLANS PLEASE CONTACT KJF LIGHTING DESIGN - 602-448-5007 FOR CLARIFICATION.

PROJECT NOTES

1. ALL PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL CONTAIN ONLY HIGH-EFFICACY LAMPS. (N1104.1)
2. ALL PERMANENTLY INSTALLED INTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER A DIMMER, AN OCCUPANT SENSOR CONTROL OR OTHER CONTROL SUCH AS AN AUTOMATIC TIMER SHUT-OFF SWITCH. EXCEPTIONS INCLUDE BATHROOMS AND HALLWAYS. (N1104.2)
3. EXTERIOR LIGHTING OVER 30 WATTS SHALL INCLUDE AN AUTOMATIC SHUT-OFF. (N1104.3)
4. RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES. ALL RECESSED LUMINAIRES SHALL BE IC-RATED AND LABELED AS HAVING AN AIR LEAKAGE RATE NOT MORE THAN 2.0 CFM. ALL RECESSED LUMINAIRES SHALL BE SEALED WITH A GASKET OR CAULK BETWEEN THE HOUSING AND THE INTERIOR WALL OR CEILING COVERING. (N1102.4.1)
5. FIXTURES LOCATED IN DAMP OR WET LOCATIONS SUCH AS SHOWER/TUB AREA AND FIXTURES/LIGHTS INSTALLED OUTSIDE SHALL BE "LISTED" TO BE SUITABLE FOR DAMP / WET LOCATION.
6. ALL LINEAR LED STRIP TAPE LIGHT TO BE FED EVERY 16'-0". CONSULT KJF LIGHTING DESIGN FOR WIRING DIAGRAMS

LIGHT CONTROL SYMBOL LEGEND

- \$ SINGLE POLE SWITCH
- \$ SINGLE POLE JAMB SWITCH
- \$ SINGLE POLE MOTION SWITCH
- \$ SINGLE POLE TIMER SWITCH
- \$ SINGLE POLE DIMMER
- 1/2 SWITCHED DUPLEX RECEPTACLE
- SWITCHED RECESSED CLOCK RECEPTACLE
- 1/2 SWITCHED FLOOR PLUG RECEPTACLE
- TF REMOTE LOW VOLTAGE TRANSFORMER
- CEILING MOUNTED EXHAUST FAN
- ELECTRIC FIREPLACE IGNITOR
- XX LIGHTING CONTROL KEYPAD
- XXX LIGHTING CONTROL SWITCH/LEG
- ENCLOSURE LIGHTING CONTROL ENCLOSURE

HILLSIDE
REVIEW

KEVIN J.
FLOWER
LIGHTING DESIGN

20650 N. 29th Place Suite 106
PHOENIX, AZ 85050
WWW.KJFLOWER.COM
T 602.341.3667

This drawing is an instrument of service and the property of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC. It shall not be reproduced, copied, or published by any method in whole or in part without the written consent of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC.

DRAWN BY:
JOHNNY ANGUIZ

DATE: MARCH 25, 2026

SCALE: AS NOTED


REVISIONS:

- 1
- 2
- 3

RUKAVINA RESIDENCE
5611 E ROAD RUNNER LANE
PARADISE VALLEY, AZ

SHEET NUMBER:

EL 3

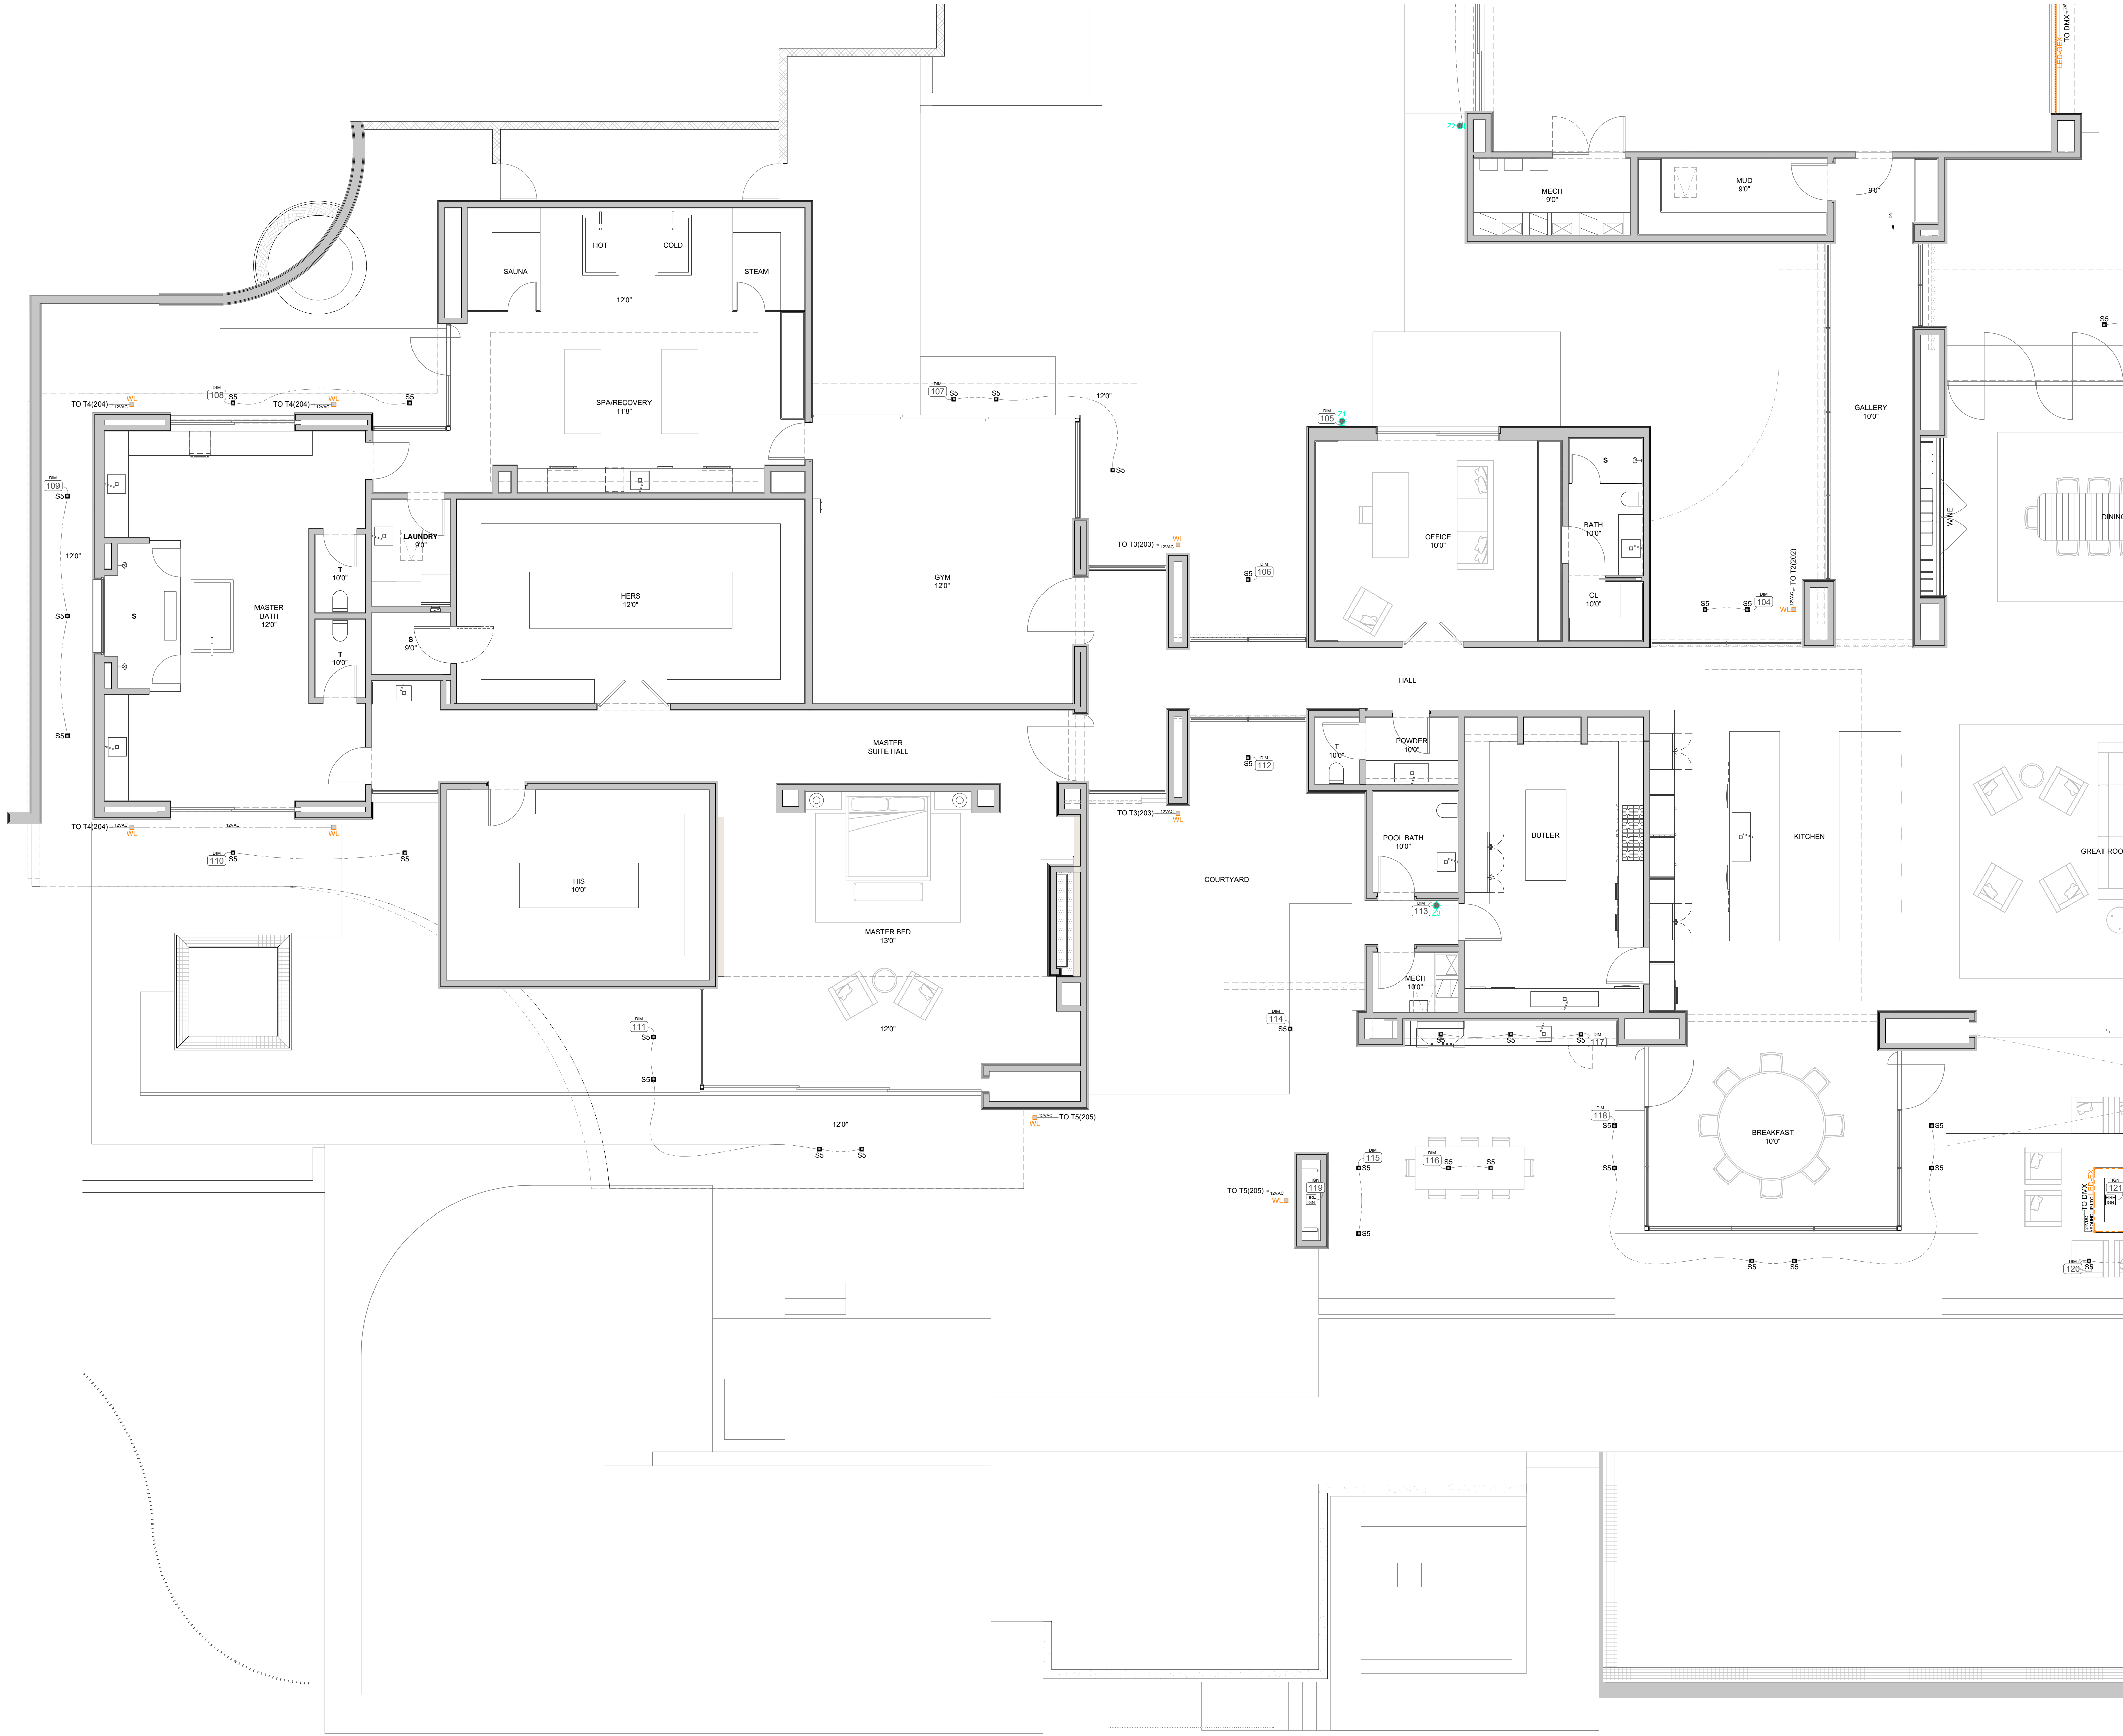

- GENERAL NOTES
1. IT IS THE INTENT OF THESE DRAWINGS TO PROVIDE A COMPREHENSIVE LIGHTING PLAN WHICH SHOWS LIGHT FIXTURE LOCATIONS, FIXTURE SPECIFICATIONS, AND CIRCUITRY FOR THE PURPOSE OF A LICENSED ELECTRICAL CONTRACTOR TO BID AND INSTALL A COMPLETE LIGHTING SYSTEM.

2. THE ELECTRICAL CONTRACTOR SHALL FOLLOW AND ADHERE TO THE CURRENT NATIONAL ELECTRICAL CODE (NEC). IN THE EVENT OF A CONFLICT BETWEEN THIS DRAWING AND THE APPLICABLE CODE, THE CODE SHALL PREVAIL AND THE INSTALLATION SHALL BE MADE IN COMPLIANCE WITH THE CODE.

3. ALL EMERGENCY EGRESS LIGHTING IS THE RESPONSIBILITY OF THE ELECTRICAL ENGINEER OR ELECTRICAL CONTRACTOR.

4. ALL WALL AND FLOOR OUTLETS SHOWN ON LIGHTING PLAN ARE FOR CONTROL OF LIGHTING EQUIPMENT. ALL OTHER OUTLETS AND LOCATIONS ALONG WITH CIRCUIT BREAKER AND/OR DETAILED ELECTRICAL WIRING PLEASE REFER TO THE ELECTRICAL SHEETS.

5. ALL DIMMING CIRCUITS ARE TWO-WIRE UNLESS NOTED DIFFERENTLY. NO COMMON NEUTRALS SHALL BE USED.

6. FIELD PAINT ALL CONDUIT, JUNCTION BOXES, LIGHTING TRIM AND HARDWARE TO MATCH ADJACENT SURFACES.

7. ELECTRICAL CONTRACTOR SHALL VERIFY ALL CEILING TYPES, RECESS CONDITIONS, AND MOUNTING HARDWARE REQUIRED PRIOR TO PURCHASE OF ANY LIGHTING FIXTURES.

8. ELECTRICAL CONTRACTOR SHALL VERIFY MOUNTING HEIGHTS OF ALL DECORATIVE FIXTURES WITH INTERIOR DESIGNER PRIOR TO INSTALLATION.

9. ALL STEP LIGHTS SHALL BE MOUNTED AT +1'-6" A.F.F. TO CENTER OF FIXTURE UNLESS OTHERWISE NOTED.

10. ALL WIRE USED SHALL BE COPPER.

11. IN ORDER TO MAINTAIN THE INTEGRITY OF OUR LIGHTING DESIGN, KJF LIGHTING DESIGN WILL REQUIRE SITE VISITS DURING ELECTRICAL ROUGH AND ELECTRICAL TRIM STAGES. THE ELECTRICAL CONTRACTOR MAY BE HELD LIABLE FOR EXPENSES INCURRED AS A RESULT OF MOVING LIGHT FIXTURES INSTALLED PRIOR TO CLIENT OR KJF LIGHTING DESIGNS' APPROVAL.

12. THE ELECTRICAL CONTRACTOR SHALL ALLOW TWO EVENINGS (4 HOUR MINIMUM EACH) AND PROVIDE ALL NECESSARY LADDERS AND MAN LIFTS TO ASSIST KJF LIGHTING DESIGN DURING THE FINAL AIM AND FOCUS OF ALL ADJUSTABLE LIGHTING FIXTURES.

13. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR TO REVIEW ALL INFORMATION ON THESE PLANS. IF THERE ARE ERRORS, OMISSIONS, OR QUESTIONS CONCERNING THESE PLANS PLEASE CONTACT KJF LIGHTING DESIGN - 602-448-5007 FOR CLARIFICATION.
- PROJECT NOTES
1. ALL PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL CONTAIN ONLY HIGH-EFFICACY LAMPS. (N1104.1)

2. ALL PERMANENTLY INSTALLED INTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER A DIMMER, AN OCCUPANT SENSOR CONTROL OR OTHER CONTROL SUCH AS AN AUTOMATIC TIMER SHUT-OFF SWITCH. EXCEPTIONS INCLUDE BATHROOMS AND HALLWAYS. (N1104.2)

3. EXTERIOR LIGHTING OVER 30 WATTS SHALL INCLUDE AN AUTOMATIC SHUT-OFF. (N1104.3)

4. RECESSED LUMINARIES INSTALLED IN THE BUILDING THERMAL ENVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES. ALL RECESSED LUMINARIES SHALL BE IC-RATED AND LABELED AS HAVING AN AIR LEAKAGE RATE NOT MORE THAN 2.0 CFM. ALL RECESSED LUMINARIES SHALL BE SEALED WITH A GASKET OR CAULK BETWEEN THE HOUSING AND THE INTERIOR WALL OR CEILING COVERING. (N1102.4.4)

5. FIXTURES LOCATED IN DAMP OR WET LOCATIONS SUCH AS SHOWER/TUB AREA AND FIXTURES/LIGHTS INSTALLED OUTSIDE SHALL BE "LISTED" TO BE SUITABLE FOR DAMP / WET LOCATION.

6. ALL LINEAR LED STRIP TAPE LIGHT TO BE FED EVERY 16'-0". CONSULT KJF LIGHTING DESIGN FOR WIRING DIAGRAMS

KEVIN J. FLOWER
LIGHTING DESIGN

20650 N. 29th Place Suite 106
PHOENIX, AZ 85050
WWW.KVINJFLOWER.COM
T 602.341.3667

This drawing is an instrument of service and the property of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC. It shall not be reproduced, copied, or published in any form without the written consent of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC.

DRAWN BY:
JOHNNY ANGUIZ

DATE: MARCH 25, 2026

SCALE: AS NOTED

- REVISIONS:
- 1

2

3

RUKAVINA RESIDENCE
5611 E ROAD RUNNER LANE
PARADISE VALLEY, AZ


1 MAIN FLOOR PLAN (CONT'D)
LIGHTING PLAN

SCALE: 3/16"=1'-0"

HILLSIDE
REVIEW

EL 4

SHEET NUMBER:

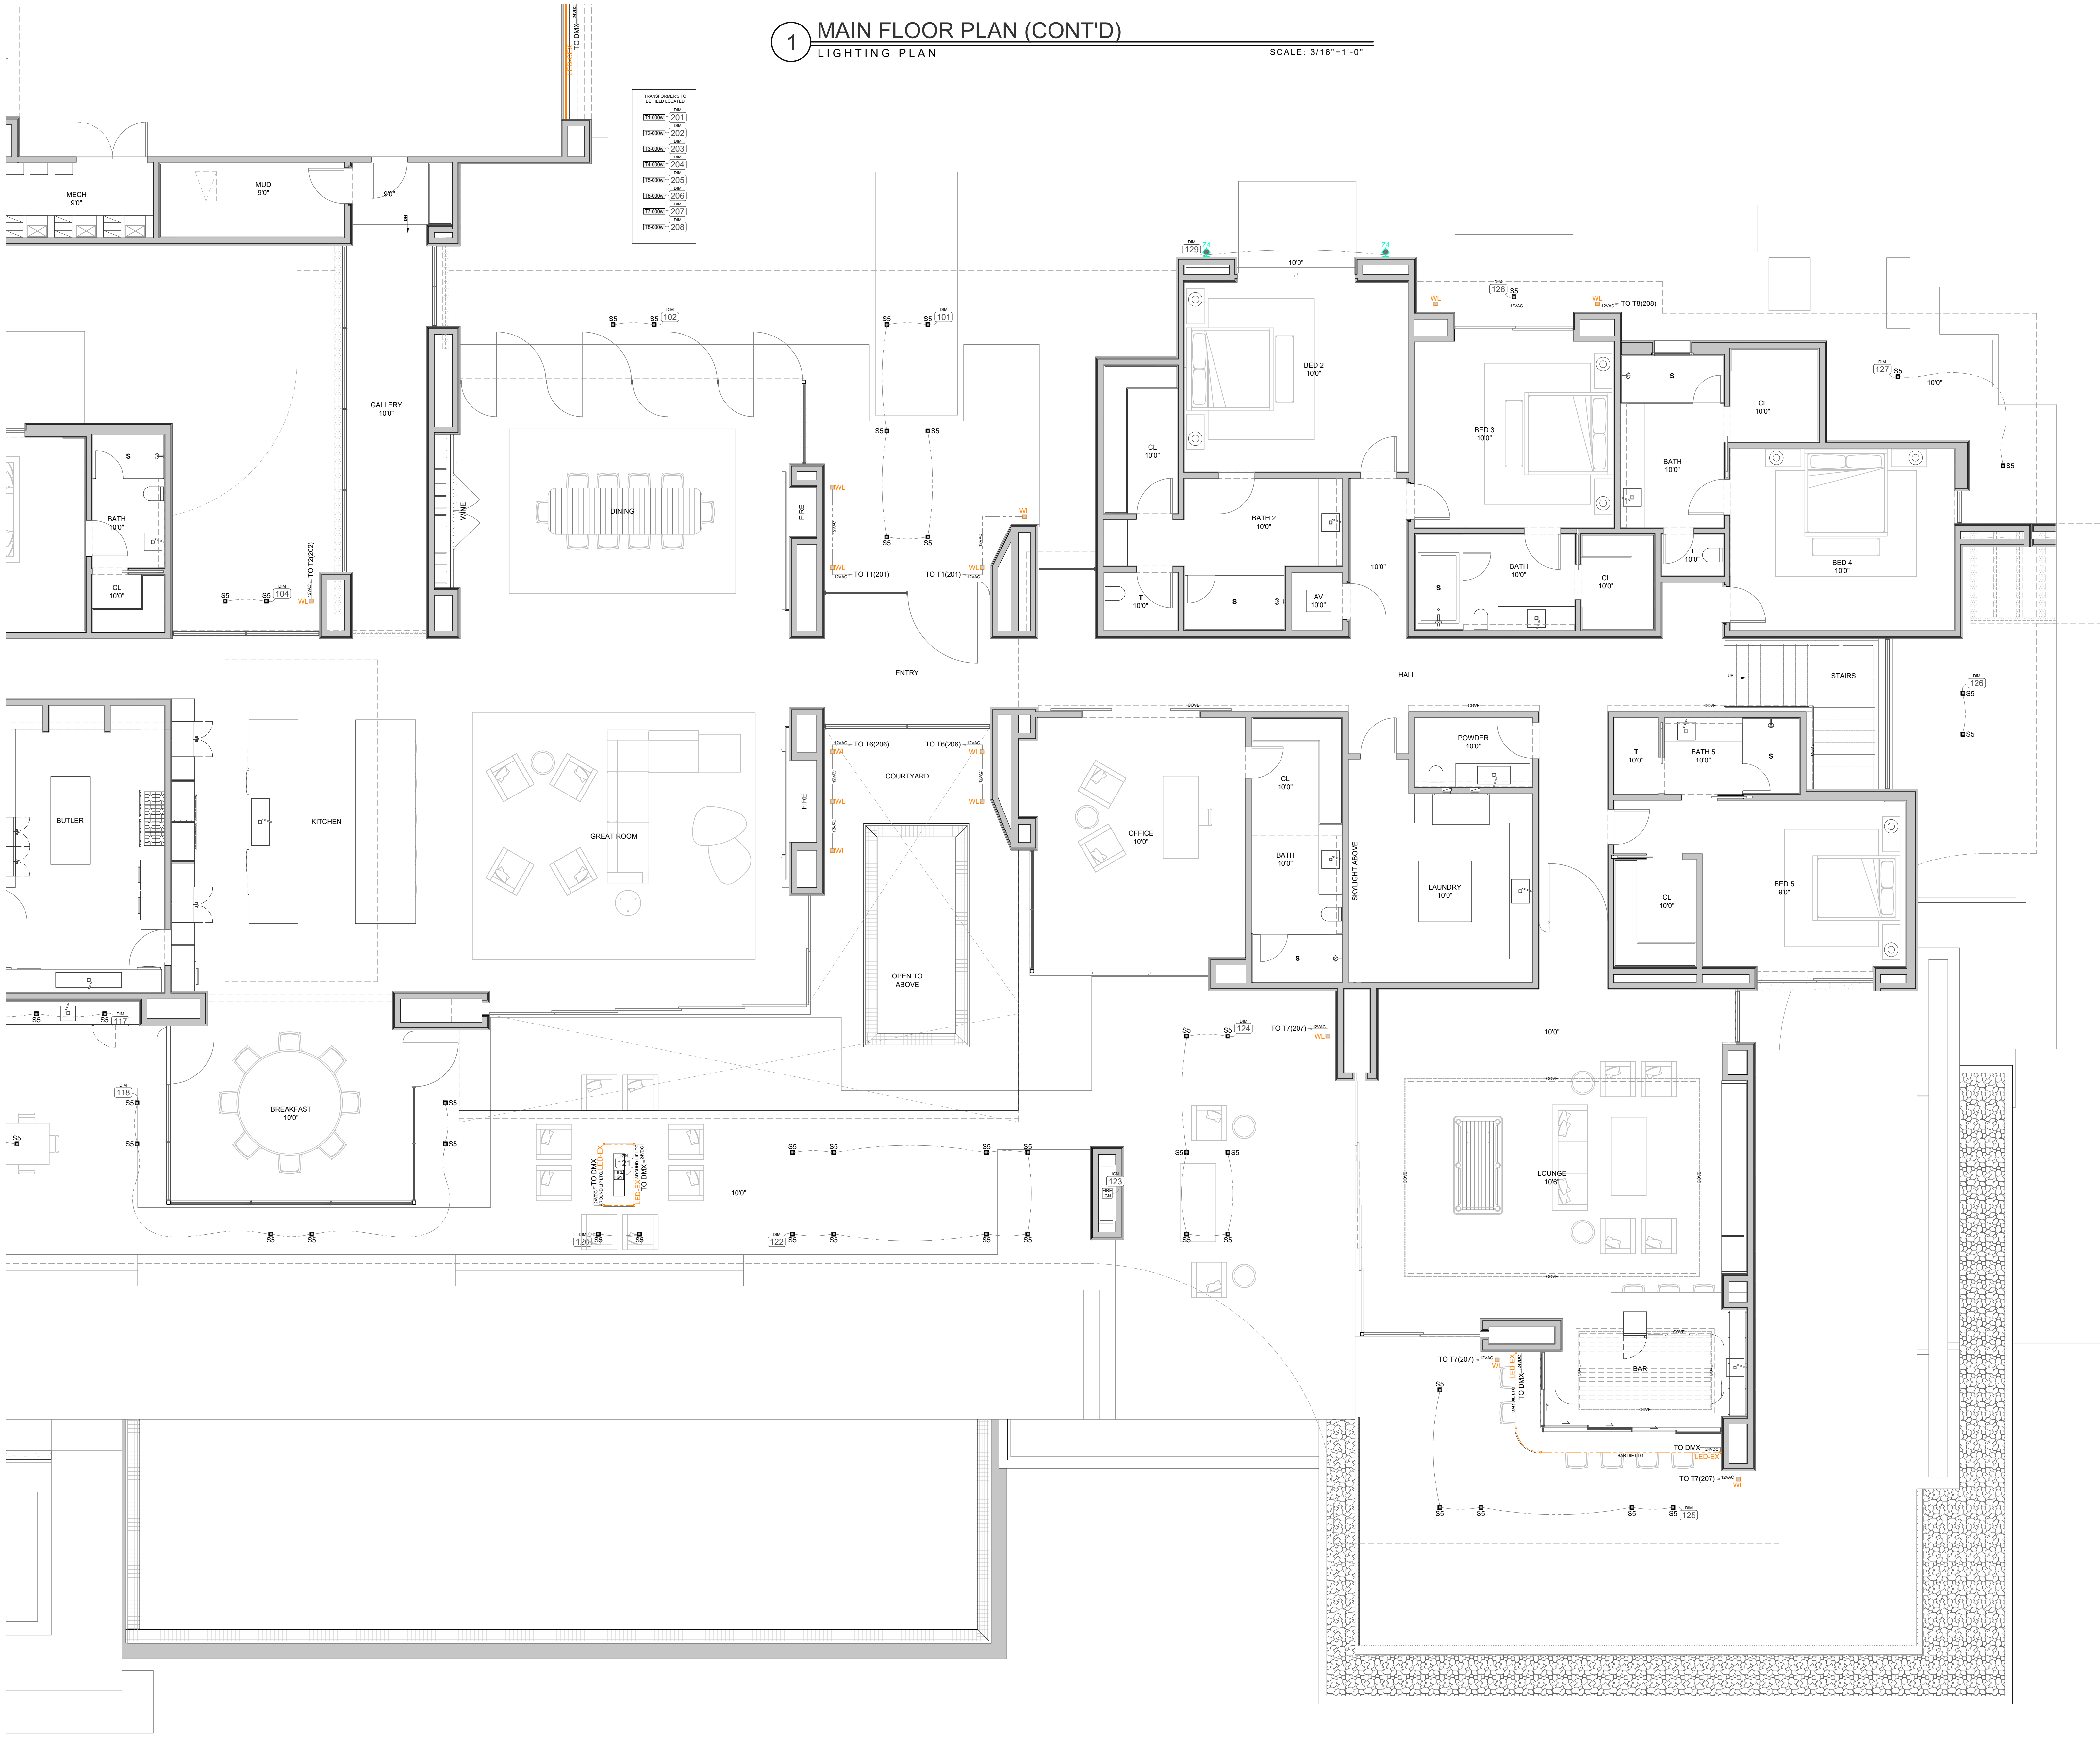

1 MAIN FLOOR PLAN (CONT'D)

LIGHTING PLAN

SCALE: 3/16"=1'-0"

GENERAL NOTES

- IT IS THE INTENT OF THESE DRAWINGS TO PROVIDE A COMPREHENSIVE LIGHTING PLAN WHICH SHOWS LIGHT FIXTURE LOCATIONS, FIXTURE SPECIFICATIONS, AND CIRCUITRY FOR THE PURPOSE OF A LICENSED ELECTRICAL CONTRACTOR TO BID AND INSTALL A COMPLETE LIGHTING SYSTEM.
- THE ELECTRICAL CONTRACTOR SHALL FOLLOW AND ADHERE TO THE CURRENT NATIONAL ELECTRICAL CODE (NEC). IN THE EVENT OF A CONFLICT BETWEEN THIS DRAWING AND THE APPLICABLE CODE, THE CODE SHALL PREVAIL, AND THE INSTALLATION SHALL BE MADE IN COMPLIANCE WITH THE CODE.
- ALL EMERGENCY EGRESS LIGHTING IS THE RESPONSIBILITY OF THE ELECTRICAL ENGINEER OR ELECTRICAL CONTRACTOR.
- ALL WALL AND FLOOR OUTLETS SHOWN ON LIGHTING PLAN ARE FOR CONTROL OF LIGHTING EQUIPMENT. ALL OTHER OUTLETS AND LOCATIONS ALONG WITH CIRCUIT BREAKER AND/OR DETAILED ELECTRICAL WIRING PLEASE REFER TO THE ELECTRICAL SHEETS.
- ALL DIMMING CIRCUITS ARE TWO-WIRE UNLESS NOTED DIFFERENTLY. NO COMMON NEUTRALS SHALL BE USED.
- FIELD PAINT ALL CONDUIT, JUNCTION BOXES, LIGHTING TRIM AND HARDWARE TO MATCH ADJACENT SURFACES.
- ELECTRICAL CONTRACTOR SHALL VERIFY ALL CEILING TYPES, RECESS CONDITIONS, AND MOUNTING HARDWARE REQUIRED PRIOR TO PURCHASE OF ANY LIGHTING FIXTURES.
- ELECTRICAL CONTRACTOR SHALL VERIFY MOUNTING HEIGHTS OF ALL DECORATIVE FIXTURES WITH INTERIOR DESIGNER PRIOR TO INSTALLATION.
- ALL STEP LIGHTS SHALL BE MOUNTED AT +1'-4" A.F.F. TO CENTER OF FIXTURE UNLESS OTHERWISE NOTED.
- ALL WIRE USED SHALL BE COPPER.
- IN ORDER TO MAINTAIN THE INTEGRITY OF OUR LIGHTING DESIGN, KJF LIGHTING DESIGN, WILL REQUIRE SITE VISITS DURING ELECTRICAL ROUGH AND ELECTRICAL TRIM STAGES. THE ELECTRICAL CONTRACTOR MAY BE HELD LIABLE FOR EXPENSES INCURRED IN A RESULT OF MOVING LIGHT FIXTURES INSTALLED PRIOR TO CLIENT OR KJF LIGHTING DESIGNS' APPROVAL.
- THE ELECTRICAL CONTRACTOR SHALL ALLOW TWO EVENINGS (4 HOUR MINIMUM EACH) AND PROVIDE ALL NECESSARY LADDERS AND MAN LIFTS TO ASSIST KJF LIGHTING DESIGN DURING THE FINAL AIM AND FOCUS OF ALL ADJUSTABLE LIGHTING FIXTURES.
- IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR TO REVIEW ALL INFORMATION ON THESE PLANS. IF THERE ARE ERRORS, OMISSIONS, OR QUESTIONS CONCERNING THESE PLANS PLEASE CONTACT KJF LIGHTING DESIGN - 602-448-5007 FOR CLARIFICATION.

PROJECT NOTES

- ALL PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL CONTAIN ONLY HIGH-EFFICACY LAMPS. (N1104.1)
- ALL PERMANENTLY INSTALLED INTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER A DIMMER, AN OCCUPANT SENSOR CONTROL OR OTHER CONTROL SUCH AS AN AUTOMATIC TIMER SHUT-OFF SWITCH. EXCEPTIONS INCLUDE BATHROOMS AND HALLWAYS. (N1104.2)
- EXTERIOR LIGHTING OVER 30 WATTS SHALL INCLUDE AN AUTOMATIC SHUT-OFF. (N1104.3)
- RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES. ALL RECESSED LUMINAIRES SHALL BE IC-RATED AND LABELED AS HAVING AN AIR LEAKAGE RATE NOT MORE THAN 2.0 CFM. ALL RECESSED LUMINAIRES SHALL BE SEALED WITH A GASKET OR CAULK BETWEEN THE HOUSING AND THE INTERIOR WALL OR CEILING COVERING. (N1102.4.4)
- FIXTURES LOCATED IN DAMP OR WET LOCATIONS SUCH AS SHOWER/TUB AREA AND FIXTURES/LIGHTS INSTALLED OUTSIDE SHALL BE "LISTED" TO BE SUITABLE FOR DAMP / WET LOCATION.
- ALL LINEAR LED STRIP TAPE LIGHT TO BE FED EVERY 16'-0". CONSULT KJF LIGHTING DESIGN FOR WIRING DIAGRAMS.

LIGHT CONTROL SYMBOL LEGEND

- \$ SINGLE POLE SWITCH
- \$ SINGLE POLE JAMB SWITCH
- \$ SINGLE POLE MOTION SWITCH
- \$ SINGLE POLE TIMER SWITCH
- \$ SINGLE POLE DIMMER
- 1/2 SWITCHED DUPLEX RECEPTACLE
- SWITCHED RECESSED CLOCK RECEPTACLE
- 1/2 SWITCHED FLOOR PLUG RECEPTACLE
- REMOTE LOW VOLTAGE TRANSFORMER
- CEILING MOUNTED EXHAUST FAN
- ELECTRIC FIREPLACE IGNITOR
- LIGHTING CONTROL KEYPAD
- LIGHTING CONTROL SWITCH/LEG
- LIGHTING CONTROL ENCLOSURE

KEVIN J.
FLOWER
LIGHTING DESIGN

20650 N. 29th Place Suite 106
PHOENIX, AZ 85050
WWW.KVINJFLOWER.COM
T 602.341.3667

This drawing is an instrument of service and the property of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC. It shall not be reproduced, copied, or published in any form without the written consent of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC.

DRAWN BY:
JOHNNY ANGUIZ

DATE: MARCH 25, 2026

SCALE: AS NOTED

REVISIONS:


- 1
- 2
- 3

RUKAVINA RESIDENCE
5611 E ROAD RUNNER LANE
PARADISE VALLEY, AZ

HILLSIDE
REVIEW


EL 5

SHEET NUMBER:

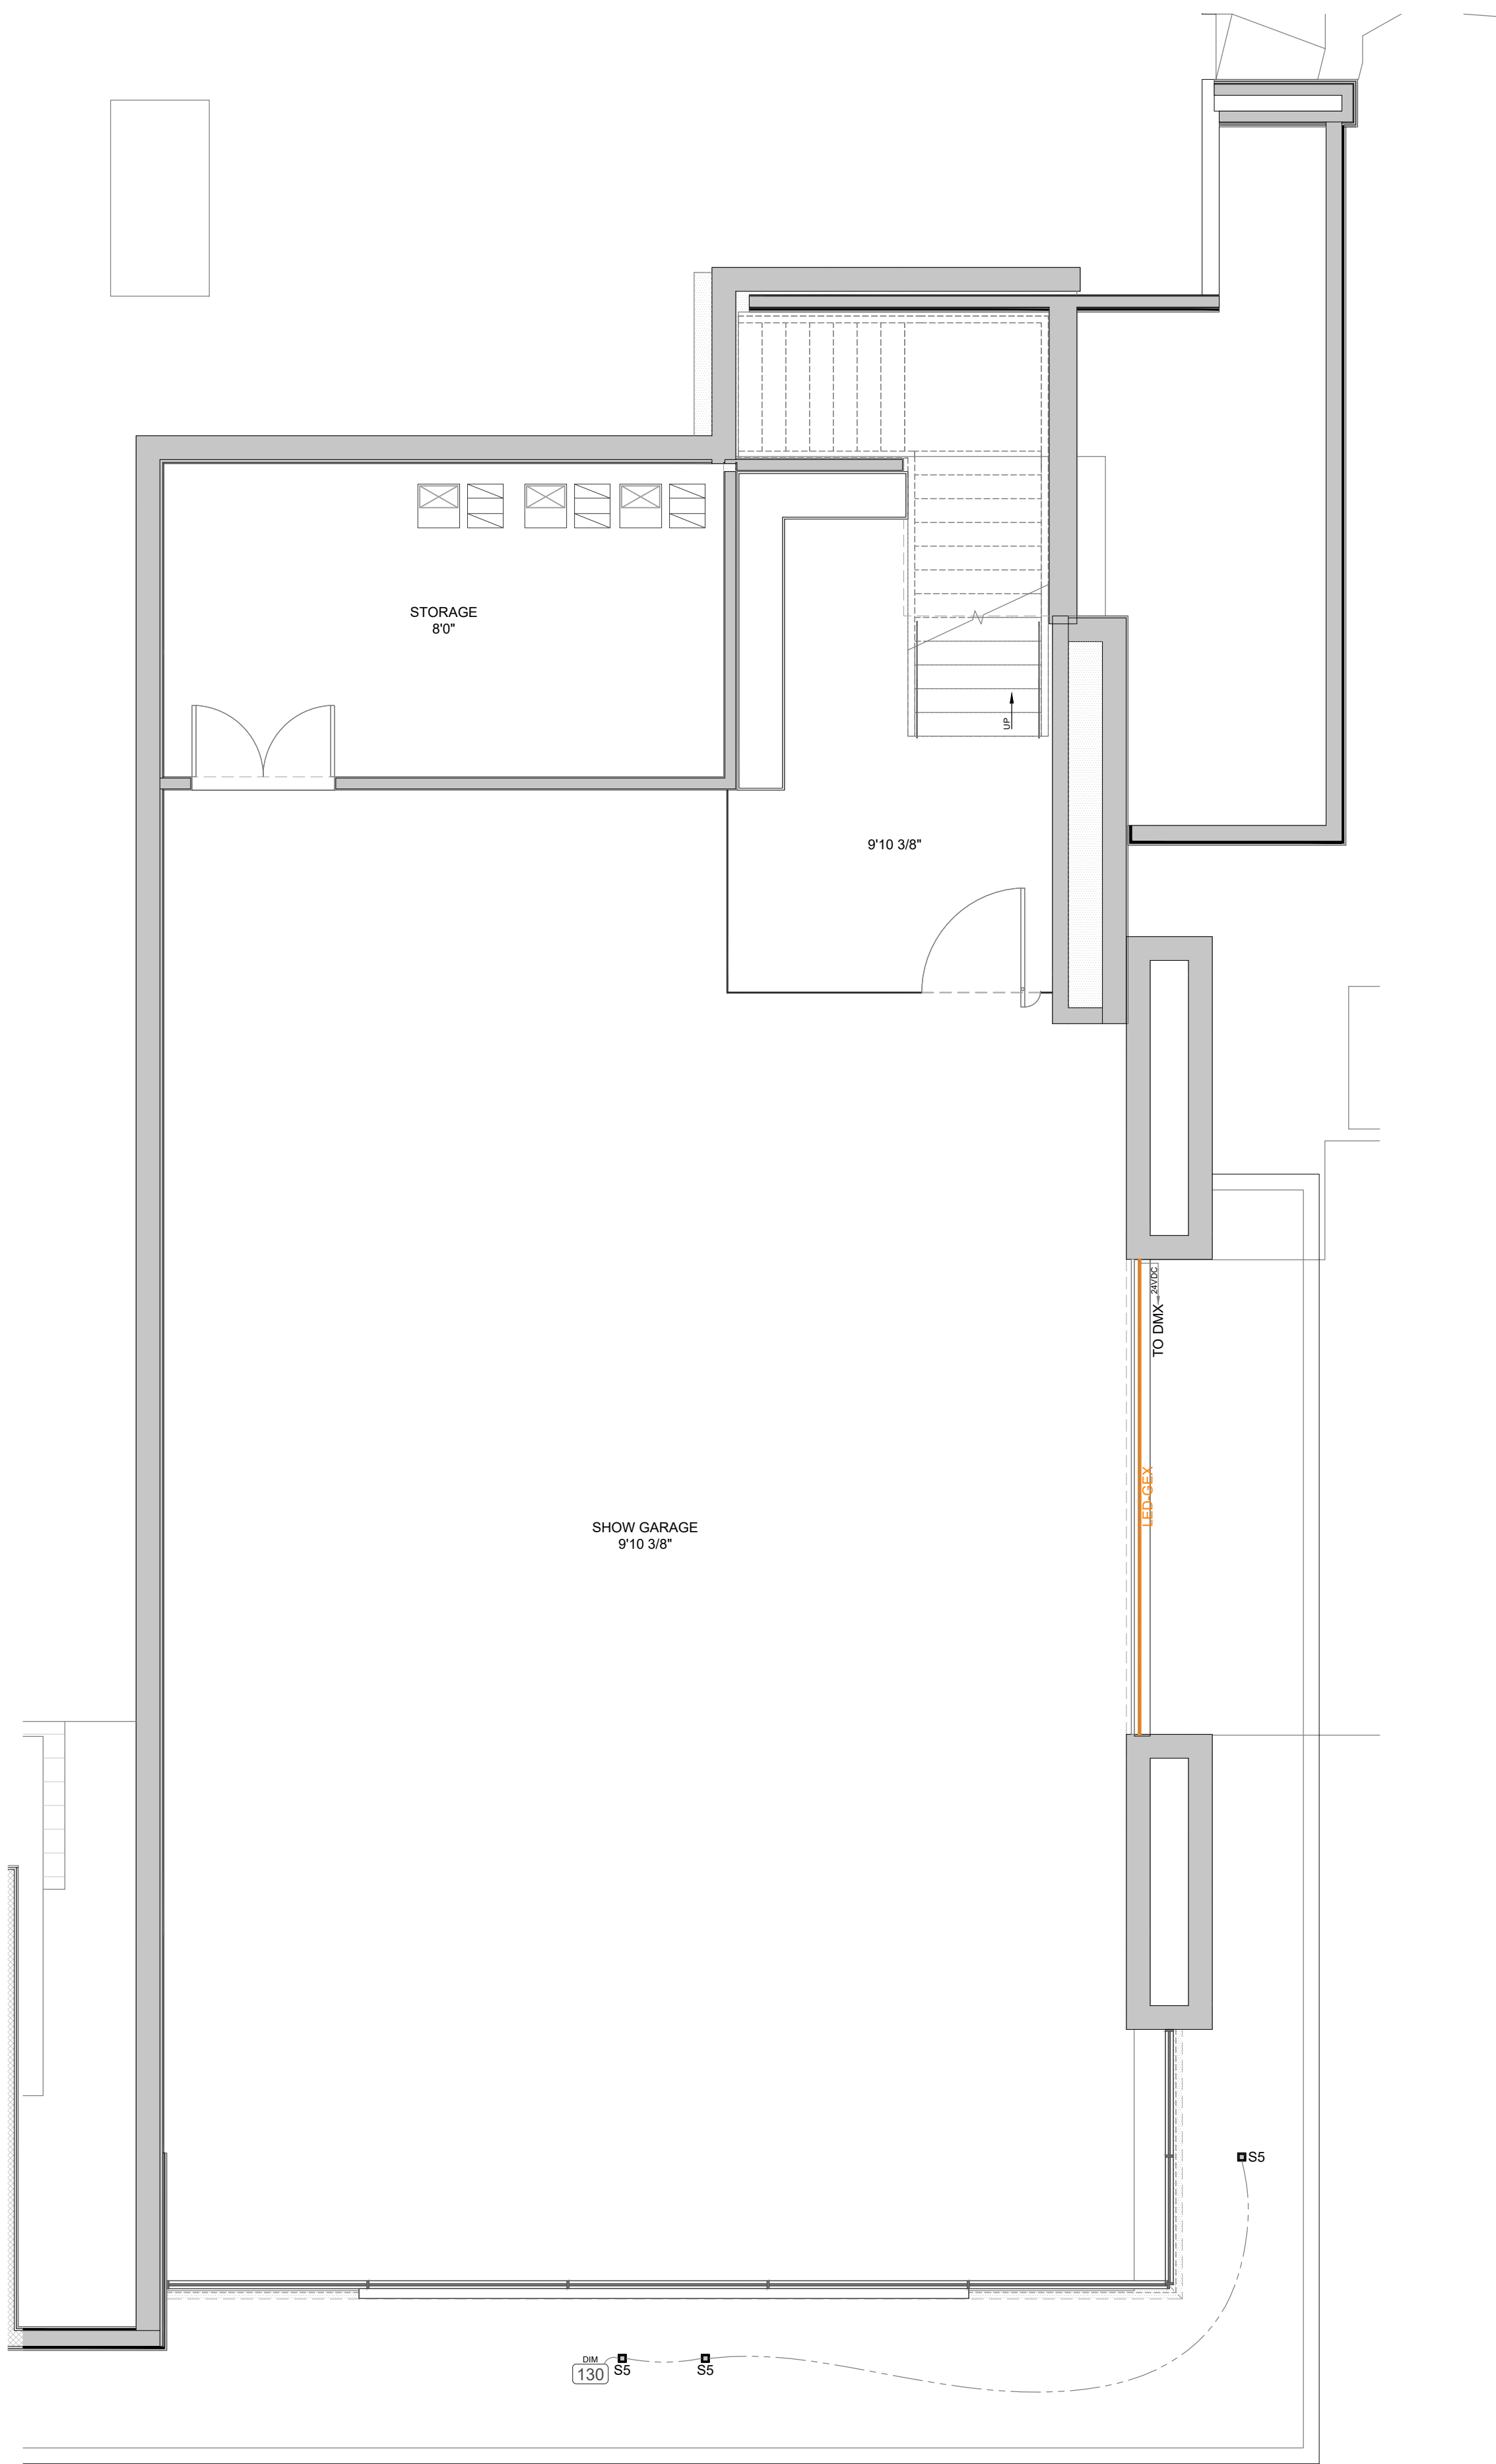

2 LOWER FLOOR PLAN
LIGHTING PLAN

SCALE: 3/16"=1'-0"

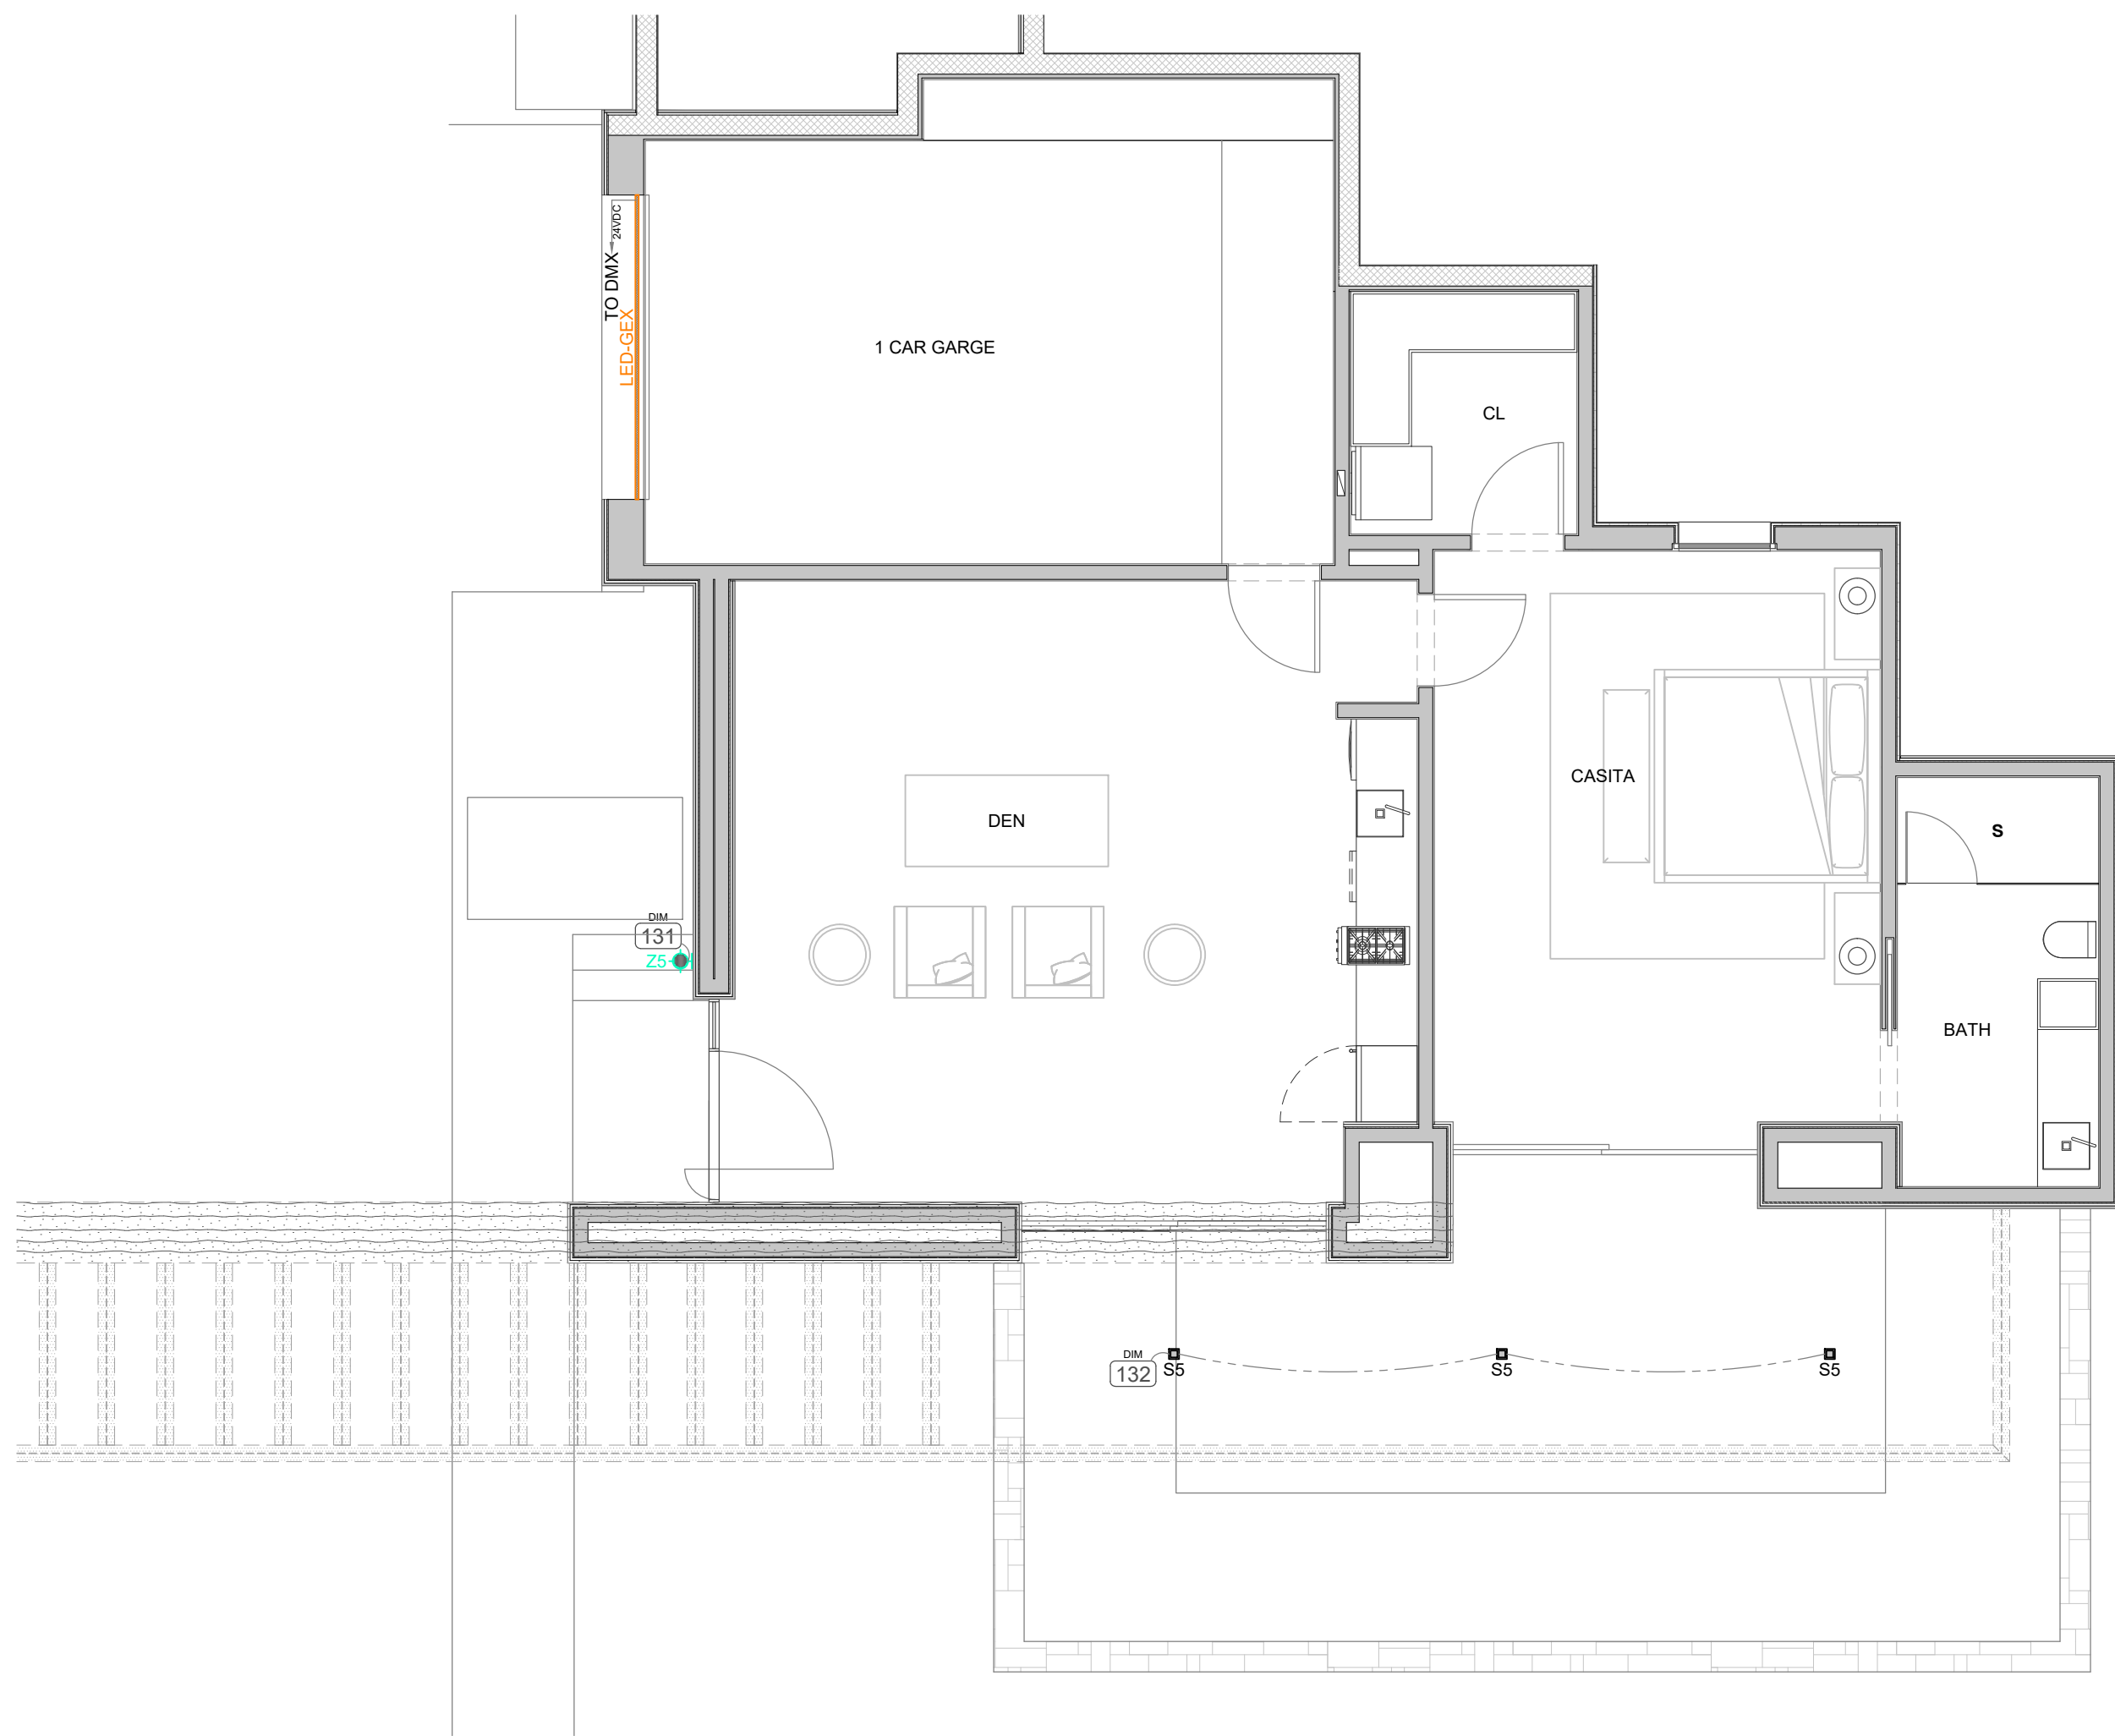

3 GUEST HOUSE FLOOR PLAN
LIGHTING PLAN

SCALE: 3/16"=1'-0"

GENERAL NOTES

1. IT IS THE INTENT OF THESE DRAWINGS TO PROVIDE A COMPREHENSIVE LIGHTING PLAN WHICH SHOWS LIGHT FIXTURE LOCATIONS, FIXTURE SPECIFICATIONS, AND CIRCUITRY FOR THE PURPOSE OF A LICENSED ELECTRICAL CONTRACTOR TO BID AND INSTALL A COMPLETE LIGHTING SYSTEM.
2. THE ELECTRICAL CONTRACTOR SHALL FOLLOW AND ADHERE TO THE CURRENT NATIONAL ELECTRICAL CODE (NEC). IN THE EVENT OF A CONFLICT BETWEEN THIS DRAWING AND THE APPLICABLE CODE, THE CODE SHALL PREVAIL AND THE INSTALLATION SHALL BE MADE IN COMPLIANCE WITH THE CODE.
3. ALL EMERGENCY EGRESS LIGHTING IS THE RESPONSIBILITY OF THE ELECTRICAL ENGINEER OR ELECTRICAL CONTRACTOR.
4. ALL WALL AND FLOOR OUTLETS SHOWN ON LIGHTING PLAN ARE FOR CONTROL OF LIGHTING EQUIPMENT. ALL OTHER OUTLETS AND LOCATIONS ALONG WITH CIRCUIT BREAKER AND/OR DETAILED ELECTRICAL WIRING PLEASE REFER TO THE ELECTRICAL SHEETS.
5. ALL DIMMING CIRCUITS ARE TWO-WIRE UNLESS NOTED DIFFERENTLY. NO COMMON NEUTRALS SHALL BE USED.
6. FIELD PAINT ALL CONDUIT, JUNCTION BOXES, LIGHTING TRIM AND HARDWARE TO MATCH ADJACENT SURFACES.
7. ELECTRICAL CONTRACTOR SHALL VERIFY ALL CEILING TYPES, RECESS CONDITIONS, AND MOUNTING HARDWARE REQUIRED PRIOR TO PURCHASE OF ANY LIGHTING FIXTURES.
8. ELECTRICAL CONTRACTOR SHALL VERIFY MOUNTING HEIGHTS OF ALL DECORATIVE FIXTURES WITH INTERIOR DESIGNER PRIOR TO INSTALLATION.
9. ALL STEP LIGHTS SHALL BE MOUNTED AT +1'-4" A.F.F. TO CENTER OF FIXTURE UNLESS OTHERWISE NOTED.
10. ALL WIRE USED SHALL BE COPPER.
11. IN ORDER TO MAINTAIN THE INTEGRITY OF OUR LIGHTING DESIGN, KJF LIGHTING DESIGN, WILL REQUIRE SITE VISITS DURING ELECTRICAL ROUGH AND ELECTRICAL TRIM STAGES. THE ELECTRICAL CONTRACTOR MAY BE HELD LIABLE FOR EXPENSES INCURRED IN A RESULT OF MOVING LIGHT FIXTURES INSTALLED PRIOR TO CLIENT OR KJF LIGHTING DESIGNS' APPROVAL.
12. THE ELECTRICAL CONTRACTOR SHALL ALLOW TWO EVENINGS (4 HOUR MINIMUM EACH) AND PROVIDE ALL NECESSARY LADDERS AND MAN LIFTS TO ASSIST KJF LIGHTING DESIGN DURING THE FINAL AIM AND FOCUS OF ALL ADJUSTABLE LIGHTING FIXTURES.
13. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR TO REVIEW ALL INFORMATION ON THESE PLANS. IF THERE ARE ERRORS, OMISSIONS, OR QUESTIONS CONCERNING THESE PLANS PLEASE CONTACT KJF LIGHTING DESIGN - 602-448-5007 FOR CLARIFICATION.

PROJECT NOTES

1. ALL PERMANENTLY INSTALLED LIGHTING FIXTURES SHALL CONTAIN ONLY HIGH-EFFICACY LAMPS. (N1104.1)
2. ALL PERMANENTLY INSTALLED INTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED WITH EITHER A DIMMER, AN OCCUPANT SENSOR CONTROL OR OTHER CONTROL SUCH AS AN AUTOMATIC TIMER SHUT-OFF SWITCH. EXCEPTIONS INCLUDE BATHROOMS AND HALLWAYS. (N1104.2)
3. EXTERIOR LIGHTING OVER 30 WATTS SHALL INCLUDE AN AUTOMATIC SHUT-OFF. (N1104.3)
4. RECESSED LUMINARIES INSTALLED IN THE BUILDING THERMAL ENVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES. ALL RECESSED LUMINARIES SHALL BE IC-RATED AND LABELED AS HAVING AN AIR LEAKAGE RATE NOT MORE THAN 2.0 CFM. ALL RECESSED LUMINARIES SHALL BE SEALED WITH A GASKET OR CAULK BETWEEN THE HOUSING AND THE INTERIOR WALL OR CEILING COVERING. (N1102.4.4)
5. FIXTURES LOCATED IN DAMP OR WET LOCATIONS SUCH AS SHOWER/TUB AREA AND FIXTURED/LIGHTS INSTALLED OUTSIDE SHALL BE "LISTED" TO BE SUITABLE FOR DAMP / WET LOCATION.
6. ALL LINEAR LED STRIP TAPE LIGHT TO BE FED EVERY 16'-0". CONSULT KJF LIGHTING DESIGN FOR WIRING DIAGRAMS

LIGHT CONTROL SYMBOL LEGEND

- S SINGLE POLE SWITCH
- S' SINGLE POLE JAMB SWITCH
- S^M SINGLE POLE MOTION SWITCH
- S^T SINGLE POLE TIMER SWITCH
- D SINGLE POLE DIMMER
- 1/2 SWITCHED DUPLEX RECEPTACLE
- SW SWITCHED RECESSED CLOCK RECEPTACLE
- FP 1/2 SWITCHED FLOOR PLUG RECEPTACLE
- TF REMOTE LOW VOLTAGE TRANSFORMER
- CEILING MOUNTED EXHAUST FAN
- ELECTRIC FIREPLACE IGNITOR
- LIGHTING CONTROL KEYPAD
- XXXX LIGHTING CONTROL SWITCHLEG
- LIGHTING CONTROL ENCLOSURE

KEVIN J.
FLOWER
LIGHTING DESIGN

20650 N. 29th Place Suite 106
PHOENIX, AZ 85050
WWW.KVINJFLOWER.COM
T 602.341.3667

This drawing is an instrument of service and the property of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC. It shall not be reproduced, copied, or published by any method in whole or in part without the written consent of Flower Holdings, LLC. It shall remain the property of Flower Holdings, LLC.

DRAWN BY:
JOHNNY ANGUIZ

DATE: MARCH 25, 2026

SCALE: AS NOTED

REVISIONS:

- 1
- 2
- 3

RUKAVINA RESIDENCE
5611 E ROAD RUNNER LANE
PARADISE VALLEY, AZ

HILLSIDE
REVIEW

EL 6

SHEET NUMBER:

Lighting Fixture Schedule

Project: 5611 E Road Runner

TYPE LED-GEX

NeoVisionMini 24VDC Neon LED Tape Specification Sheet		GMLighting® 24VDC Neon LED Tape		
ORDERING INFORMATION		Example: NVM24S-2W-27K-16		
Catalog No.	Watts/Ft Max.	Color Temp	Lumens/Ft	Max. Run
NVM24S-2W-27K-16	2W	2700K	70 Lm	16 ft 4 in
NVM24S-2W-30K-16	2W	3000K	68 Lm	16 ft 4 in
NVM24S-2W-40K-16	2W	4000K	59 Lm	16 ft 4 in
NVM24S-2W-AM-16	2W	Amber (590nm pk)	59 Lm	16 ft 4 in
NVM24S-2W-BL-16	2W	Blue (470nm pk)	13 lm	16 ft 4 in
NVM24S-2W-GR-16	2W	Green (519nm pk)	59 Lm	16 ft 4 in
NVM24S-2W-OR-16	2W	Orange (610nm pk)	15 lm	16 ft 4 in
NVM24S-2W-RD-16	2W	Red (630nm pk)	7 lm	16 ft 4 in
ACCESSORIES				
Catalog No.	Description			
NVM24S-EC	End Cap, Molded Silicone (sealant not included)			
NVM24S-MC-A	Back Mounting Clips, Aluminum (20 clips, 20 SS screws)			
NVM24S-CHL-4A	Rigid Channel, Aluminum, 4ft			
NVM24S-FLEX-CHL	Flexible Channel, Stainless Steel, 1m 105 holes & screws			
TAPE-DS-VHB-4MMW	4mm wide x 6m VHB tape			
TOOL-PHO-HEX	PH0 Phillips head, 1/4" hex drive bit			
TOOL-PHO-HEX		NVM24S-MC-A		
TOOL-PHO-HEX		NVM24S-CHL-4A		

NOVA REMOTE GRAZER, STATIC WHITE & WARM DIM

24VDC WALL FRAZER, STAIN WHITE & WARM DIM

PURE EDGE
Pure Smart Lighting

Wi-Fi PRO

REV:04.25

Lamp Data: Lamp data for Nova Ceiling Wall Grazer

BASIC												
20 Degree Wall Grazer Lens without Lens												
DESCRIPTION	Size (4 x 6 inch)						7x (7 x 2 inch)					
BEDS PER FOOT	156	276	215P	306	306P	436	406	216	306	436	246	336
COR-AL TEMPERATURE	274	278	279	280	283	283	277	476	488	523	628	628
LUMENS PER FOOT (lm/ft)	62	83	67	65	67	76	79	65	68	76	83	84
CR	90+	90+	90+	90+	90+	90+	88+	90+	88+	88+	88+	88+
BASIC												
20 Degree Wall Grazer Lens with Lens												
BEDS PER FOOT	Size (4 x 6 inch)						7x (7 x 2 inch)					
COR-AL TEMPERATURE	156	276	215P	306	306P	436	406	216	306	436	246	336
LUMENS PER FOOT (lm/ft)	170	171	120	120	265	214	208	308	265	214	382	382
CR	90+	90+	90+	90+	90+	90+	88+	90+	88+	88+	88+	88+
BASIC												
20 Degree Wall Grazer Lens with Black Lens												
BEDS PER FOOT	Size (4 x 6 inch)						7x (7 x 2 inch)					
COR-AL TEMPERATURE	156	276	215P	306	306P	436	406	216	306	436	246	336
LUMENS PER FOOT (lm/ft)	120	122	122	122	142	140	210	210	210	210	210	210
CR	90+	90+	90+	90+	90+	90+	88+	90+	88+	88+	88+	88+

*CR: 30+ - Near Dim (4.0kK)

30K 20° 7W CLEAR LENS			
DISTANCE	BEAM	FOOT CANDLE	
13in	3in	342FC	
18in	3in	218FC	
24in	4in	173FC	
36in	5in	114FC	

30K 20° 10W CLEAR LENS			
DISTANCE	BEAM	FOOT CANDLE	
13in	3in	686FC	
18in	3in	342FC	
24in	4in	214FC	
36in	5in	135FC	

PROJECT	EXTURE TYPE	DATE
---------	-------------	------

www.PureEdgeLighting.com | Phone: 773.700.1195 | 1718 W. Fullerton Ave, Chicago, IL 60614

For custom design and layout assistance, send drawings to design@PureEdgeLighting.com

2

TYPE S5

Artafex
4" Square Adjustable

PRODUCT BUILDER

M SERIES HOUSING

EXAMPLE: M4NCB8

PRODUCT CODE	APPLICATION	SHAPE	RATING
 M4		 Square	 Blank
M4 4" Housing	MC New Construction MS Super Shallow ^{1,2} CP Chicago Plenum ¹ LT Low Profile, TRAC/ELV (8" Plenum) RM Remodel ³ SF Spray Foam ¹	8 Square	8 Standard F Fire Rated

¹ Only available in Standard rating

² Only compatible with Flanged trim

ARTAFEX 4" ADJUSTABLE MODULE

EXAMPLE: ART4AG7T2H8T

PRODUCT CODE	LUMENS	METRIC	CCT	BEAM SPREAD	FINISH	DIMMING
 ART4A		 T				
ART4A Adjustable	07 750 lm 10 1000 lm	T True Spectrum ³	27 2700K 30 3000K 35 3500K 40 4000K 5W Warm Dim ³ (3000K-1800K) T1 Tunable White ³ (4000K-1800K)	NS Narrow Spot (10°) ¹ SP Spot (25°) FL Flood (40°) LS Linear Spread (90° x30°) SF Soft Focus ⁵ NW Narrow Spot w/ Flex Louver ² BH Spot w/ Flex Louver ⁵ PH Flood w/ Flex Louver ⁵	Blank Black T TRAC/ELV W White D DALI-2 ⁴	

¹ Only available in 1000 lm

² Only available in 750 lm for DALI-2

³ Not available in Warm Dim or Tunable White

⁴ Only available in 750W Basic CCT with TRAC Dimming and available with 10W to 180W

¹ Not available in Warm Dim, Tunable White, or DALI-2

² Not available for DALI-2

³ Only available in 750W Tunable White, and 1000 lm Warm Dim or DALI CCT

M SERIES TRIM & ACCESSORY

EXAMPLE: M1TSQWH

PRODUCT CODE	FINISH	OPTION
		
M1TSQ Round on Square	WH White	Blank ¹ None
M1TSP Pinhole ¹	BK Black BZ Bronze ¹¹ CD Clear Diffuse ¹¹ CC Custom Color (RAL Colors)	FL ¹ Recessless ^{11,12}

MAXREMUD Flangeless Mud Plug¹ (required for flangeless drywall application)

MAXTEMPPLATE Wood Template¹ (recommended for flangeless rim-weld installation)

¹ Only available in white or Black Finish

² Recess is available for both round on square and round on square Flangeless;

Clear Diffuse is available for round on square only (not Flangeless)

¹¹ Mud plug is required for all PL Trim except for recess ceiling applications;

Not compatible with Remodel, Spray Foam or Super Shallow housing

DMF LIGHTING 1118 E. 223rd St. Caron, CA 90745 323.934.7779 info@dmf-lighting.com dmf.luxury.com

© 2019 DMF Lighting. All Rights Reserved. Specifications subject to change without notice. See website for U.S. and International patent information.

Page 2 of 13

dmf

Artaflex
 4" Square Adjustable

TRIMS

M Series

4" Square Trims

M4TS

SUMMARY

CONSTRUCTION: Die-cast aluminum

INSTALLATION: Twist & Lock

Round On Square

M4TSQWH

Round On Square Flangeless

M4TSQWHFL

Pinhole

M4TSPWH

Pinhole Flangeless

M4TSPWHFL

DMF LIGHTING | 1118 E. 223rd St. Carson, CA 90745 | 323.634.7770 | info@dmflighting.com | dmfLuxury.com
 © 2025 DMF Lighting. All Rights Reserved. Specifications subject to change without notice. See website for U.S. and International patent information.

Page 9 of 13

20650 N. 29th Place Suite 106
PHOENIX, AZ 85050
WWW.KEVINJFLOWER.COM
T 602.341.3667

This drawing is an instrument of service and the property of Flower Holdings, LLC dba Kevin J Flower Lighting Design and shall remain their property. Reuse, reproduction, or publication by any method in whole or in part is prohibited without their written consent. Any questions or concerns contact Flower Holdings, LLC dba Kevin J Flower Lighting Design.

JOHNNY ANGUIZ

REVISIONS:



3

8. ELECTRICAL CONTRACTOR SHALL VERIFY MOUNTING HEIGHTS OF ALL DECORATIVE FIXTURES WITH INTERIOR DESIGNER PRIOR TO INSTALLATION.
9. ALL STEP LIGHTS SHALL BE MOUNTED AT +1'-6" A.F.F. TO RESULT OF FIXTURE UNLESS OTHERWISE NOTED.
10. ALL WIRE USED SHALL BE COPPER
11. IN ORDER TO MAINTAIN THE INTEGRITY OF OUR LIGHTING DESIGN, KJF LIGHTING DESIGN, WILL BE REQUIRED TO PROVIDE ELECTRICAL ROUGH AND ELECTRICAL TRIM STAGES. THE ELECTRICAL CONTRACTOR MAY BE HELD LIABLE FOR EXPENSES INCURRED AS A RESULT OF MOVING LIGHT FIXTURES INSTALLED PRIOR TO CLIENT OR KJF LIGHTING DESIGN'S APPROVAL.
12. THE ELECTRICAL CONTRACTOR SHALL ALLOW TWO EVENINGS (4 HOUR MINIMUM EACH) AND ONE DAY TO COMPLETE ALL ELECTRICAL WORK TO ASSIST KJF LIGHTING DESIGN DURING THE FINAL AIM AND FOCUS OF ALL ADJUSTABLE LIGHTING FIXTURES.
13. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND THE ELECTRICAL CONTRACTOR TO REVIEW ALL INFORMATION ON THESE PLANS. IF THERE ARE ERRORS, OMISSIONS, OR QUESTIONS REGARDING THE LIGHTING DESIGN, CONTACT KJF LIGHTING DESIGN - 602.448.5007 FOR CLARIFICATION.

2. ALL PERMANENTLY INSTALLED INTERIOR LIGHTING

5. FIXTURES LOCATED IN DAMP OR WET LOCATIONS SUCH AS SHOWER/TUB AREA AND FIXTURED/LIGHTS INSTALLED OUTSIDE SHALL BE "LISTED" TO BE SUITABLE FOR DAMP / WET LOCATION.

6. ALL LINEAR LED STRIP TAPE LIGHT TO BE FED EVERY 16'-0". CONSULT KJF LIGHTING DESIGN FOR WIRING DIAGRAMS

NOTICE CONCERNING CHANGES TO TERMS

 SINGLE POLE SWITCH

\$ SINGLE POLE JAMB SWITCH

\$^{MD} SINGLE POLE MOTION SWITCH

\$^T

Q SINGLE POLE DIMMER

 1/2 SWITCHED DUPLEX RECEPTACLE

 SWITCHED RECESSED CLOCK RECEPTACLE

 1/2 SWITCHED FLOOR PLUG RECEPTACLE
 REMOTE LOW VOLTAGE TRANSFORMER


 CEILING MOUNTED EXHAUST FAN

 ELECTRIC FIREPLACE IGNITOR



 LIGHTING CONTROL KEYPAD
 LIGHTING CONTROL SWITCHLEG

LIGHTING CONTROL ENCLOSURE

HILLSIDE REVIEW

REVIEW

RUKAVINA RESIDENCE
 5611 E ROAD RUNNER LANE
 PARADISE VALLEY, AZ

HILLSIDE REVIEW

EL 7

- ROADRUNNER RESIDENCE -

- 5611 E. Roadrunner Ln. Paradise Valley, AZ. 85253 -
- Landscape Construction Documents -

GENERAL NOTES:

- THESE CONSTRUCTION DOCUMENTS, INCLUDING ALL PLANS, NOTES, DETAILS, AND SPECIFICATIONS ARE INTENDED TO FACILITATE THE INSTALLATION CONTRACTOR BY PROVIDING GENERAL GUIDELINES FOR DESIGN INTENT. IT IS THE GOAL OF THE DOCUMENTS THAT THE WORK IS TO BE COMPLETED WITHOUT CHANGE ORDERS. ALL QUANTITIES SHOWN IN THE DOCUMENTS ARE ESTIMATES ONLY AND ARE NOT GUARANTEED; THE CONTRACTOR SHALL SUPPLY ALL MATERIALS, LABOR AND EQUIPMENT IN ORDER TO FULFILL THE INTENT OF THE DESIGN DRAWINGS.
- INTERPRETATION OF THE PLANS AND SPECIFICATIONS SHALL BE MADE BY THE "AUTHOR" OR "ARCHITECT/ENGINEER-OF-RECORD" OF THE RESPECTIVE DOCUMENT AND SHALL BE CONSIDERED FINAL. ANY POSSIBLE AMBIGUITY SHALL BE SUBMITTED IN WRITING BY THE CONTRACTOR PRIOR TO SUBMITTING FORMAL BIDS. ALL CLARIFICATIONS SHALL BE PREPARED IN WRITING BY THE "ARCHITECT/ENGINEER-OF-RECORD" PRIOR TO BIDDING. THE CONTRACTOR SHALL ACCEPT THE INTERPRETATION OF THE "ARCHITECT/ENGINEER-OF-RECORD" AS THE CORRECT AND FINAL INTERPRETATION.
- ANY INCIDENTAL INSTALLATION PROCEDURE, MATERIAL OR EQUIPMENT, NOT MENTIONED IN THESE CONSTRUCTION DOCUMENTS, THE SPECIFICATIONS NOR SHOWN ON THE PLANS, WHICH MAY BE NECESSARY FOR COMPLETION AND SATISFACTORY OPERATION OF THE DESIGN SYSTEM SHALL BE FURNISHED AND INSTALLED (AS BASED ON INDUSTRY STANDARDS) AS THOUGH SHOWN OR PROVIDED FOR.
- EXISTING CONDITIONS AND BASE INFORMATION ARE BASED ON PLANS PREPARED BY THE ARCHITECT.
- THE CONTRACTOR SHALL BECOME FAMILIAR WITH THE LOCATIONS OF EXISTING AND FUTURE UNDERGROUND SERVICES AND IMPROVEMENTS WHICH MAY CONFLICT WITH THE WORK TO BE DONE. NOTIFY THE OWNER'S AUTHORIZED REPRESENTATIVE IMMEDIATELY SHOULD A CONFLICT ARISE.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR SECURING ALL NECESSARY PERMITS AND SHALL NOTIFY ALL UTILITY COMPANIES WITH UTILITIES ON SITE PRIOR TO THE CONSTRUCTION OF THE PROJECT.
- FOR UNDERGROUND UTILITY COORDINATION AND 48 HOURS PRIOR TO START OF CONSTRUCTION (DEPENDING ON AREA OR JURISDICTION), THE CONTRACTOR SHALL CONTACT:
A) BLUE STAKE (ARIZONA) 1-800-782-5348
B) UNDERGROUND SERVICES ALERT (USA) 1-800-227-2600
- THESE NOTES ARE TO BE USED FOR GENERAL REFERENCE IN CONJUNCTION WITH AND AS A SUPPLEMENT TO THE WRITTEN SPECIFICATIONS, APPROVED ADDENDUMS, AND THE CHANGE ORDERS AS ASSOCIATED WITH THESE CONSTRUCTION DOCUMENTS.
- SHOULD THE CONTRACTOR HAVE ANY QUESTIONS REGARDING THESE CONSTRUCTION DOCUMENTS OR SHOULD THERE BE ANY DISCREPANCIES, HE SHALL CONTACT THE LANDSCAPE ARCHITECT FOR CLARIFICATION BEFORE PROCEEDING FURTHER.
- ALL WORK SHALL CONFORM TO THE CONTRACT DOCUMENTS AND PER GOVERNING CODES AND/OR ORDINANCES.
- THE CONTRACTOR SHALL PROVIDE BARRICADES AND TRAFFIC CONTROL ALONG PUBLIC STREETS, IF REQUIRED, DURING INSTALLATION.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO REPORT TO THE LANDSCAPE ARCHITECT AND/OR THE OWNER'S AUTHORIZED REPRESENTATIVE ANY DISCREPANCIES BETWEEN THE CONSTRUCTION DOCUMENTS AND FIELD CONDITIONS PRIOR TO THE START OF WORK.
- BEFORE WORK BEGINS ON THE PROJECT, THE CONTRACTOR SHALL REVIEW THE PROJECT WITH THE LANDSCAPE ARCHITECT AND/OR THE OWNER'S AUTHORIZED REPRESENTATIVE.
- THE LANDSCAPE ARCHITECT AND/OR THE OWNER'S AUTHORIZED REPRESENTATIVE SHALL APPROVE ANY OR ALL CHANGES PRIOR TO THE START OF WORK.
- THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING AND COORDINATING EXISTING SITE CONDITIONS.
- THE CONTRACTOR SHALL ADHERE TO ALL APPLICABLE LOCAL, STATE, AND/OR FEDERAL LAWS AND/OR REGULATIONS PERTAINING TO THE PROJECT.
- THE CONTRACTOR SHALL PROPERLY COORDINATE HIS WORK WITH OTHER CONTRACTOR'S WORK PRIOR TO INSTALLATION.
- THE CONTRACTOR SHALL TAKE PRECAUTIONARY MEASURES TO PROTECT EXISTING IMPROVEMENTS AND THE PUBLIC FROM DAMAGE THROUGHOUT CONSTRUCTION.
- THE CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ANY DAMAGES IMPOSED, UNINTENTIONALLY OR ACCIDENTALLY TO EXISTING UTILITIES, STRUCTURES, WALLS, OR OTHER AMENITIES, DUE TO THE ACTION OF THE CONTRACTOR, CONTRACTOR EMPLOYEES, AND/OR THE CONTRACTOR'S SUBCONTRACTORS. DAMAGE OCCURRED DURING THE CONTRACTOR'S OPERATION SHALL BE REPAIRED, AT THE EXPENSE OF THE CONTRACTOR, TO THE SATISFACTION OF THE OWNER'S AUTHORIZED REPRESENTATIVE.
- MATCH GRADES, LAYOUT AND ELEVATIONS OF ADJOINING LANDSCAPE WORK BY OTHERS. NOTIFY THE LANDSCAPE ARCHITECT OF CONFLICTS BEFORE PROCEEDING WITH CONSTRUCTION.

PLANTING GENERAL NOTES:

- THE CONTRACTOR SHALL REVIEW PLANTING PLAN WITH LANDSCAPE ARCHITECT PRIOR TO INSTALLATION.
- THE LANDSCAPE ARCHITECT OR HIS REPRESENTATIVE RESERVES THE RIGHT TO REFUSE ANY PLANT MATERIALS HE DEEMS UNACCEPTABLE. SEE SPECIFICATIONS.
- THE CONTRACTOR SHALL SUPPLY AND INSTALL ALL PLANT MATERIAL AS SPECIFIED ON THE PLANTING PLANS, HOWEVER, SHOULD THE PLANT MATERIAL BE TEMPORARILY UNAVAILABLE, THE CONTRACTOR SHALL NOTIFY THE LANDSCAPE ARCHITECT AND INSTALL 5 GALLON NURSERY BUCKETS WITH IRRIGATION AT EACH PLANT LOCATION. AS THE PLANT MATERIAL BECOMES AVAILABLE, THE 5 GALLON BUCKETS SHALL BE REMOVED AND PLANT MATERIAL INSTALLED.
- ANY AND ALL SUBSTITUTIONS TO BE APPROVED BY THE LANDSCAPE ARCHITECT.
- LOCATE PLANTS AWAY FROM SPRINKLER HEADS, LIGHT FIXTURES AND OTHER OBSTRUCTIONS.
- FINAL LOCATION OF ALL PLANT MATERIAL SHALL BE SUBJECT TO THE APPROVAL OF THE OWNER'S AUTHORIZED REPRESENTATIVE.
- PLANTING AND IRRIGATION DESIGNING MAY BE MODIFIED TO ADAPT TO WALK CONFIGURATIONS THAT DIFFER FROM THESE PLANS, OR BECAUSE OF GRADE LIMITATIONS ON SITE OR CONTRACTOR'S SUBCONTRACTORS.
- WATER TEST ALL TREE PLANTING HOLES PRIOR TO PLANTING. IF TREE HOLE DOES NOT DRAIN, DO NOT PLANT. SEE HARDPAN DETAIL.
- REFER TO THE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS NOT SHOWN ON DRAWINGS.
- TREES SHALL BE PLANTED A MINIMUM OF 10'-0" FROM STREET LIGHTS / FIRE HYDRANTS, 6'-0" FROM EDGE OF UNDERGROUND PIPELINES AND A MINIMUM OF 4'-0" FROM WALKS, CURBS AND WALLS. SHRUBS SHALL BE PLANTED A MINIMUM OF 2'-0" FROM CURB AND WALKS.
- ALL SPECIMEN TREES, SHRUBS AND CACTI SHALL BE FIELD LOCATED BY LANDSCAPE ARCHITECT OR OWNER'S AUTHORIZED REPRESENTATIVE.
- THE CONTRACTOR SHALL INSTALL "SHAWTOWN ROOT BARRIER PANELS" (OR APPROVED EQUAL) AT ALL TREES WITHIN 7'-0" FEET OF HARDSCAPE ELEMENTS INCLUDING (BUT NOT LIMITED TO) SIDEWALKS, ASPHALT, CONCRETE SLABS / FOOTINGS AND STRUCTURES. CONTRACTOR SHALL SUBMIT SPECIFICATION SHEETS OF PROPOSED ROOT BARRIER PANELS TO THE LANDSCAPE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION.
- THE CONTRACTOR SHALL INSTALL ARBOR GUARDS AT ALL TREES LOCATED IN TURF AREAS.
- ON-SITE AND OFF-SITE TOPSOIL SHALL CONFORM TO CONTENT REQUIREMENTS AS SPECIFIED IN PART 2 OF THE PLANTING SPECIFICATIONS. AGRONOMY TEST SUBMITTALS ARE REQUIRED FOR ALL MATERIAL USED FOR TOPSOIL AND BACKFILL. SUBMIT REPORT TO LANDSCAPE ARCHITECT FOR REVIEW.
- ALL PLANT MATERIAL SHALL BE IN COMPLIANCE WITH THE AMERICAN STANDARDS FOR NURSERY STOCK, LATEST EDITION.
- THE CONTRACTOR SHALL PROVIDE MAINTENANCE FOR ALL ALL PLANT MATERIAL FROM THE TIME OF INSTALLATION THROUGH SUBSTANTIAL COMPLETION.
- CACTI SHALL BE PLANTED A MINIMUM OF 3'-0" AWAY FROM ALL PEDESTRIAN ROUTES.
- CACTI SHALL BE WELL ROOTED AND NON-SCARRED.
- PLANT MATERIAL MARKED 'SALVAGE' SHALL BE SELECTED FROM ON-SITE SALVAGE INVENTORY. ALL MATERIAL SELECTIONS SHALL BE APPROVED BY LANDSCAPE ARCHITECT AND/OR OWNER'S AUTHORIZED REPRESENTATIVE.
- IN DISTURBED AREAS INDICATED TO RECEIVE REVEGETATION HYDROSEED AND/OR PLANTING, THE CONTRACTOR SHALL MATCH EXISTING NATURAL DESERT STONE GROUND COVER CONDITIONS ADJACENT TO THE PROJECT.
- NATIVE REVEGETATION AREAS AND PLANTER BEDS SHALL BE TREATED WITH PRE-EMERGENT AS PER MANUFACTURER'S INSTRUCTIONS, RE-APPLY AS NECESSARY TO ELIMINATE INVASIVE WEEDS, REMOVE ALL DEAD DEBRIS.
- THE CONTRACTOR SHALL PROVIDE A 50'-0" BY 50'-0" TYPICAL MOCK-UP OF NATIVE REVEGETATION AREAS FOR REVIEW BY THE LANDSCAPE ARCHITECT OR OWNER'S AUTHORIZED REPRESENTATIVE.
- ALL TREE STAKING SHALL CONFORM TO THE PLANTING DETAILS OR AS NOTED IN THE SPECIFICATIONS. THE LANDSCAPE ARCHITECT OR OWNER'S AUTHORIZED REPRESENTATIVE SHALL REVIEW TYPICAL TREE STAKING PRIOR TO FINAL ACCEPTANCE.

INERT GENERAL NOTES:

ANGULAR GRANITE RIP-RAP

- INSTALL GRANITE RIP-RAP IN ALL DRAINAGE SWALES, AND WHERE INDICATED ON PLANS (TYPICAL). REFER TO MATERIALS SCHEDULE / PLANTING LEGEND FOR COLOR AND SIZE OF GRANITE RIP-RAP.
- THE CONTRACTOR SHALL SUBMIT SAMPLES TO LANDSCAPE ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.
- THE CONTRACTOR SHALL REFER TO CIVIL PLANS FOR ADDITIONAL INFORMATION.

DECOMPOSED GRANITE

- DECOMPOSED GRANITE IS REQUIRED IN ALL PLANTING AREAS, EXCEPT AREAS OF TURF AND GRANITE RIP-RAP, AND SHALL EXTEND UNDER PLANT MATERIAL UNLESS NOTED OTHERWISE ON PLANS. REFER TO MATERIALS SCHEDULE / PLANTING LEGEND.
- ALL PLANTING AREAS SHALL RECEIVE A 2" MINIMUM LAYER OF DECOMPOSED GRANITE, THROUGHOUT (TYPICAL).
- CONTRACTOR SHALL SUBMIT SAMPLES TO LANDSCAPE ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.

IRRIGATION GENERAL NOTES:


- THE LANDSCAPE CONTRACTOR IS RESPONSIBLE FOR FULL IRRIGATION COVERAGE OF ALL PLANT MATERIAL.
- THE LANDSCAPE CONTRACTOR SHALL SUBMIT FULL PIPING PLANS, AFTER FIELD VERIFICATION, DEPICTING POINT OF CONNECTION, METER LOCATION AND SIZE, BACKFLOW PREVENTER LOCATION AND SIZE, AND PIPE ROUTING AND SIZES.
- THE LANDSCAPE CONTRACTOR SHALL INSTALL THE SPECIFIED SYSTEM IN ACCORDANCE WITH THE ATTACHED SCHEDULES, NOTES, DETAILS, AND SPECIFICATIONS.
- THE LANDSCAPE CONTRACTOR TO SITE VERIFY PRESSURE AND NOTIFY LANDSCAPE ARCHITECT OF ANY DIFFERENCES PRIOR TO INSTALLATION OR ORDERING OF MATERIALS. IF CONTRACTOR FAILS TO NOTIFY LANDSCAPE ARCHITECT, HE IS FINANCIALLY RESPONSIBLE FOR ANY NECESSARY SYSTEM ALTERATIONS THAT RESULT.
- THE LANDSCAPE CONTRACTOR SHALL FIELD VERIFY EXISTING TAP LOCATIONS. INSTALL NEW METERS PER THE ATTACHED IRRIGATION SCHEDULE.
- THE LANDSCAPE CONTRACTOR SHALL BE RESPONSIBLE FOR CUTTING AND PATCHING OF ASPHALT AND CONCRETE AS REQUIRED FOR SLEEVE INSTALLATION ACCORDING TO THE IRRIGATION SCHEDULE.
- CONTROLLER TO BE INSTALLED AS PER MANUFACTURER'S SPECIFICATIONS. CONTROLLER SIZE AND QUANTITIES TO BE DETERMINED BY THE VALVE REQUIREMENTS AND POINTS OF CONNECTION. INSTALL ONE (1) CONTROLLER AT EACH POINT OF CONNECTION.
- INSTALL PVC MAINLINE AND LATERALS ACCORDING TO THE IRRIGATION AND PIPING SCHEDULES.
- ALL VALVE FLOWS SHALL NOT EXCEED MANUFACTURER'S SPECIFICATIONS.
- VALVE BOXES SHALL BE SQUARE TO ADJACENT WALKS OR CURBS AND FLUSH WITH THE FINAL GRADE.
- WORK SHALL CONFORM TO ALL CONSTRUCTION CODES AND REGULATIONS.
- THE LANDSCAPE CONTRACTOR SHALL INSTALL GREEN VALVE BOXES IN TURF AREAS AND TAN VALVE BOXES IN DECOMPOSED GRANITE AREAS (TYPICAL).
- REFER TO THE IRRIGATION NOTES FOR THE CALCULATED PRESSURE AT THE WATER METER. REFER TO NOTE #4 IF PRESSURE DIFFERS FROM THAT NOTED.
- THE LANDSCAPE CONTRACTOR SHALL VISIT SITE PRIOR TO BIDDING ON PROJECT TO VERIFY INSTALLATION CONDITIONS.
- PRIOR TO COMMENCEMENT OF ANY WORK, THE CONTRACTOR SHALL CONTACT BLUE STAKE TO VERIFY LOCATIONS AND DEPTHS OF UNDERGROUND UTILITIES THAT MAY BE EFFECTED BY HIS WORK, AND HE SHALL BE RESPONSIBLE FOR DAMAGES TO SUCH UTILITIES CAUSED AS A RESULT OF HIS IRRIGATION INSTALLATION.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR COMPENSATING THE OWNER AND/OR THE OWNER'S REPRESENTATIVE FOR ANY DESIGN CHANGES MADE AS A RESULT OF DEVIATION BY THE CONTRACTOR FROM THE PLANS AND SPECIFICATIONS OR DUE TO ERRORS, FAULTY MATERIAL OR FAULTY WORK OR FAULTY WORKER.
- INSTALL ALL MAINLINES WITH A MINIMUM OF 20" OF COVER.
- INSTALL ALL LATERALS WITH A MINIMUM OF 12" OF COVER.
- ALL PIPE TO BE INSTALLED PER THE MANUFACTURER'S SPECIFICATIONS AND ASTM STANDARD D 2774.
- ALL THREADED JOINTS TO BE COATED WITH TEFLON TAPE UNLESS OTHERWISE SPECIFIED BY THE MANUFACTURER. USE LIQUID TEFLON ON METAL PIPE THREADS ONLY.
- FLUSHING OF ALL LINES PRIOR TO INSTALLATION OF SPRINKLERS AND EMITTERS IS REQUIRED.
- INSTALL ALL SPRINKLERS, EMITTERS, AND RELATED MATERIAL PER IRRIGATION SYSTEM SPECIFICATIONS AND DETAILS.
- INSTALL ALL ELECTRICAL JOINTS WITH 3-M WATERPROOF CONNECTORS.
- ALL ELECTRICAL CONNECTIONS SHALL BE MADE AT THE REMOTE CONTROL VALVE BOXES, CONTROLLER ENCLOSURES AND VALVE BOXES SPECIFICALLY FOR ELECTRICAL CONNECTIONS.
- A CERTIFIED ELECTRICIAN SHALL BE RESPONSIBLE FOR INSTALLING ALL WIRING FROM THE CIRCUIT BREAKER AT THE 120 VOLT SOURCE LOCATION TO AUTOMATIC CONTROLLER.
- ALL 120 VOLT VOLT POWER WIRE TO BE INSTALLED PER LOCAL CODE AND THE N.E.C.
- INSTALL ALL VALVE WIRING IN MAINLINE TRENCH AS DETAILED.
- INSTALL ALL REMOTE CONTROL VALVES AT HEIGHT INDICATED ON DETAILS, AS HIGH AS POSSIBLE BUT ALLOWING CLEARANCE BETWEEN VALVE BOX LID AND FLOW CONTROL HANDLE ON REMOTE CONTROL VALVE.
- INSTALL ALL MAINLINE GATE VALVES IN A ROUND PLASTIC VALVE BOX PER DETAILS.
- ALL PVC SOLVENT WELD FITTINGS SHALL BE LASCO OR APPROVED EQUAL.
- THE MAINLINE, LATERAL PIPE, AND VALVES ARE SHOWN SCHEMATICALLY AND SHALL BE INSTALLED WITHIN THE LANDSCAPE AREA, OUTSIDE R.O.W. AND P.U.E., ADJACENT TO SIDEWALK OR CURB AND OFFSET 18" WHEREVER POSSIBLE.
- SUPPLY THE FOLLOWING MATERIAL TO THE OWNER:
A) TWO WRENCHES FOR DISASSEMBLY AND ADJUSTING OF EACH TYPE OF SPRINKLER HEAD AND VALVE SUPPLIED.
B) TWO KEYS FOR EACH OF THE CONTROLLERS.
C) TWO COUPLERS WITH MATCHING HOSE BIBS AND SHUT-OFF VALVE.
D) TWO VALVE BOX KEYS.
- ALL MAINLINE FITTINGS FOR PIPE 3" AND LARGER SHALL BE CAST OR DUCTILE IRON FOR PVC; SCHEDULE 80 PVC FOR 2 1/2" AND SMALLER.
- ALL MAINLINE PIPE SHALL BE A MINIMUM OF SCHEDULE 40.
- SLEEVES SHALL BE A MINIMUM OF TWO TIMES THE DIAMETER OF THE LINE SIZE.
- ALL MAINLINE AND IRRIGATION EQUIPMENT SHALL BE PLACED IN THE LANDSCAPED AREAS.
- CONTROLLER WIRES THAT ARE DIRECT BURIED SHALL BE #14 OR BETTER, BUNDLED OR WRAPPED A MINIMUM OF EVERY TWELVE (12) FEET. DURING INSTALLATION WIRES SHALL HAVE A 24" LOOP TIED IN ALL DIRECTION CHANGES GREATER THAN 30 DEGREES AND BE UNITED PRIOR TO TRENCH FILL IN.
- DRIP SYSTEM FLUSH CAPS SHALL BE PLACED IN A VALVE BOX AT THE END OF ALL DRIP LATERAL RUNS, AS DESCRIBED ON THE DRAWINGS.
- ALL VALVES, PRESSURE REGULATORS AND OTHER DEVICES SHALL BE PLACED IN AN APPROPRIATELY SIZED VALVE BOX WITH A MINIMUM OF TWO (2) INCHES OF PEA GRAVEL.
- PRIOR TO PLACING ANY IRRIGATION SYSTEM IN SERVICE, AN ARIZONA CERTIFIED BACKFLOW DEVICE TESTER SHALL TEST THE BACKFLOW PREVENTION DEVICE AND GIVE A COPY OF THE PASSED TEST RESULTS TO THE MARICOPA COUNTY INSPECTOR OR MAIL IT TO THE MARICOPA COUNTY DEPARTMENT OF PUBLIC WORKS INSPECTION STATION.
- AFTER INITIAL TESTING, ALL BACKFLOW DEVICES SHALL BE TESTED ANNUALLY.
- BACKFLOW DEVICES SHALL BE A MINIMUM OF TWO (2) FEET FROM THE WATER METER AND BE THE SAME SIZE AS THE METER SERVICE LINE.
- ALL BACKFLOW PREVENTION DEVICES SHALL HAVE A MINIMUM 24"x36"x4" CLASS B CONCRETE SLAB WITH PIPE SLEEVES. IF A SECURITY CAGE IS INSTALLED, CONCRETE SHALL BE SIX (6") INCHES LARGER ON ALL SIDES THAN THE SECURITY CAGE.
- ALL PIPE CROSSINGS IN THE RIGHT-OF-WAY SHALL BE MARKED ON EACH SIDE OF THE CURB WITH A NON-DESTRUCTIBLE MARKING.

GRADING GENERAL NOTES:

- CONTRACTOR SHALL GRADE TO MAINTAIN POSITIVE DRAINAGE AWAY FROM ALL STRUCTURES. REVIEW ENGINEERS PLAN FOR DRAINAGE.
- FINISH GRADING SHALL BE BY THE DIRECTION OF THE LANDSCAPE ARCHITECT.
- LANDSCAPE ARCHITECT SHALL APPROVE GRADING PRIOR TO PLANTING.
- GRADING FOR THIS PROJECT INCLUDES THE FOLLOWING:
A) FINE GRADING OF EXISTING ROUGH GRADES IS REQUIRED TO PROVIDE SMOOTH, EVEN GRADE TRANSITION IN LANDSCAPE AREA.
B) IMPORTING AND PLACING "OFF-SITE 3/8" MINUS TOPSOIL" IN THE FOLLOWING AREAS:
i) TURF AND ANNUAL AREAS (6" DEPTH).
ii) PLANT BACKFILL (CAN BE SCREENED ON-SITE SOIL).
- THE CONTRACTOR IS RESPONSIBLE FOR REMOVING ANY CAULICHE ENCOUNTERED ON SITE AT NO ADDITIONAL COST TO THE OWNER. THE OWNER AND CONTRACTOR SHALL COORDINATE A SUITABLE LOCATION ON SITE TO DISPOSE OF THE CAULICHE MATERIAL. SHOULD A SUITABLE LOCATION ON SITE NOT EXIST, THE OWNER SHALL BE RESPONSIBLE FOR ALL FEES ASSOCIATED WITH REMOVAL AND DISPOSAL OF THE CAULICHE.
- FINISH GRADE OF ALL PLANTING AREAS IS TO BE 1.5" BELOW ADJACENT PAVING UNLESS NOTED OTHERWISE.
- REFERENCE CIVIL ENGINEERING DRAWINGS FOR GRADING AND DRAINAGE FLOWS. THE CONTRACTOR SHALL BE RESPONSIBLE THAT THESE ARE PROVIDED FOR AND NOT IMPAIRED WITH OBSTRUCTIONS.
- THE CONTRACTOR IS RESPONSIBLE FOR GRADING ALL AREAS AT THE DIRECTION OF THE LANDSCAPE ARCHITECT TO CREATE A NATURALLY UNDULATING GROUND PLANE.

VICINITY MAP:

SCALE: NTS

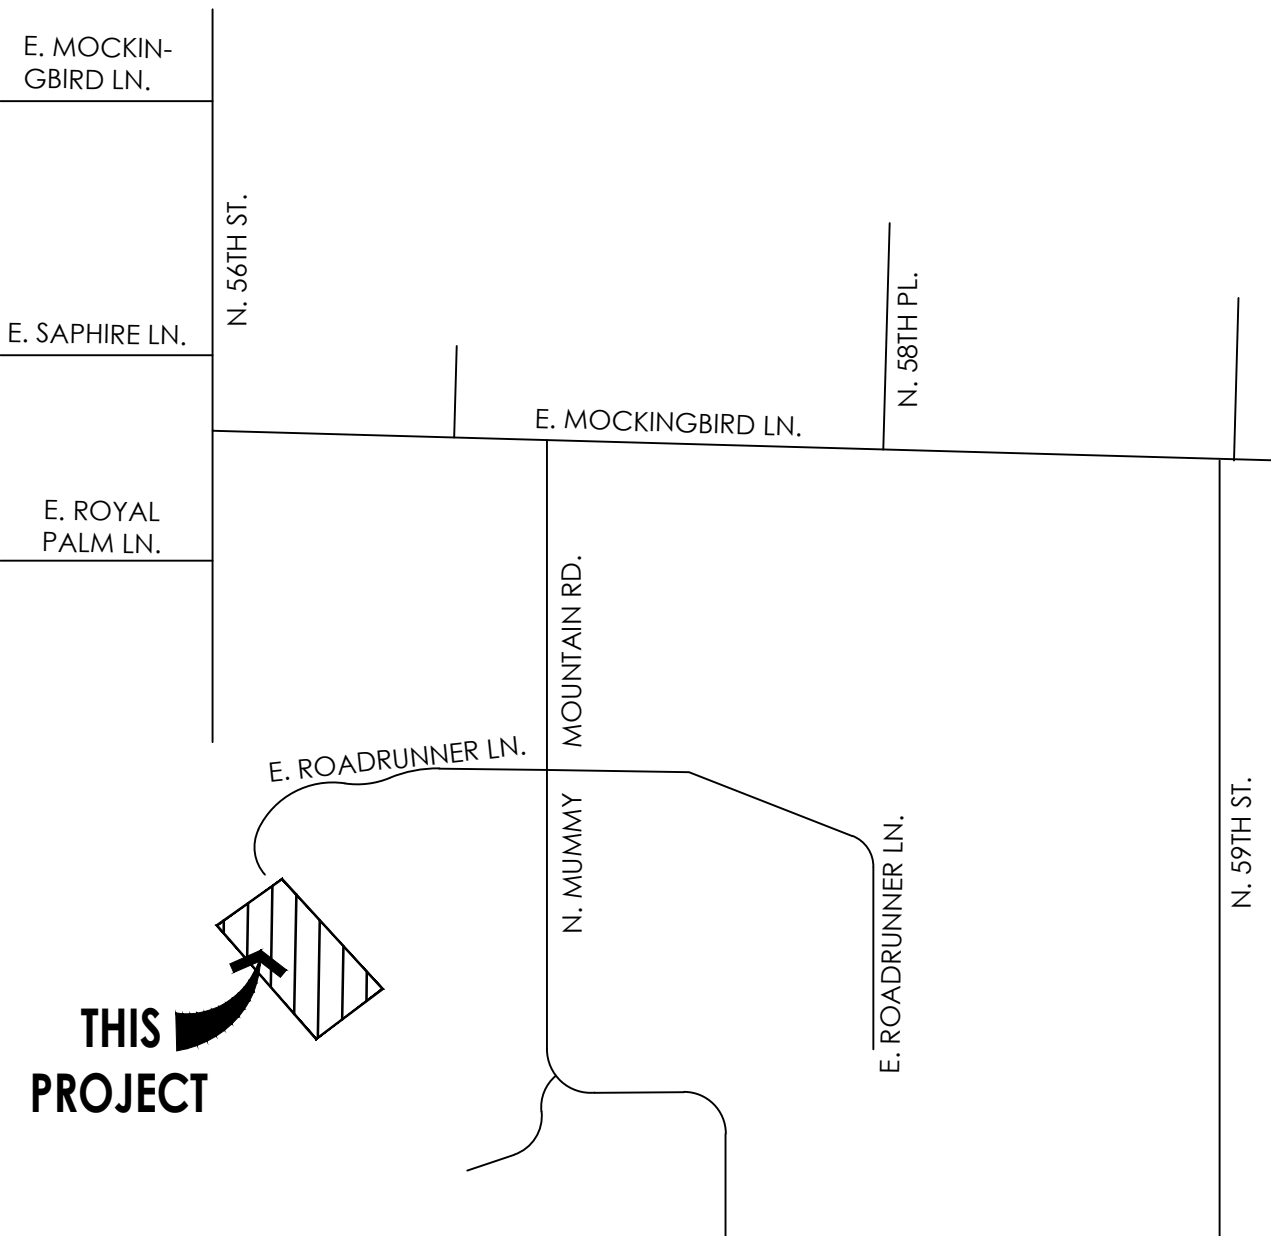

HARDSCAPE GENERAL NOTES:

- FOOTINGS, WALLS AND FENCES SHALL BE PLACED OUTSIDE OF THE PUBLIC RIGHT-OF-WAY.
- REFER TO CIVIL PLANS PREPARED BY CIVIL ENGINEERS FOR ALL INFORMATION REGARDING HORIZONTAL AND VERTICAL CONTROLS.
- ALL DETAILS SHALL BE REVIEWED BY A STRUCTURAL ENGINEER AND MODIFIED (IF NECESSARY) PRIOR TO CONSTRUCTION.
- ALL DIMENSIONS SHOWN ON THIS PLAN ARE BASED ON THE CIVIL PLAN SUBMITTED BY THE ARCHITECT. SHOULD DISCREPANCIES OCCUR, FIELD REVISIONS SHALL BE REQUIRED.
- THE CONTRACTOR SHALL HAVE SIDEWALK SURVEYED AND STAKED FOR REVIEW BY THE LANDSCAPE ARCHITECT PRIOR TO INSTALLATION.
- IN ADDITION TO SUBMITTING MATERIAL SAMPLES OF ALL SITE RELATED MATERIALS, THE CONTRACTOR SHALL PREPARE A 4'X4' SAMPLE PANEL FOR EACH TYPE OF CONSTRUCTION, I.E. A) CONCRETE PAVERS, B) EXPOSED AGGREGATE PAVING, C) INTEGRAL COLORED CONCRETE, ETC., FOR APPROVAL BY THE LANDSCAPE ARCHITECT AND OWNER'S AUTHORIZED REPRESENTATIVE PRIOR TO FINAL CONSTRUCTION.
- UNLESS NOTED OTHERWISE ON CONSTRUCTION DOCUMENTS OR NOTED IN DETAILS, SIDEWALKS SHALL BE 5'-0" WIDE, 4" THICK, 3,000 PSI CONCRETE ON COMPACTED BASE WITH CONSTRUCTION JOINTS AT 5'-0" ON CENTER AND EXPANSION JOINTS AT 20'-0" ON CENTER. SIDEWALKS SHALL HAVE A MEDIUM BROOM, NON-SKID FINISH WITH 1/2" RADIUS TOOLED EDGES.
- RADIUS AT SIDEWALK INTERSECTIONS SHALL BE 5'-0" (TYPICAL), UNLESS NOTED OTHERWISE.
- THE CONTRACTOR SHALL LAYOUT AND VERIFY ALL HARDSCAPE ELEMENTS PRIOR TO CONSTRUCTION FOR REVIEW BY THE LANDSCAPE ARCHITECT OR OWNER'S AUTHORIZED REPRESENTATIVE. SHOULD DISCREPANCIES EXIST, CONTRACTOR SHALL NOTIFY THE LANDSCAPE ARCHITECT OR OWNER'S AUTHORIZED REPRESENTATIVE BEFORE PROCEEDING FURTHER.

SHEET INDEX:

COVER SHEET	L0.0
INVENTORY SALVAGE PLAN	L2.0A, L2.0B
LAYOUT PLAN	L2.1-L2.3
PLANTING PLAN	L3.1-L3.3
IRRIGATION PLAN	L4.1
LIGHTING PLAN	L5.1
PLANTING DETAILS	L7.1
PLANTING SPECIFICATIONS	L8.1
IRRIGATION SPECIFICATIONS	L8.2

CONSULTANT TEAM

CLIENT:

MARK RUKAVINA

LANDSCAPE ARCHITECT:

GREEY | PICKETT
7144 E. STETSON DRIVE
SUITE 205
SCOTTSDALE, AZ 85251
PHONE: (480) 609-0009
FAX: (480) 609-0068
CONTACT: RUSS GREEY


ARCHITECT:

STRATTON ARCHITECTS
5090 N. 40TH ST. STE 170
PHOENIX, AZ 85018
PHONE: (860) 331-0701
CONTACT: ANDREW STRATTON



ROADRUNNER RESIDENCE

5611 E. Roadrunner Ln.
Paradise Valley, AZ. 85253



project #:
SAA112

drawn by:
TEAM

drawing:
Cover

revisions:

scale:
N/A

issued for:

date:
03/19/2026

L0.0
of



GENERAL SALVAGE NOTES:

1. PLANT MATERIALS MUST BE INDIVIDUALLY TAGGED IN THE FIELD AT THE TIME THE INVENTORY PLANS ARE SUBMITTED. TAGGED MATERIALS MUST BE CLEARLY MARKED WITH WATERPROOF INK AND INCLUDE THE NUMBER WHICH CORRESPONDS TO THE NUMBER SHOWN ON THE PLANS.
2. ALL PLANT MATERIALS MUST REMAIN ON SITE UNTIL THE SALVAGE PLAN IS APPROVED.
3. TAGS MUST BE ATTACHED SO THAT THEY WILL REMAIN ON THE PLANT FOR THE DURATION OF THE SALVAGE AND NURSERY STORAGE PERIOD.
4. ALL SALVAGEABLE MATERIAL IS TO BE CLEARLY FLAGGED WITH TAPE OR PLASTIC TAGS VISIBLE FROM ALL DIRECTIONS. TAGS SHALL BE NUMBERED TO CORRESPOND WITH THE PLANT INVENTORY PLAN AND LEGEND.
- COLOR CODE AS FOLLOWS:
RED - SALVAGE AND RELOCATE
WHITE - PRESERVE AND PROTECT IN PLACE
BLUE - DESTROY, NOT SALVAGEABLE AND CANNOT REMAIN IN PLACE
5. ALL SALVAGEABLE PLANTS WILL BE STORED AT AN ON-SITE HOLDING YARD AND WILL BE RE-PLANTED ON-SITE AT A LATER DATE.
6. ALL MISCELLANEOUS CACTI UNDER 3' IN HEIGHT WILL BE SALVAGED AND STORED IN THE NURSERY IF THEY ARE WITHIN THE BUILDING ENVELOPE AND AFFECTED BY CONSTRUCTION.
7. UPON REMOVAL OF SALVAGEABLE NATIVE PLANTS THE SALVAGE CONTRACTOR SHALL SUBMIT A LIST IDENTIFYING THE TAG NUMBER OF THE PLANTS SURVIVING SALVAGE OPERATIONS TO THE CITY'S LANDSCAPE INSPECTOR PRIOR TO ISSUANCE OF THE CERTIFICATE OF OCCUPANCY.
8. CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL PROJECT PROPERTY LINES PRIOR TO SALVAGE. ANY PLANT MATERIAL THAT IS LABELED SALVAGEABLE OR NON-SALVAGEABLE OUTSIDE OF FINAL STAKING BOUNDARIES IS TO REMAIN IN PLACE UNLESS OTHERWISE DIRECTED BY OWNER.
9. CONTRACTOR TO VERIFY WITH OWNER ALL PLANT MATERIAL LABELED SALVAGEABLE OR NON-SALVAGEABLE ADJACENT TO N.A.O.S. BOUNDARIES AND /OR DRAINAGE WAYS




INVENTORY COMPLETED BY: (CITY APPROVED FOR INVENTORY)

ARIZONA SPECIALTY CACTUS
PHONE: 602-694-3496
E-MAIL: AZSPECIALTYCACTUS@GMAIL.COM
CONTACT: ALEX GREY

SALVAGE TO BE COMPLETED BY: (CITY APPROVED FOR SALVAGE)

BLACK EAGLE NURSERIES AND MAINTENANCE
ADDRESS: 5226 32ND STREET
PHOENIX AZ, 85040
PHONE: 602-323-1558
E-MAIL: CZORNS@BLACKEAGLEAZ.COM
CONTACT: CLAY ZORNS

PLANT SYMBOL LEGEND:



Parkinsonia

Prosopis velutina

Carnegiea gigantea

Palo Verde

Mesquite

Saguaro


INVENTORY COMPLETED BY:

ARIZONA SPECIALTY CACTUS
PHONE: 602-694-3496
E-MAIL: AZSPECIALTYCACTUS@GMAIL.COM
CONTACT: ALEX GREY

Tag#	Species	Condition	Inventory Designation	Intended Designation	Salvageability Comments	Caliper Inches	Tree Height-Ft.	Tree Width-Ft.	Tree Height-Lf
1	Palo Verde	Good	RP	Remain		8	12	17	
2	Palo Verde	Good	RP	Remain		4	10	15	
3	Palo Verde	Good	RP	Remain		5	13	15	
4	Palo Verde	Good	RP	Remain		5	10	15	
5	Palo Verde	Good	RP	Remain		5	12	13	
6	Palo Verde	Good	RP	Remain		4	8	12	
7	Palo Verde	Good	RP	Remain		5	11	14	
8	Palo Verde	Good	RP	Remain		10	14	17	
9	Palo Verde	Good	RP	Remain		10	14	16	
10	Palo Verde	Good	RP	Remain		10	14	15	
11	Palo Verde	Good	RP	Remain		4	8	8	
12	Palo Verde	Good	RP	Remain		5	8	8	
13	Palo Verde	Good	RP	Remain		6	12	15	
14	Mesquite	Good	RP	Remain		10	12	17	
15	Palo Verde	Good	RP	Remain		6	12	15	
16	Palo Verde	Good	RP	Remain		4	10	15	
17	Palo Verde	Good	RP	Remain		5	7	10	
18	Palo Verde	Good	RP	Remain		5	10	15	
19	Saguaro	Good	S	Salvage		20	4		
20	Palo Verde	Good	RP	Remain		4	7	15	
21	Palo Verde	Good	RP	Remain		5	15	15	
22	Palo Verde	Good	RP	Remain		5	12	15	
23	Palo Verde	Good	RP	Remain		5	7	14	
24	Palo Verde	Good	RP	Remain		4	9	13	
25	Palo Verde	Good	RP	Remain		4	9	15	
26	Palo Verde	Good	RP	Remain		6	14	16	
27	Palo Verde	Good	RP	Remain		4	9	12	
28	Palo Verde	Good	RP	Remain		4	12	16	
29	Palo Verde	Good	RP	Remain		12	15	20	
30	Palo Verde	Good	RP	Remain		7	12	15	
31	Palo Verde	Good	RP	Remain		5	9	14	
32	Palo Verde	Good	RP	Remain		10	15	18	
33	Palo Verde	Good	RP	Remain		10	13	16	
34	Palo Verde	Good	RP	Remain		10	15	18	
35	Palo Verde	Poor	D	Destroy	Split Head	6	15	17	
36	Palo Verde	Poor	D	Destroy	In Wash	4	10	14	
37	Palo Verde	Poor	D	Destroy	Branch Die Back	10	15	15	
38	Palo Verde	Poor	D	Destroy	Branch Die Back	10	15	20	
39	Palo Verde	Poor	D	Destroy	Branch Die Back	4	9	15	
40	Palo Verde	Poor	D	Destroy	On Ledge	12	13		
41	Palo Verde	Poor	D	Destroy	On Ledge	5	16	18	
42	Palo Verde	Poor	D	Destroy	On Ledge	5	16		
43	Palo Verde	Poor	D	Destroy	Leaning	8	16	17	
44	Palo Verde	Good	S	Salvage		12	15	17	
45	Palo Verde	Poor	D	Destroy	Branch Die Back	12	10	18	
46	Palo Verde	Poor	D	Destroy	Branch Die Back	8	12	17	
47	Palo Verde	Poor	D	Destroy	Branch Die Back	4	13	15	
48	Palo Verde	Poor	D	Destroy	Branch Die Back	5	12	15	

Summary

	Salvage Plants
1	Trees on this site to be salvaged totaling 62 caliper inches
1	Cacti on this site to be salvaged totaling 4 lateral feet
2	Total Plants to Salvage
	Unsalvageable Plants (Destroy)
13	Trees on this site that are not salvageable (destroy) totaling 93 caliper inches
0	Cacti on this site that not salvageable totaling 0 caliper inches
13	Total Plants to Destroy (Unsalvageable)
	Plants to Remain
33	Trees on site to remain in place

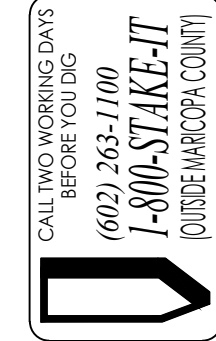

ROADRUNNER RESIDENCE



project #: SAA112
scale: 1"=20'-0"
issued for:

drawn by: TEAM
date: 03/19/2026


drawing: Native Plant Inventory

L2.0A

of

5611 E. Roadrunner Ln.
Paradise Valley, AZ. 85253

GREEY | PICKETT
landscape architecture | community design
7144 E. Mission Drive, Suite 205
Phoenix, AZ 85032
480.609.0009p 480.609.0068t

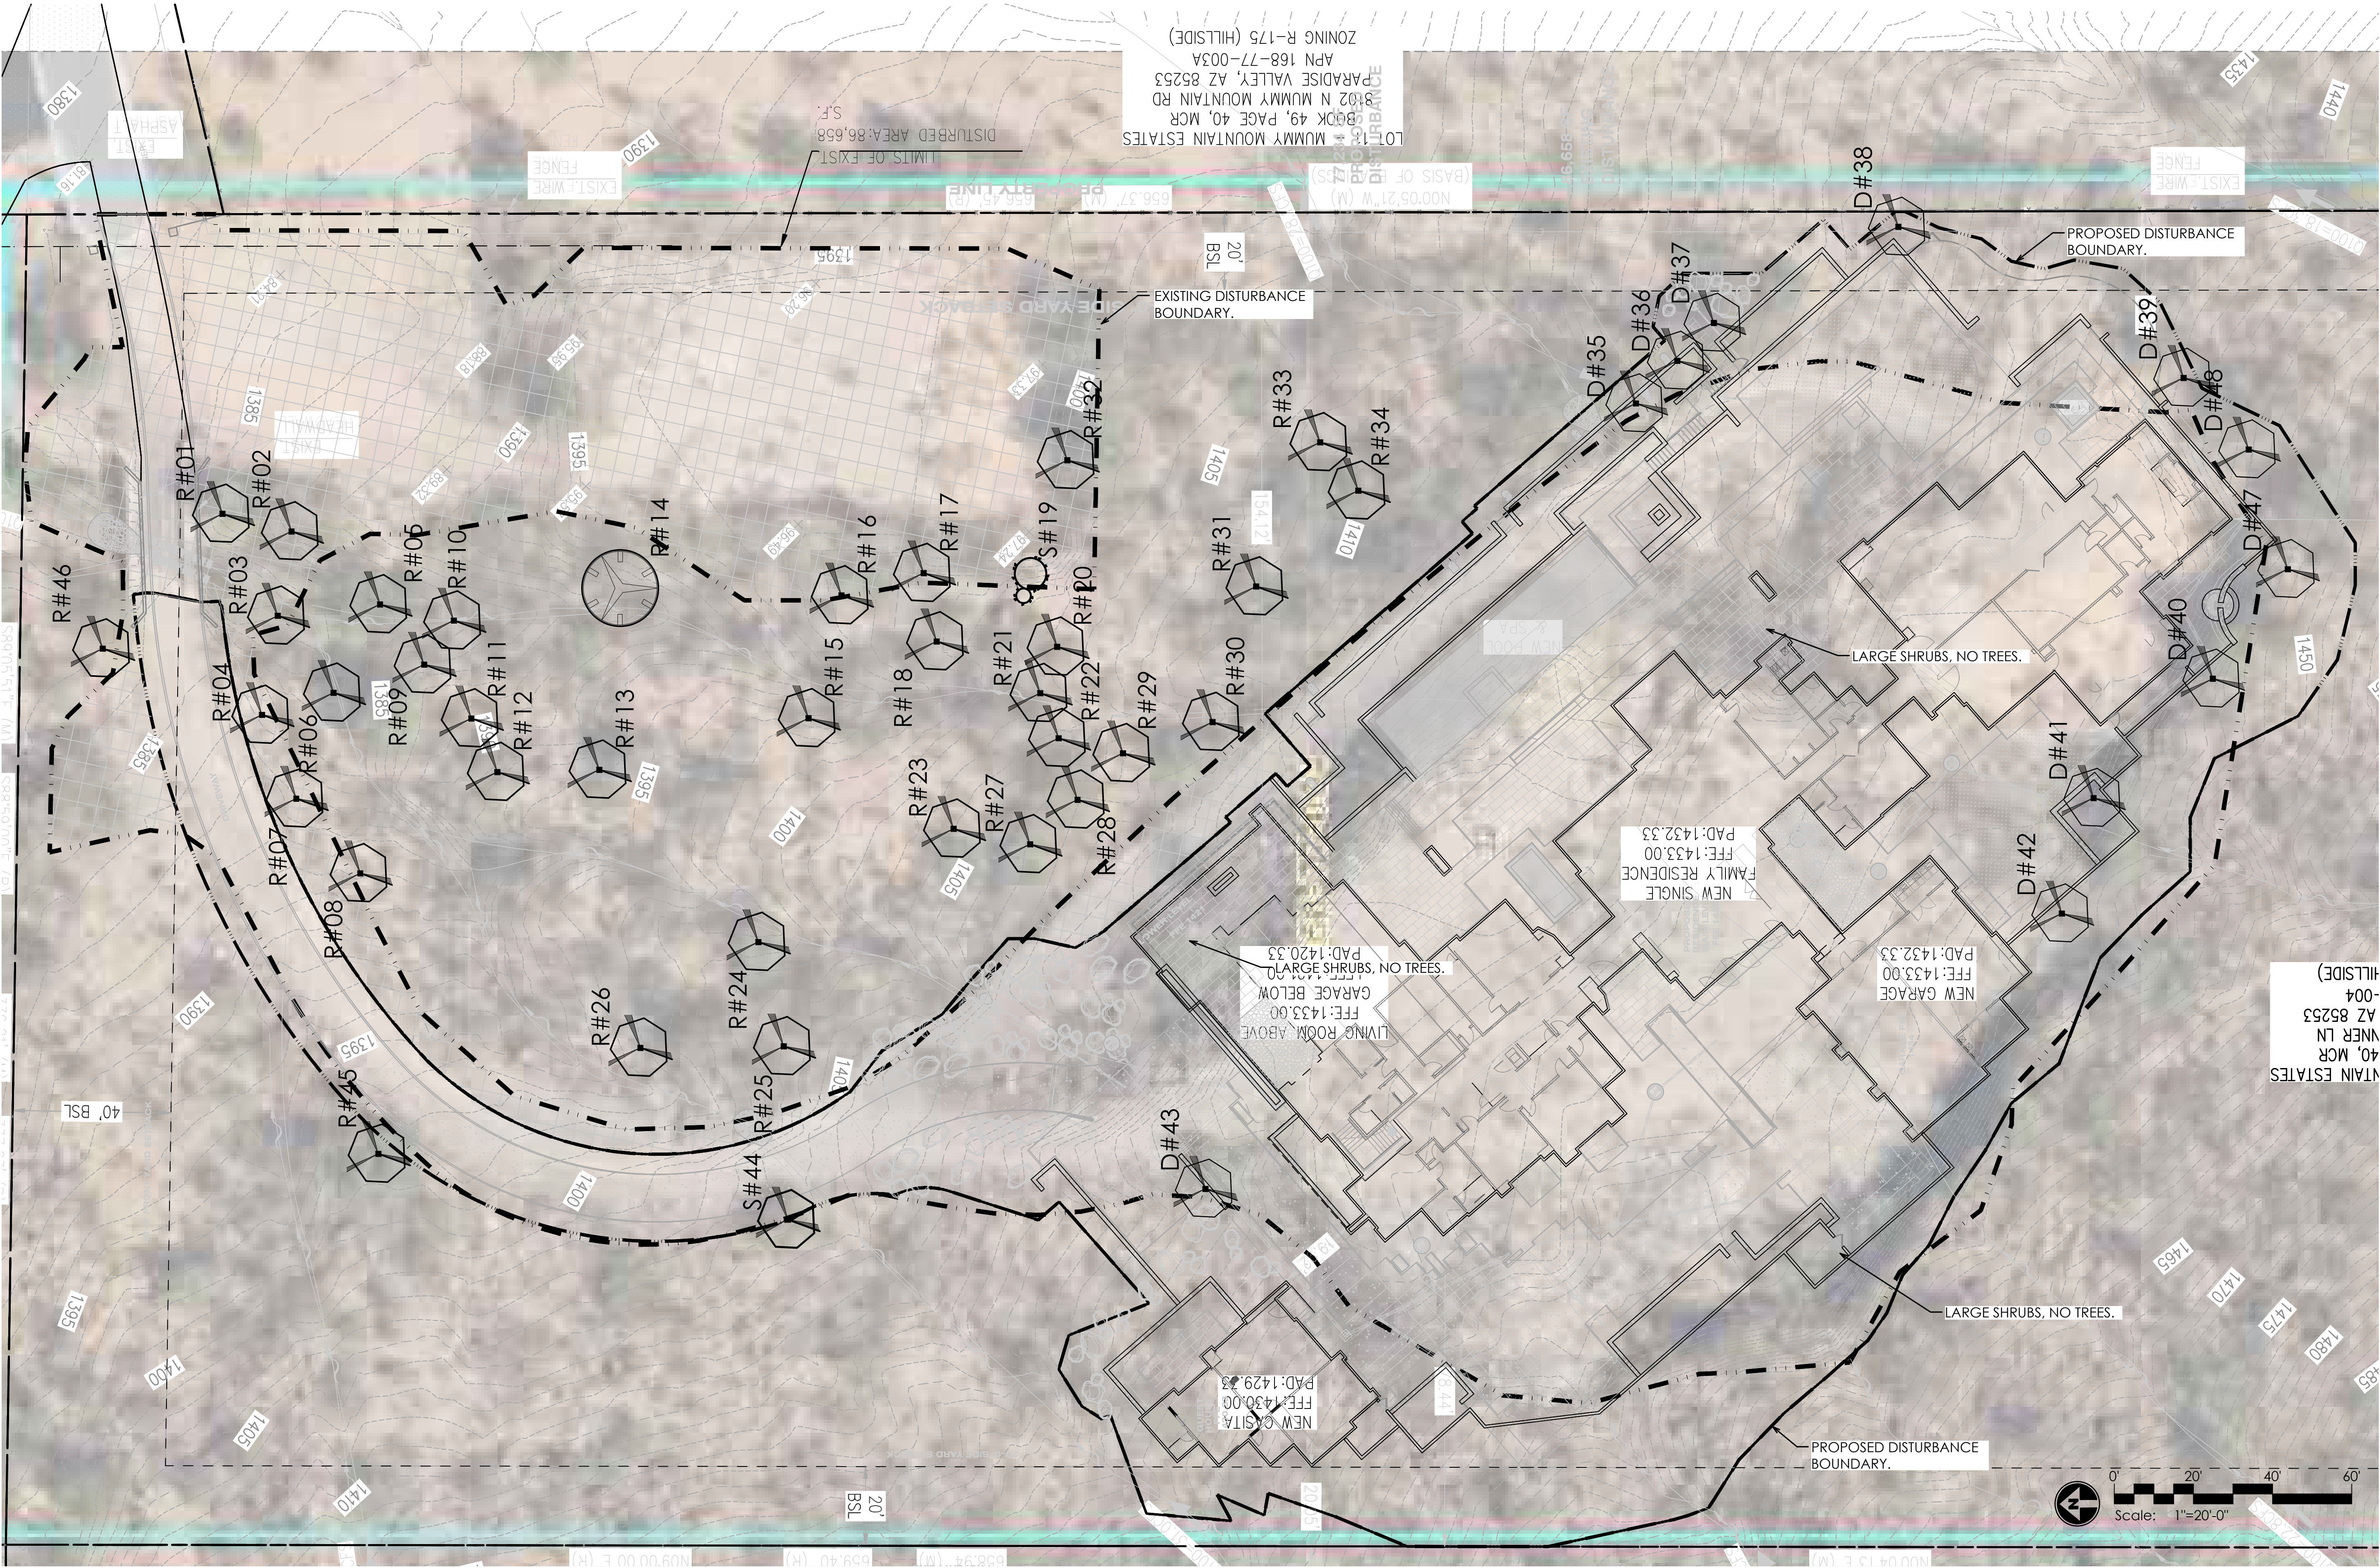

These documents are protected by copyright and may not be reproduced, in whole or in part, in any form or by any means, electronic or mechanical, without express written consent of the owner or Greey Pickett. Unauthorized reproduction may subject you to civil and criminal liability.



ROADRUNNER RESIDENCE

5611 E. Roadrunner Ln.
Paradise Valley, AZ. 85253



project #:
SAA112

scale:
1"=20'-0"
issued for:

drawn by:
TEAM

date:
03/19/2026


drawing:
Native Plant Inventory

L2.0B

of

Copyright © 2014 by
Greey Pickett Professional Corp.

Greey Pickett
landscape architecture | community design
7144 E. Mission Drive, Suite 205
Phoenix, AZ 85032
480.609.0009p 480.609.0068f

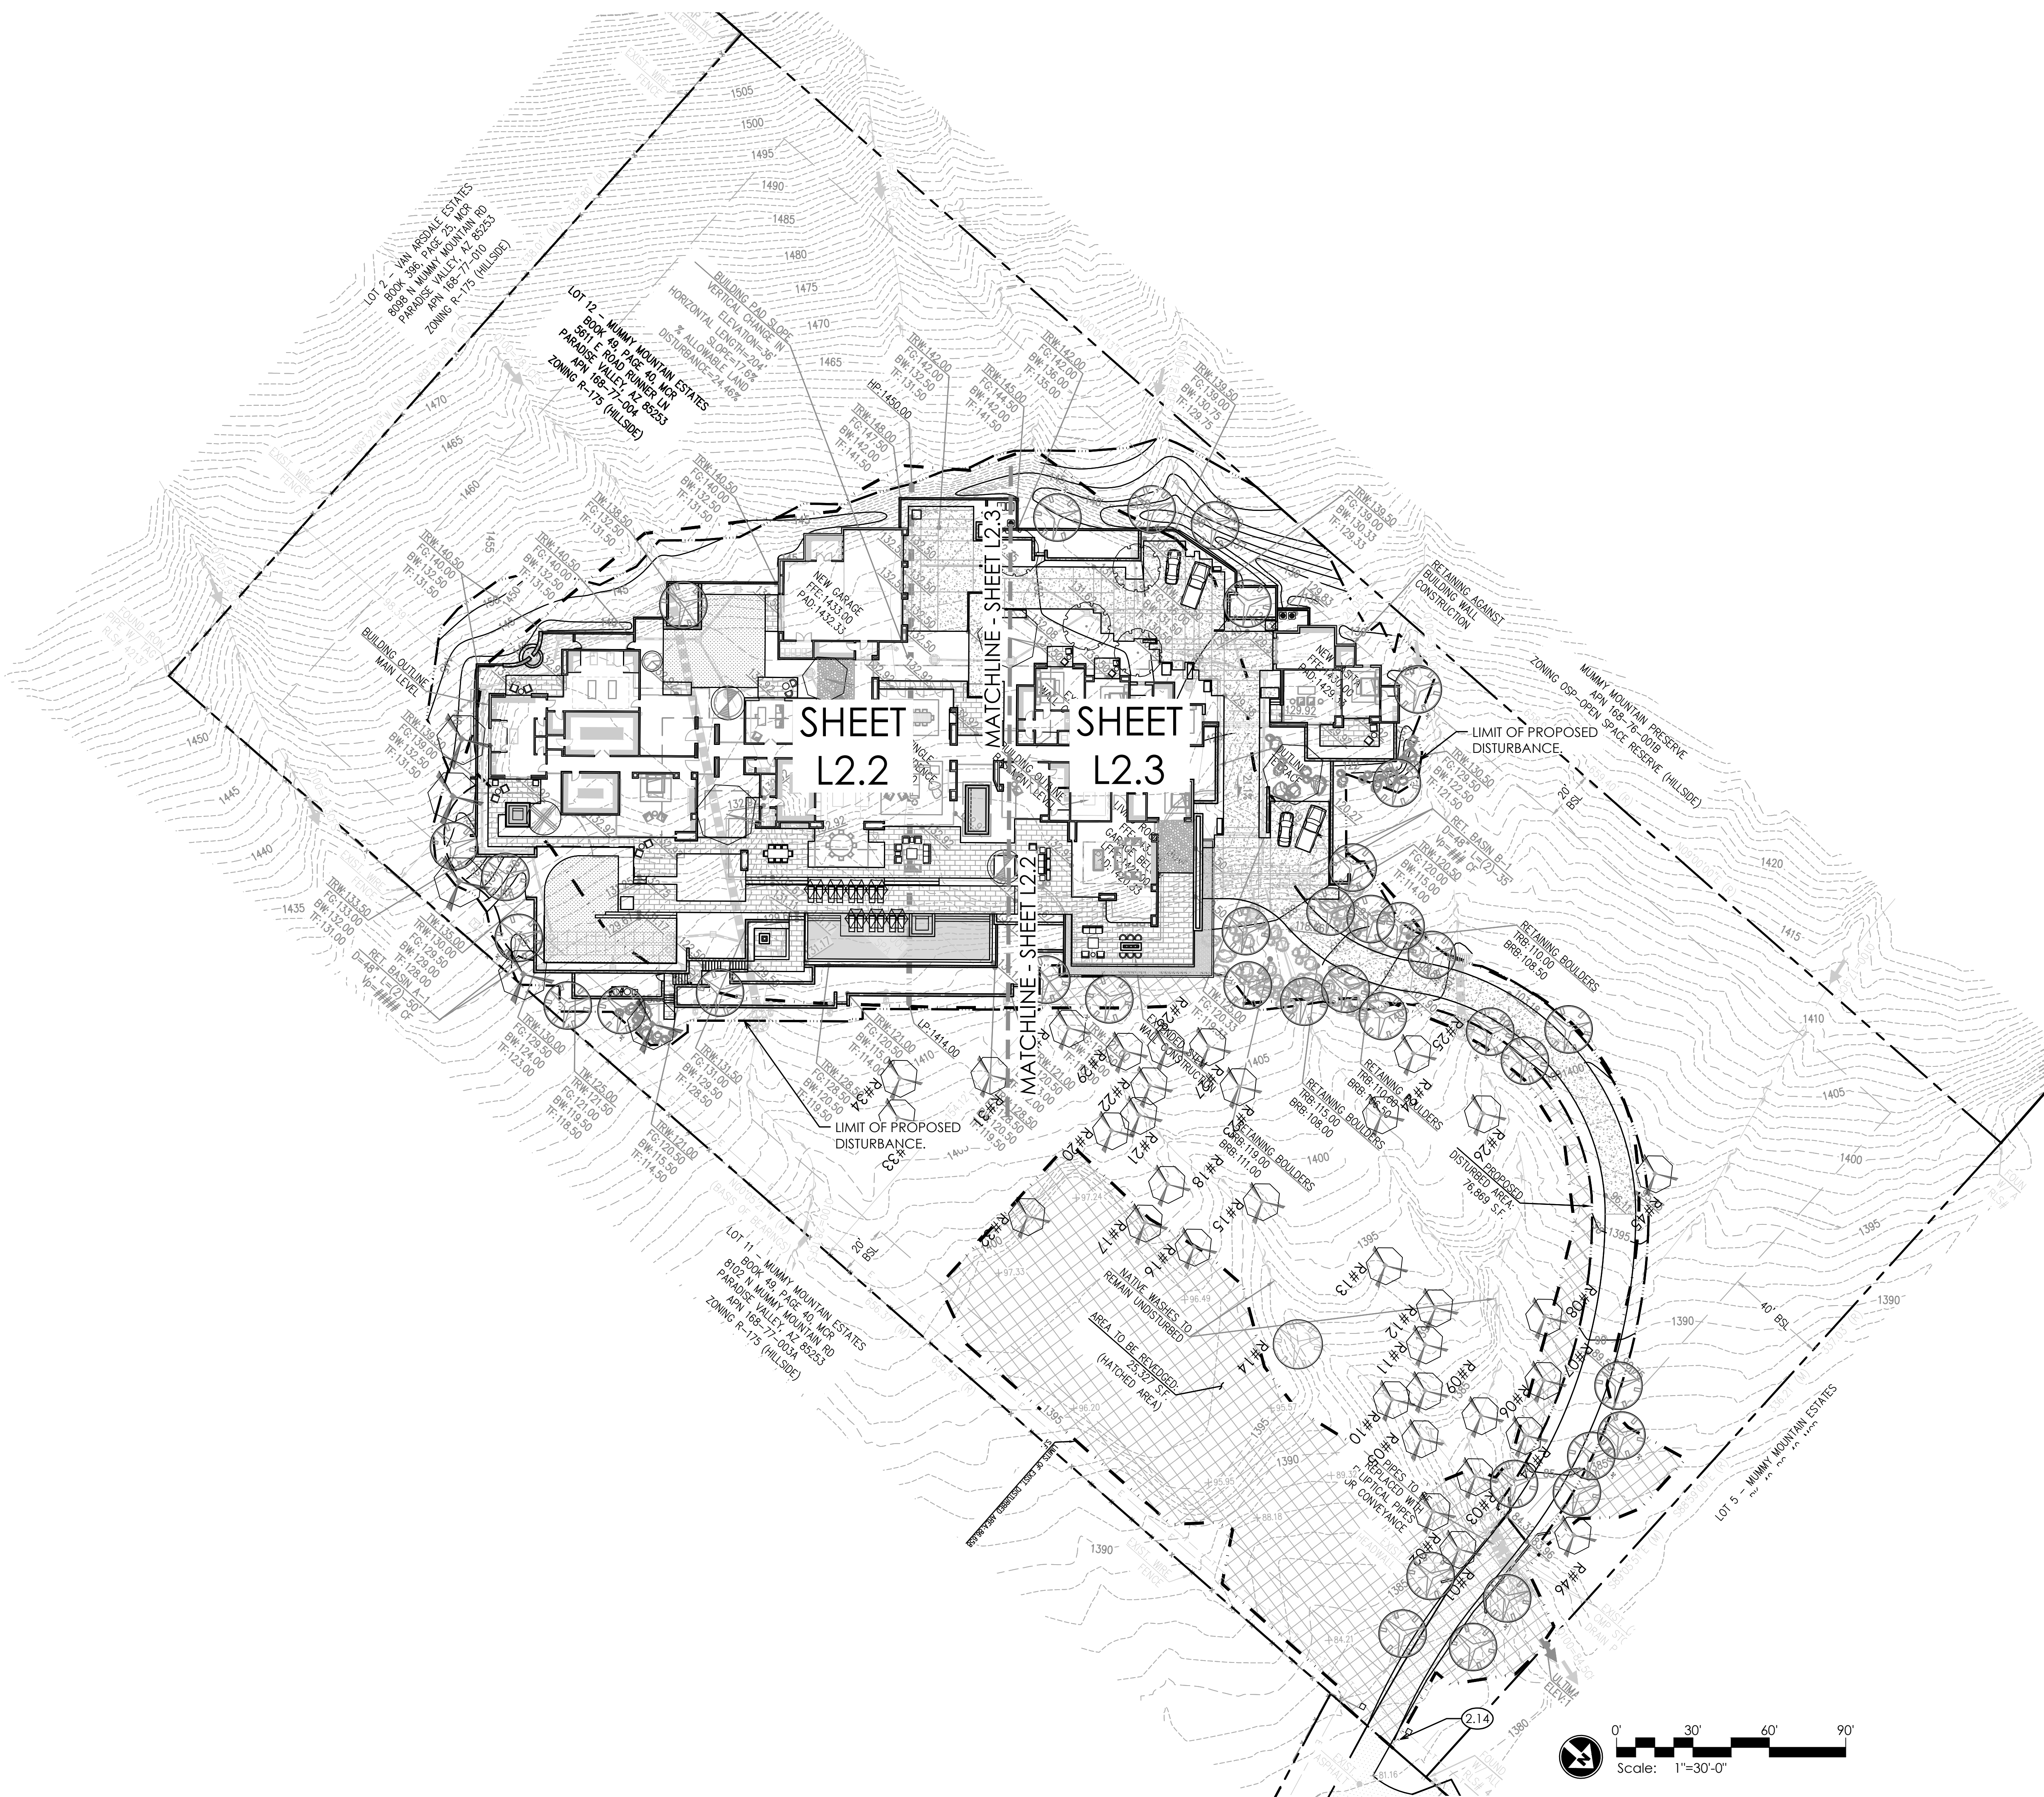

- KEY NOTES
- 1.10

COLOR CONCRETE, LIGHT EXPOSED FINISHED, 3/8" MIX, COLOR TBD. SAW CUT JOINTS. 1/4" RADIUS EDGE.

1.11

LARGE FORMAT PATIO PAVING, TBD. NOTE GRADE CHANGE AT EDGE OF PATIO, TURN DOWN CONDITIONS EXIST. MITER AND CARRY PATIO MATERIAL DOWN EXPOSED FACES OF PATIO.

1.30

1/4" THICK STEEL ANGLE LANDSCAPE HEADER.

1.31

1/4" THICK RAISED STEEL HEADER. 12" HIGH.

1.32

1"-3" DESERT COBBLE AT ROOF TOP GARDEN.

1.61

STEPS:16" TREAD, 6" RISER. FINISH TO MATCH KEYNOTE 1.11.

1.61

STEPS:14" TREAD, 6" RISER. FINISH TO MATCH KEYNOTE 1.11.

1.62

STEPS:12" TREAD,6" RISER. FINISH TO MATCH KEYNOTE 1.11.

2.10

8" WIDE MASONRY WALL, STUCCO AND PAINT FINISH TO MATCH ARCHITECTURE. FLAT STUCCO CAP. SLOPE TO DRAIN.

2.11

12" WIDE MASONRY WALL, STUCCO AND PAINT FINISH TO MATCH ARCHITECTURE. FLAT STUCCO CAP. SLOPE TO DRAIN.

2.12

8" WIDE MASONRY WALL, STONE VENEER WRAP TO CAP.

2.13

8" WIDE MASONRY FEATURE WALL AT POOL WITH SCUPPERS. CLAD IN STONE TO MATCH ARCHITECTURE. WRAP STONE OVER FOR CAP.

2.14

MAILBOX. TO MEET PV STANDARDS.

2.15

STEEL PLATE WALL INSERT.

2.50

FENCE, #4 REBAR PICKETS SPACED AT 4" ON CENTER.

2.51

3'-0" WIDE GATE TO MATCH 2.50.

2.52

3'-0" WIDE STEEL PANEL GATE.

2.53

RAILING, PER ARCHITECT.

3.30

STEEL FIRE PIT AT SUNKEN SEATING AREA.

3.31

FIREPIT AT ROOFTOP DECK.

3.32

FIREPLACE PER ARCHITECT.

4.10

POOL WITH NEGATIVE EDGE.

4.11

SUN SHELF AT POOL, 9" WATER DEPTH.

4.12

INVISIBLE EDGE SPA.

4.13

POOL EQUIPMENT LOCATION.

4.14

RAISED NEGATIVE EDGE SPA. SPILLOVER ON ALL SIDES. 18" HIGH.

4.15

FOUNTAIN AT MASTER BATH.

4.16

FOUNTAIN WITH NEGATIVE EDGE AND FIRE BURNER FEATURE.

5.10

SYNTHETIC TURF. ARTIFICIAL LAWNS CO. 'CORONADO' TURF. CONTRACTOR TO PROVIDE SAMPLE ON SITE FOR OWNER APPROVAL PRIOR TO PURCHASE OR INSTALL.

5.11

BOULDERS TO BE FIELD LOCATED BY LANDSCAPE ARCHITECT. CONTRACTOR TO SALVAGE LARGER BOULDERS DURING SITE EXCAVATION, FOR REUSE IN LANDSCAPE. BOULDERS TO MATCH NATURAL HILLSIDE ROCK. NO SURFACE SELECT.

5.12

PLANTER POT. CONTRACTOR TO PROVIDE PLUMBING AND SLEEVING FOR IRRIGATION AND DRAINAGE.

6.10

BBQ COUNTER, PER ARCHITECT.

6.11

PASS THROUGH WINDOW BAR COUNTER, PER ARCHITECT.

6.12

BUILT IN SEATING. 9" THICK CAST CONCRETE CAP WITH HIDDEN LED LIGHT STRIP.

NOTES:

1. WALLS: IF RETAINING DAMP PROOF AND GROUT ALL CELLS BELOW GRADE. SEE PLAN FOR HEIGHT.

2. ALL GATES AND FENCING TO MEET POOL BARRIER STANDARDS.

3. POOL CONTRACTOR TO PROVIDE SHOP DRAWINGS TO LANDSCAPE ARCHITECT FOR APPROVAL PRIOR TO CONSTRUCTION.

4. CONCRETE COLOR TO BE SELECTED BY OWNER. CONTRACTOR TO PROVIDE 2'X2' SAMPLE OF PROPOSED CONCRETE COLOR AND FINISH FOR APPROVAL BY OWNER PRIOR TO INSTALLATION.

5. ALL STEEL TO BE ELECTROSTATIC PAINTED TO MATCH ARCHITECTURAL STEEL. GRIND ALL WELDS SMOOTH.

6. ALL SPOT ELEVATIONS AND CALLOUTS ARE FOR DESIGN INTENT PURPOSES ONLY.REFER TO CIVIL PLAN FOR ALL GRADING AND DRAINAGE INFORMATION.

7. CONTRACTOR TO PROVIDE SAMPLES ONSITE OF ALL PROPOSED MATERIALS, FOR APPROVAL BY OWNER PRIOR TO PURCHASE OR INSTALL.

GREY PICKETT

landscape architecture community design

7144 e session drive, suite 205

paradise valley, az 85253

480.609.0009p 480.609.0068f

28448

RUSSELL E. GREY

Professional Engineer

License No. 12831026

Expires 12/31/26

ROADRUNNER RESIDENCE

5611 E. Roadrunner Ln.

Paradise Valley, AZ. 85253

project #:

SAA112

scale:

1"=30'-0"

issued for:

drawn by:

TEAM

date:

03/19/2026

drawing:

Overall Layout Plan

L2.1

of

revisions:

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

31

32

33

34

35

36

37

38

39

40

41

42

43

44

45

46

47

48

49

50

51

52

53

54

55

56

57

58

59

60

61

62

63

64

65

66

67

68

69

70

71

72

73

74

75

76

77

78

79

80

81

82

83

84

85

86

87

88

89

90

91

92

93

94

95


96

97

98

99

100

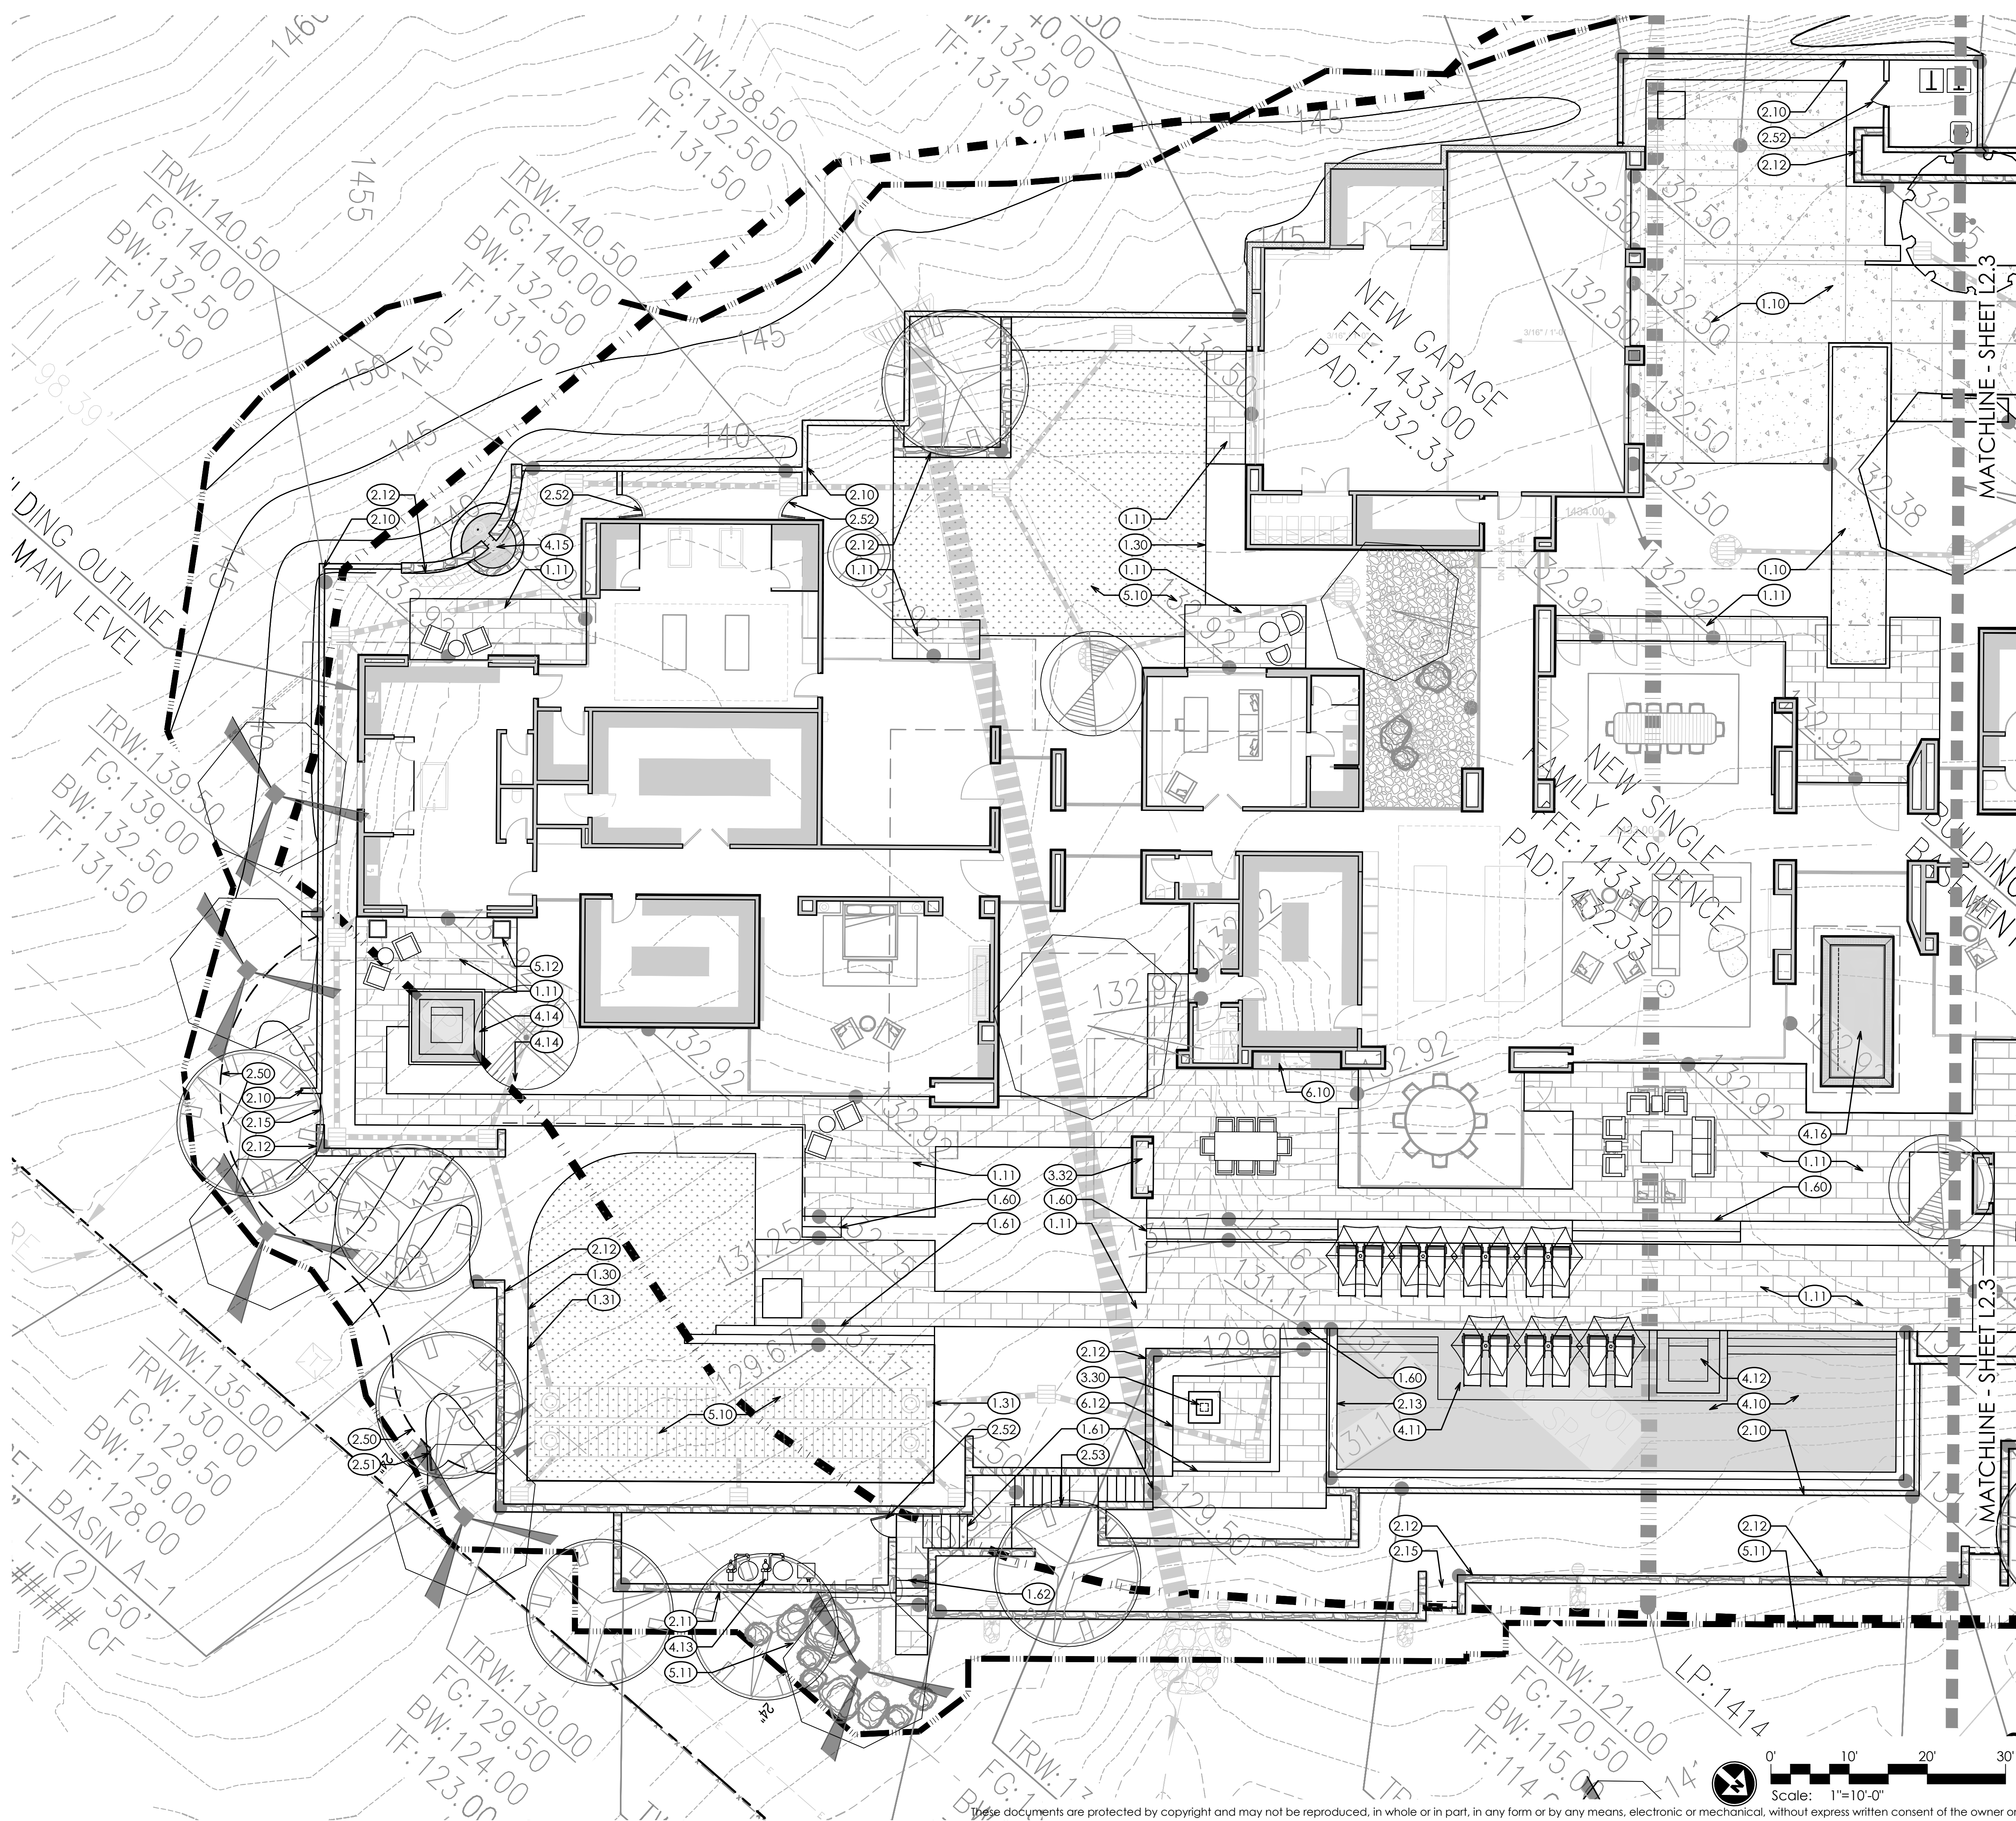

- KEY NOTES**
- 10 COLORED CONCRETE, LIGHT EXPOSED FINISHED, 3/8" MIX, COLOR TBD. SAW CUT JOINTS. 1/4" RADIUS EDGE.
 - 11 LARGE FORMAT PATIO PAVING, TBD. NOTE GRADE CHANGE AT EDGE OF PATIO, TURN DOWN CONDITIONS EXIST. MITER AND CARRY PATIO MATERIAL DOWN EXPOSED FACES OF PATIO.
 - 130 1/4" THICK STEEL ANGLE LANDSCAPE HEADER.
 - 13 1/4" THICK RAISED STEEL HEADER. 12" HIGH.
 - 130 1"-3" DESERT COBBLE AT ROOF TOP GARDEN.
 - 160 STEPS:16" TREAD, 6" RISER. FINISH TO MATCH KEYNOTE 1.11.
 - 16 STEPS:14" TREAD, 6" RISER. FINISH TO MATCH KEYNOTE 1.11.
 - 16 STEPS:12" TREAD, 6" RISER. FINISH TO MATCH KEYNOTE 1.11.
 - 10 8" WIDE MASONRY WALL, STUCCO AND PAINT FINISH TO MATCH ARCHITECTURE. FLAT STUCCO CAP, SLOPE TO DRAIN.
 - 11 12" WIDE MASONRY WALL, STUCCO AND PAINT FINISH TO MATCH ARCHITECTURE. FLAT STUCCO CAP, SLOPE TO DRAIN.
 - 12 8" WIDE MASONRY WALL, STONE VENEER WRAP TO CAP.
 - 13 8" WIDE MASONRY FEATURE WALL AT POOL WITH SCUPPERS. CLAD IN STONE TO MATCH ARCHITECTURE. WRAP STONE OVER FOR CAP.
 - 14 MAILBOX. TO MEET PV STANDARDS.
 - 13 STEEL PLATE WALL INSERT.
 - 250 FENCE, #4 REBAR PICKETS SPACED AT 4" ON CENTER.
 - 25 3'-0" WIDE GATE TO MATCH 2.50.
 - 250 3'-0" WIDE STEEL PANEL GATE.
 - 25 RAILING, PER ARCHITECT.
 - 33 STEEL FIRE PIT AT SUNKEN SEATING AREA.
 - 33 FIREPIT AT ROOFTOP DECK.
 - 33 FIREPLACE PER ARCHITECT.
 - 10 POOL WITH NEGATIVE EDGE.
 - 11 SUN SHELF AT POOL, 9" WATER DEPTH.
 - 11 INVISIBLE EDGE SPA.
 - 13 POOL EQUIPMENT LOCATION.
 - 14 RAISED NEGATIVE EDGE SPA, SPILLOVER ON ALL SIDES, 18" HIGH.
 - 13 FOUNTAIN AT MASTER BATH.
 - 14 FOUNTAIN WITH NEGATIVE EDGE AND FIRE BURNER FEATURE.
 - 510 SYNTHETIC TURF. ARTIFICIAL LAWNS CO. 'CORONADO' TURF. CONTRACTOR TO PROVIDE SAMPLE ON SITE FOR OWNER APPROVAL PRIOR TO PURCHASE OR INSTALL.
 - 11 BOULDERS TO BE FIELD LOCATED BY LANDSCAPE ARCHITECT. CONTRACTOR TO SALVAGE LARGER BOULDERS DURING SITE EXCAVATION, FOR REUSE IN LANDSCAPE. BOULDERS TO MATCH NATURAL HILLSIDE ROCK, NO SURFACE SELECT.
 - 512 PLANTER POT. CONTRACTOR TO PROVIDE PLUMBING AND SLEEVING FOR IRRIGATION AND DRAINAGE.
 - 10 BBQ COUNTER, PER ARCHITECT.
 - 11 PASS THROUGH WINDOW BAR COUNTER, PER ARCHITECT.
 - 14 BUILT IN SEATING. 9" THICK CAST CONCRETE CAP WITH HIDDEN LED LIGHT STRIP.
- NOTES:**
1. WALLS: IF RETAINING DAMP PROOF AND GROUT ALL CELLS BELOW GRADE. SEE PLAN FOR HEIGHT.
 2. ALL GATES AND FENCING TO MEET POOL BARRIER STANDARDS.
 3. POOL CONTRACTOR TO PROVIDE SHOP DRAWINGS TO LANDSCAPE ARCHITECT FOR APPROVAL PRIOR TO CONSTRUCTION.
 4. CONCRETE COLOR TO BE SELECTED BY OWNER. CONTRACTOR TO PROVIDE 2'X2' SAMPLE OF PROPOSED CONCRETE COLOR AND FINISH FOR APPROVAL BY OWNER PRIOR TO INSTALLATION.
 5. ALL STEEL TO BE ELECTROSTATIC PAINTED TO MATCH ARCHITECTURAL STEEL. GRIND ALL WELDS SMOOTH.
 6. ALL SPOT ELEVATIONS AND CALLOUTS ARE FOR DESIGN INTENT PURPOSES ONLY. REFER TO CIVIL PLAN FOR ALL GRADING AND DRAINAGE INFORMATION.
 7. CONTRACTOR TO PROVIDE SAMPLES ON SITE OF ALL PROPOSED MATERIALS, FOR APPROVAL BY OWNER PRIOR TO PURCHASE OR INSTALL.

GREY PICKETT
landscape architecture community design
7144 e session drive, suite 205
paradise valley, az 85253
480.609.0009p 480.609.0068t

ROADRUNNER RESIDENCE


5611 E. Roadrunner Ln.
Paradise Valley, AZ. 85253

project #: SAA112
scale: 1"=10'-0"
issued for:
drawing: Enlarged Layout Plan
date: 03/19/2026
drawn by: TEAM

revisions:

L2.2
of

Copyright © 2014 by Grey | Pickett Professional Corp.

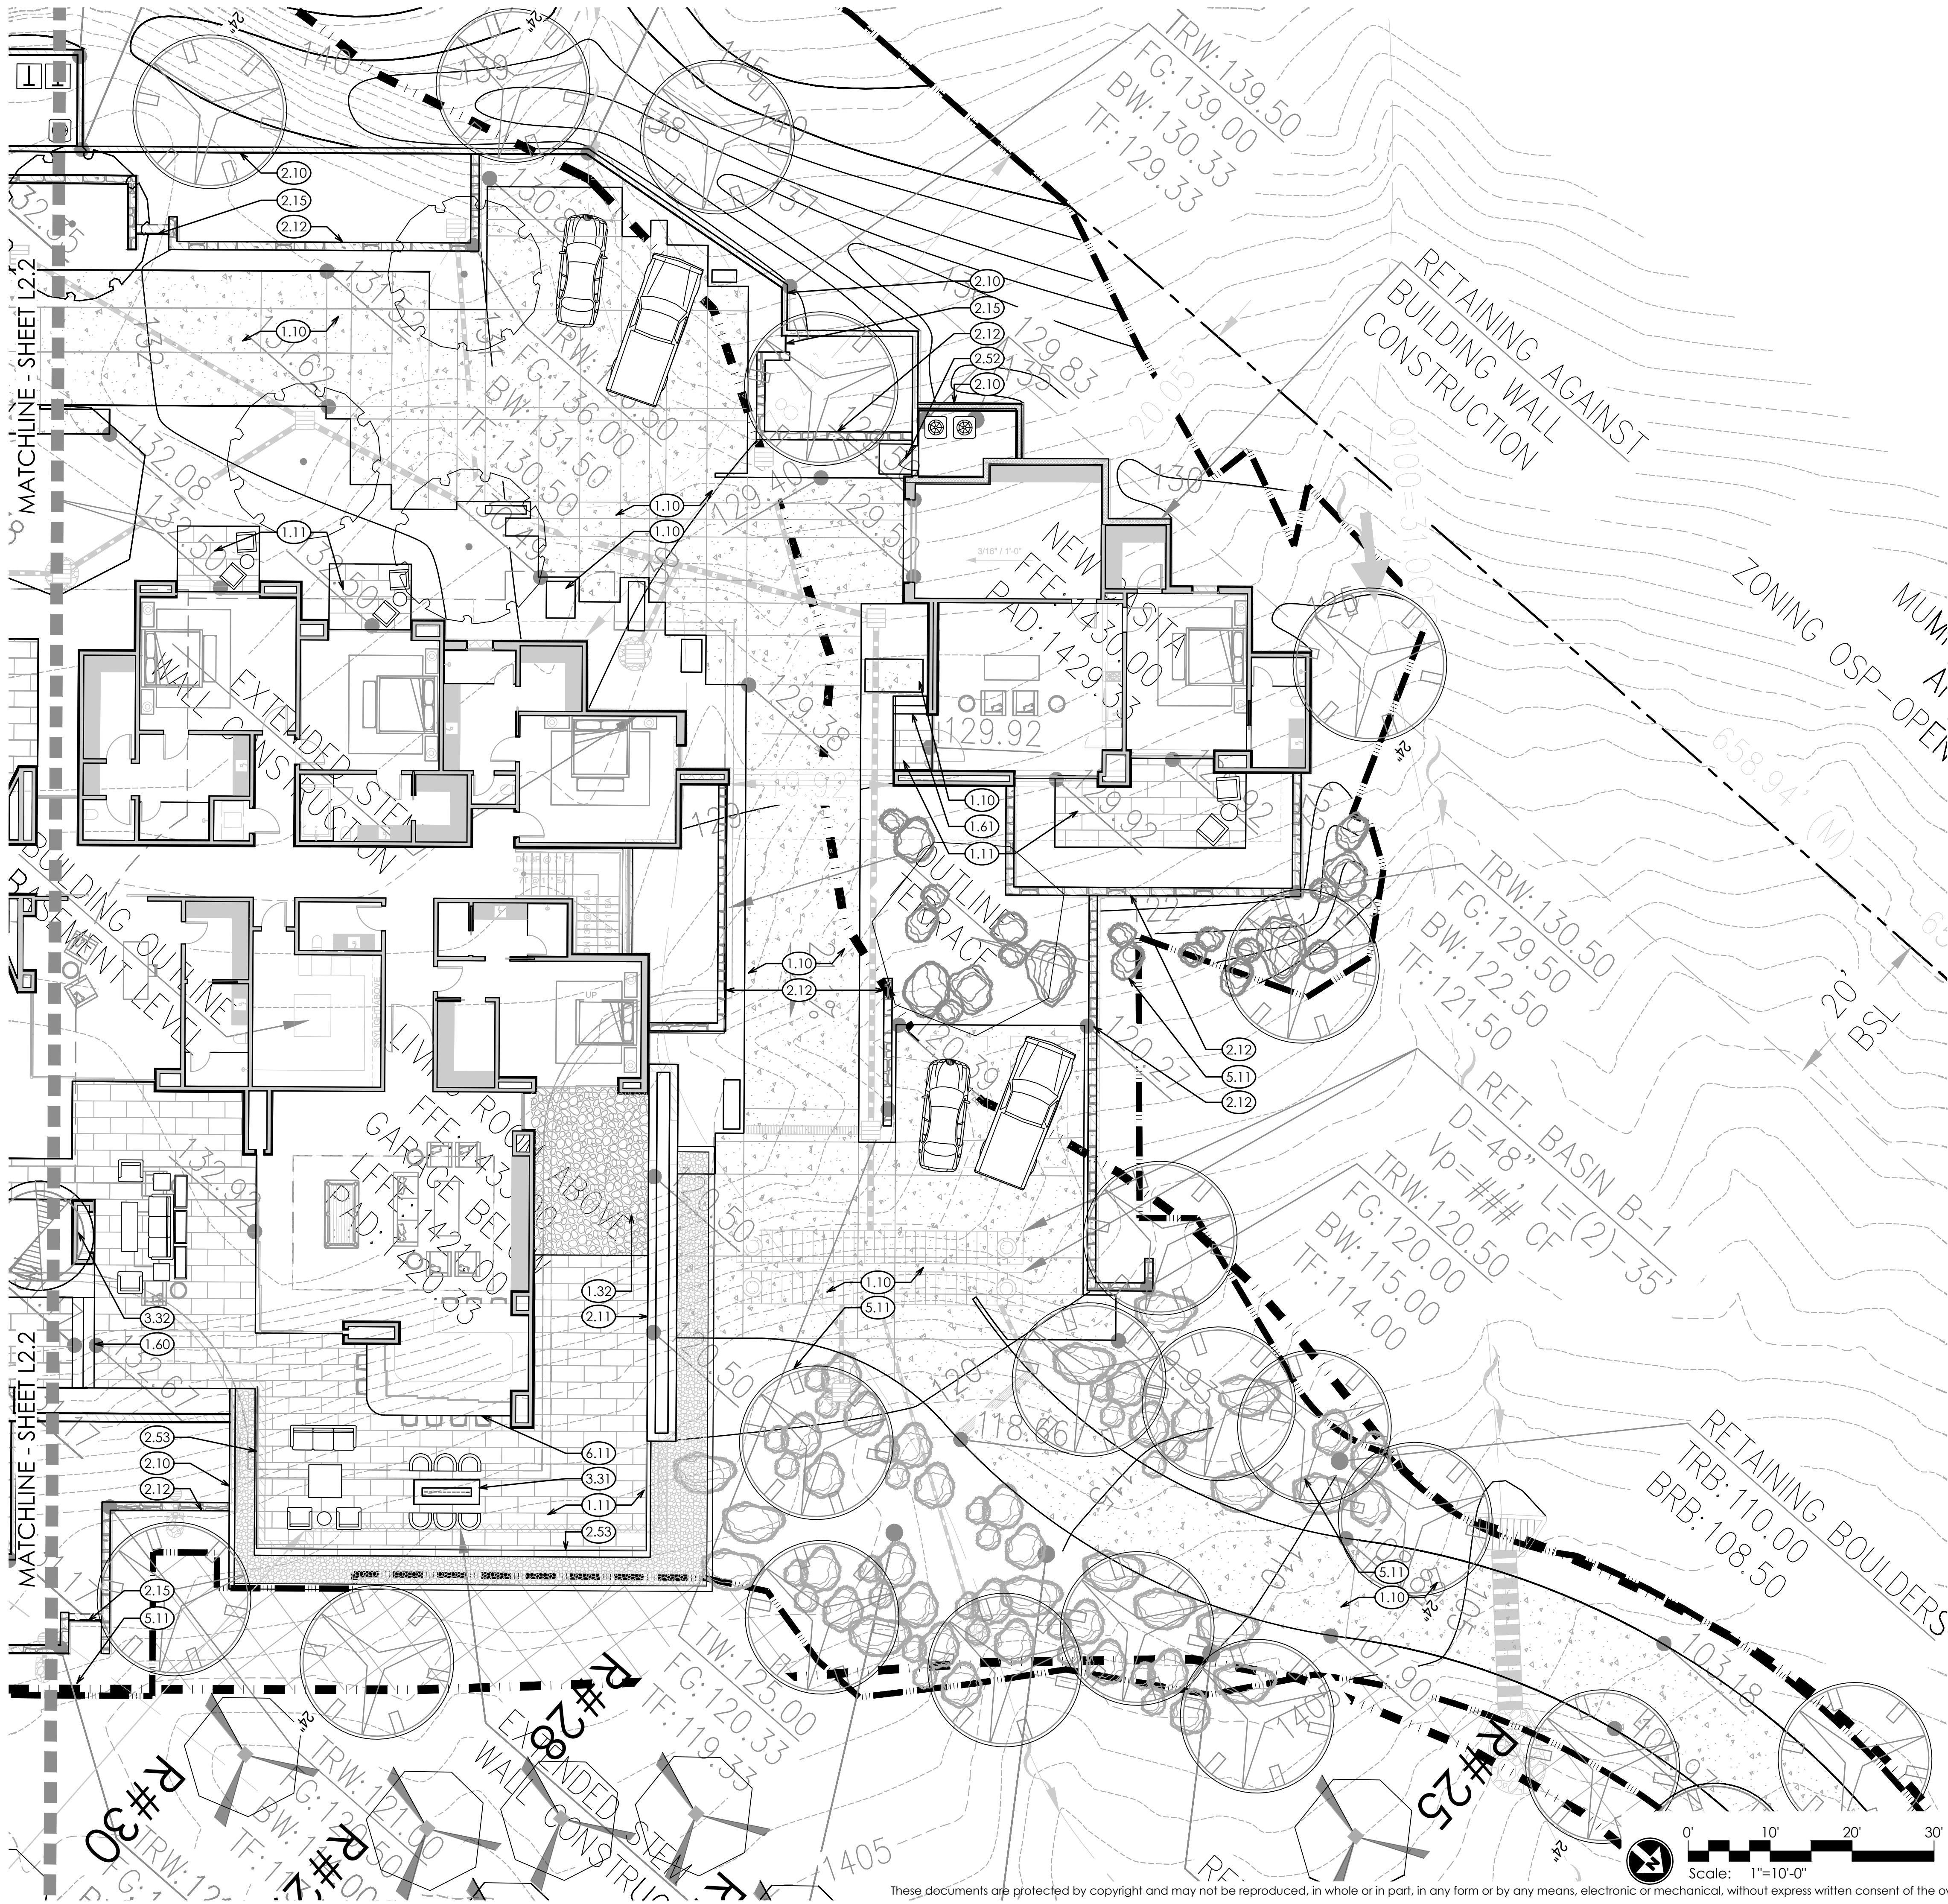


KEY NOTES

- 1.10 COLORED CONCRETE, LIGHT EXPOSED FINISHED, 3/8" MIX, COLOR TBD. SAW CUT JOINTS. 1/4" RADIUS EDGE.
- 1.11 LARGE FORMAT PATIO PAVING, TBD. NOTE GRADE CHANGE AT EDGE OF PATIO, TURN DOWN CONDITIONS EXIST. MITER AND CARRY PATIO MATERIAL DOWN EXPOSED FACES OF PATIO.
- 1.30 1/4" THICK STEEL ANGLE LANDSCAPE HEADER.
- 1.31 1/4" THICK RAISED STEEL HEADER. 12" HIGH.
- 1.32 1"X3" DESERT COBBLE AT ROOF TOP GARDEN.
- 1.60 STEPS:16" TREAD, 6" RISER. FINISH TO MATCH KEYNOTE 1.11.
- 1.61 STEPS:14" TREAD, 6" RISER. FINISH TO MATCH KEYNOTE 1.11.
- 1.62 STEPS:12" TREAD,6" RISER. FINISH TO MATCH KEYNOTE 1.11.
- 2.10 8" WIDE MASONRY WALL, STUCCO AND PAINT FINISH TO MATCH ARCHITECTURE. FLAT STUCCO CAP, SLOPE TO DRAIN.
- 2.11 12" WIDE MASONRY WALL, STUCCO AND PAINT FINISH TO MATCH ARCHITECTURE. FLAT STUCCO CAP, SLOPE TO DRAIN.
- 2.12 8" WIDE MASONRY WALL, STONE VENEER WRAP TO CAP.
- 2.13 8" WIDE MASONRY FEATURE WALL AT POOL WITH SCUPPERS. CLAD IN STONE TO MATCH ARCHITECTURE. WRAP STONE OVER FOR CAP.
- 2.14 MAILBOX. TO MEET PV STANDARDS.
- 2.15 STEEL PLATE WALL INSERT.
- 2.50 FENCE, #4 REBAR PICKETS SPACED AT 4" ON CENTER.
- 2.51 3'-0" WIDE GATE TO MATCH 2.50.
- 2.52 3'-0" WIDE STEEL PANEL GATE.
- 2.53 RAILING, PER ARCHITECT.
- 3.30 STEEL FIRE PIT AT SUNKEN SEATING AREA.
- 3.31 FIREPIT AT ROOFTOP DECK.
- 3.32 FIREPLACE PER ARCHITECT.
- 4.10 POOL WITH NEGATIVE EDGE.
- 4.11 SUN SHELF AT POOL, 9" WATER DEPTH.
- 4.12 INVISIBLE EDGE SPA.
- 4.13 POOL EQUIPMENT LOCATION.
- 4.14 RAISED NEGATIVE EDGE SPA. SPILLOVER ON ALL SIDES. 18" HIGH.
- 4.15 FOUNTAIN AT MASTER BATH.
- 4.16 FOUNTAIN WITH NEGATIVE EDGE AND FIRE BURNER FEATURE.
- 5.10 SYNTHETIC TURF. ARTIFICIAL LAWNS CO. 'CORONADO' TURF. CONTRACTOR TO PROVIDE SAMPLE ON SITE FOR OWNER APPROVAL PRIOR TO PURCHASE OR INSTALL.
- 5.11 BOULDERS TO BE FIELD LOCATED BY LANDSCAPE ARCHITECT. CONTRACTOR TO SALVAGE LARGER BOULDERS DURING SITE EXCAVATION, FOR REUSE IN LANDSCAPE. BOULDERS TO MATCH NATURAL HILLSIDE ROCK, NO SURFACE SELECT.
- 5.12 PLANTER POT. CONTRACTOR TO PROVIDE PLUMBING AND SLEEVING FOR IRRIGATION AND DRAINAGE.
- 6.10 BBQ COUNTER, PER ARCHITECT.
- 6.11 PASS THROUGH WINDOW BAR COUNTER, PER ARCHITECT.
- 6.12 BUILT IN SEATING. 9" THICK CAST CONCRETE CAP WITH HIDDEN LED LIGHT STRIP.

NOTES:

- WALLS: IF RETAINING DAMP PROOF AND GROUT ALL CELLS BELOW GRADE. SEE PLAN FOR HEIGHT.
- ALL GATES AND FENCING TO MEET POOL BARRIER STANDARDS.
- POOL CONTRACTOR TO PROVIDE SHOP DRAWINGS TO LANDSCAPE ARCHITECT FOR APPROVAL PRIOR TO CONSTRUCTION.
- CONCRETE COLOR TO BE SELECTED BY OWNER. CONTRACTOR TO PROVIDE 2'X2' SAMPLE OF PROPOSED CONCRETE COLOR AND FINISH FOR APPROVAL BY OWNER PRIOR TO INSTALLATION.
- ALL STEEL TO BE ELECTROSTATIC PAINTED TO MATCH ARCHITECTURAL STEEL. GRIND ALL WELDS SMOOTH.
- ALL SPOT ELEVATIONS AND CALLOUTS ARE FOR DESIGN INTENT PURPOSES ONLY.REFER TO CIVIL PLAN FOR ALL GRADING AND DRAINAGE INFORMATION.
- CONTRACTOR TO PROVIDE SAMPLES ONSITE OF ALL PROPOSED MATERIALS, FOR APPROVAL BY OWNER PRIOR TO PURCHASE OR INSTALL.



project #:
SAA112

scale:
1"=10'-0"
issued for:

drawn by:
TEAM

date:
03/19/2026

drawing:
Enlarged Layout Plan


L2.3

of



ROADRUNNER RESIDENCE

5611 E. Roadrunner Ln.
Paradise Valley, AZ. 85253

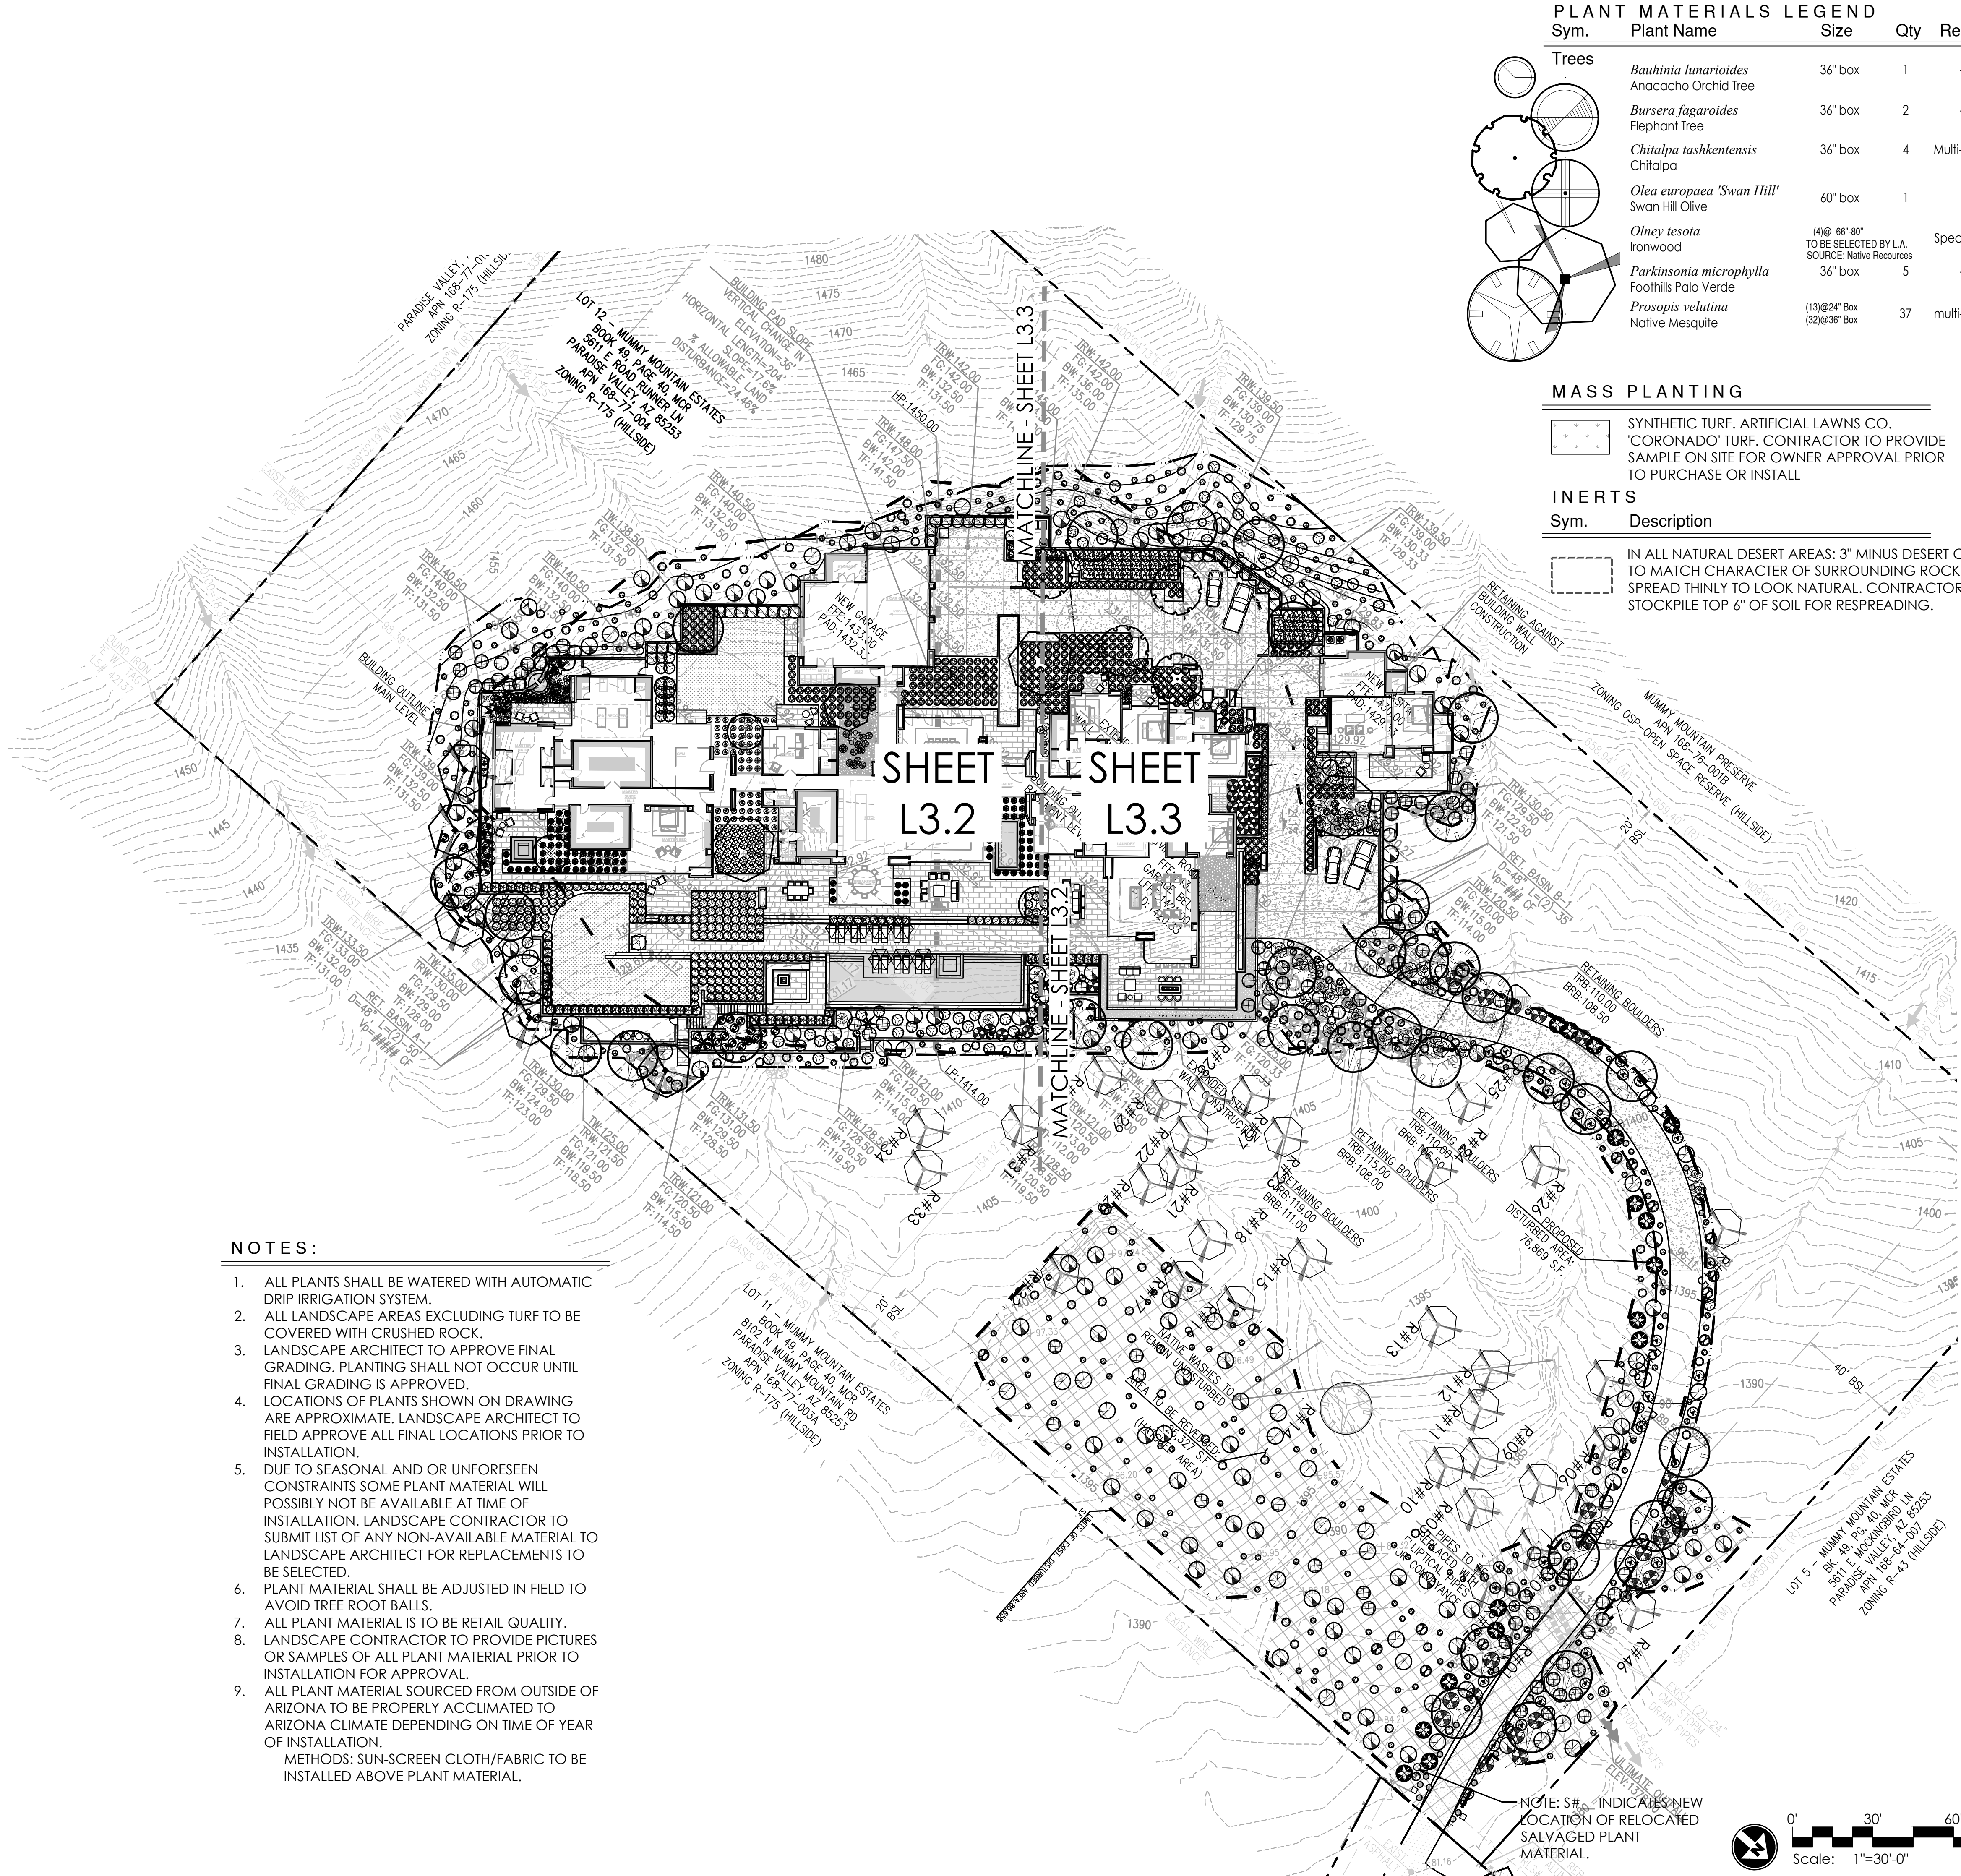

- NOTES:
- ALL PLANTS SHALL BE WATERED WITH AUTOMATIC DRIP IRRIGATION SYSTEM.
 - ALL LANDSCAPE AREAS EXCLUDING TURF TO BE COVERED WITH CRUSHED ROCK.
 - LANDSCAPE ARCHITECT TO APPROVE FINAL GRADING. PLANTING SHALL NOT OCCUR UNTIL FINAL GRADING IS APPROVED.
 - LOCATIONS OF PLANTS SHOWN ON DRAWING ARE APPROXIMATE. LANDSCAPE ARCHITECT TO FIELD APPROVE ALL FINAL LOCATIONS PRIOR TO INSTALLATION.
 - DUE TO SEASONAL AND OR UNFORESEEN CONSTRAINTS SOME PLANT MATERIAL WILL POSSIBLY NOT BE AVAILABLE AT TIME OF INSTALLATION. LANDSCAPE CONTRACTOR TO SUBMIT LIST OF ANY NON-AVAILABLE MATERIAL TO LANDSCAPE ARCHITECT FOR REPLACEMENTS TO BE SELECTED.
 - PLANT MATERIAL SHALL BE ADJUSTED IN FIELD TO AVOID TREE ROOT BALLS.
 - ALL PLANT MATERIAL IS TO BE RETAIL QUALITY.
 - LANDSCAPE CONTRACTOR TO PROVIDE PICTURES OR SAMPLES OF ALL PLANT MATERIAL PRIOR TO INSTALLATION FOR APPROVAL.
 - ALL PLANT MATERIAL SOURCED FROM OUTSIDE OF ARIZONA TO BE PROPERLY ACCLIMATED TO ARIZONA CLIMATE DEPENDING ON TIME OF YEAR OF INSTALLATION.
METHODS: SUN-SCREEN CLOTH/FABRIC TO BE INSTALLED ABOVE PLANT MATERIAL.

PLANT MATERIALS LEGEND				
Sym.	Plant Name	Size	Qty	Remarks
Trees				
	<i>Bauhinia lunarioides</i> Anacacho Orchid Tree	36" box	1	-
	<i>Bursera fagaroides</i> Elephant Tree	36" box	2	-
	<i>Chitalpa tashkentensis</i> Chitalpa	36" box	4	Multi-Trunk
	<i>Olea europaea</i> 'Swan Hill' Swan Hill Olive	60" box	1	-
	<i>Olney tesota</i> Ironwood	(4)@ 66"-80" TO BE SELECTED BY L.A. SOURCE: Native Resources	1	Specimen
	<i>Parkinsonia microphylla</i> Foothills Palo Verde	36" box	5	-
	<i>Prosopis velutina</i> Native Mesquite	(13)@24" Box (32)@36" Box	37	multi-trunk
Shrubs				
	<i>Ambrosia deltoidea</i>	1 gal.	320	-
	Triangle Leaf Bursage			
	<i>Bouteloua gracilis</i> 'Blonde Ambition'	1 gal.	365	-
	Blonde Ambition Blue Grama			
	<i>Calliandra eriophylla</i> Pink Fairy Duster	1 gal.	17	-
	<i>Dianella revoluta</i> 'Little Rev'	1 gal.	104	-
	Little Rev Flax Lily			
	<i>Dodonaea viscosa</i> Hop Bush	5 gal.	34	-
	<i>Eriogonum fasciculatum</i> Flat Top Buckwheat	1 gal.	74	-
	<i>Justicia californica</i> Chuparosa	5 gal.	96	-
	<i>Larrea tridentata</i> Creosote	5 gal.	104	-
	<i>Lavandula multifida</i> Femleaf Lavender	5 gal.	24	-
	<i>Muhlenbergia rigens</i> Deer Grass	1 gal.	37	-
	<i>Olea europaea</i> 'Montra'	5 gal.	55	-
	Little Olie Dwarf Olie			
	<i>Penstemon parryi</i> Perry's Penstemon	1 gal.	10	-
	<i>Perovskia atriplicifolia</i> Russian Sage	1 gal.	200	-
	<i>Salvia clevelandii</i> Chaparral Sage	5 gal.	16	-
	<i>Simmondsia chinensis</i> Jojoba	5 gal.	43	-
	<i>Sphaeralcea ambigua</i> Globe Mallow	5 gal.	108	-
	<i>Vaqueria californica</i> Arizona Rosewood	5 gal.	3	-
	<i>Viguiera deltoidea</i> Goldeneye	1 gal.	27	-
	<i>Vitex trifolia</i> 'Purpurea' Arabian Lilac	5 gal.	9	-
Groundcovers				
	<i>Glandularia pulchella</i> Moss Verbena	1 gal.	25	-
	<i>Melampodium leucanthum</i> Blackfoot Daisy	1 gal.	12	-
Accents				
	<i>Agave americana</i> Century Plant	15 gal.	3	-
	<i>Agave bovicornuta</i> Cow Horn Agave	15 gal.	3	-
	<i>Agave ovatifolia</i> Whale's Tongue Agave	15 gal.	3	-
	<i>Agave requiliana</i> Weber Blue Agave	15 gal.	2	-
	<i>Agave weberi</i> Blue Agave	5 gal.	8	-
	<i>Agave x 'Blue Glow'</i> Blue Glow Agave	15 gal.	5	-
	<i>Aloe barbadensis</i> Medicinal Aloe	5 gal.	17	-
	<i>Aloe rudiokoppe</i> Little Red Riding Hood Aloe	5 gal.	63	-
	<i>Asclepias subulata</i> Desert Milkweed	5 gal.	4	-
	<i>Dasyliroton wheeleri</i> Desert Spoon	5 gal.	2	-
	<i>Euphorbia antisyphilitica</i> Candelilla	5 gal.	6	-
	<i>Euphorbia ingens</i> 'Chocolate Drop' Chocolate Drop Cactus	15 gal.	6	-
	<i>Euphorbia royleana</i> Churee	15 gal.	1	-
	<i>Fouquieria splendens</i> Ocotillo	Large bare root	4	-
	<i>Opuntia basilaris</i> 'Baby Rita' Baby Rita Prickly Pear	5 gal.	35	-
	<i>Opuntia engelmannii</i> Engelmann's Prickly Pear	5 gal.	22	-
	<i>Opuntia ficus-indica</i> Indian Fig	15 gal.	7	-
	<i>Opuntia gomei</i> 'Old Mexico' Old Mexico Prickly Pear	5 gal.	31	-
	<i>Opuntia violacea santa-rita</i> Purple Prickly Pear	5 gal.	54	-
	<i>Pachycereus pringlei</i> Cordon	(5)@5" (2)@8" (1)@10"	(2)@3" (4)@4" (3)@5"	17 total
	<i>Pachycereus schottii f. monstrosus</i> Totem Pole Cactus	(4)@2" (2)@3"	6 total	-
	<i>Stenocereus marginatus</i> Mexican Fence Post	15 gal.	3	-
	<i>Yucca baccata</i> Banana Yucca	5 gal.	36	-
	<i>Yucca filifera</i> Tree Yucca	15 gal.	5	-
	<i>Yucca rostrata</i> Beaked Yucca	48" box	1	specimen "natural trunk"
SALVAGE PLANT MATERIALS LEGEND				
Sym.	Plant Name	Salvage Tag	Qty	
	<i>Parkinsonia microphylla</i> Foothills Palo Verde	S#44	1	
	<i>Carnegiea gigantea</i> Saguaro	S#19	1	

GREY PICKETT
landscape architecture community design

7144 E. Mission Drive, Suite 205
Paradise Valley, AZ 85253
480.609.0009p 480.609.0068t

28448
RUSSELL E.
GREY
Landscape Architect
Expires 12/31/26

CALL TWO WORKING DAYS
BEFORE YOU DIG
(602) 262-1100
1-800-STAKE-IT
(TOLL FREE IN ARIZONA)

ROADRUNNER RESIDENCE

5611 E. Roadrunner Ln.
Paradise Valley, AZ. 85253

project #:
SAA112

scale:
1"=30'-0"

issued for:

drawn by:
TEAM


date:
03/19/2026

drawing:
Overall Planting Plan

L3.1

of

Copyright © 2014 by
Grey | Pickett Professional Corp.

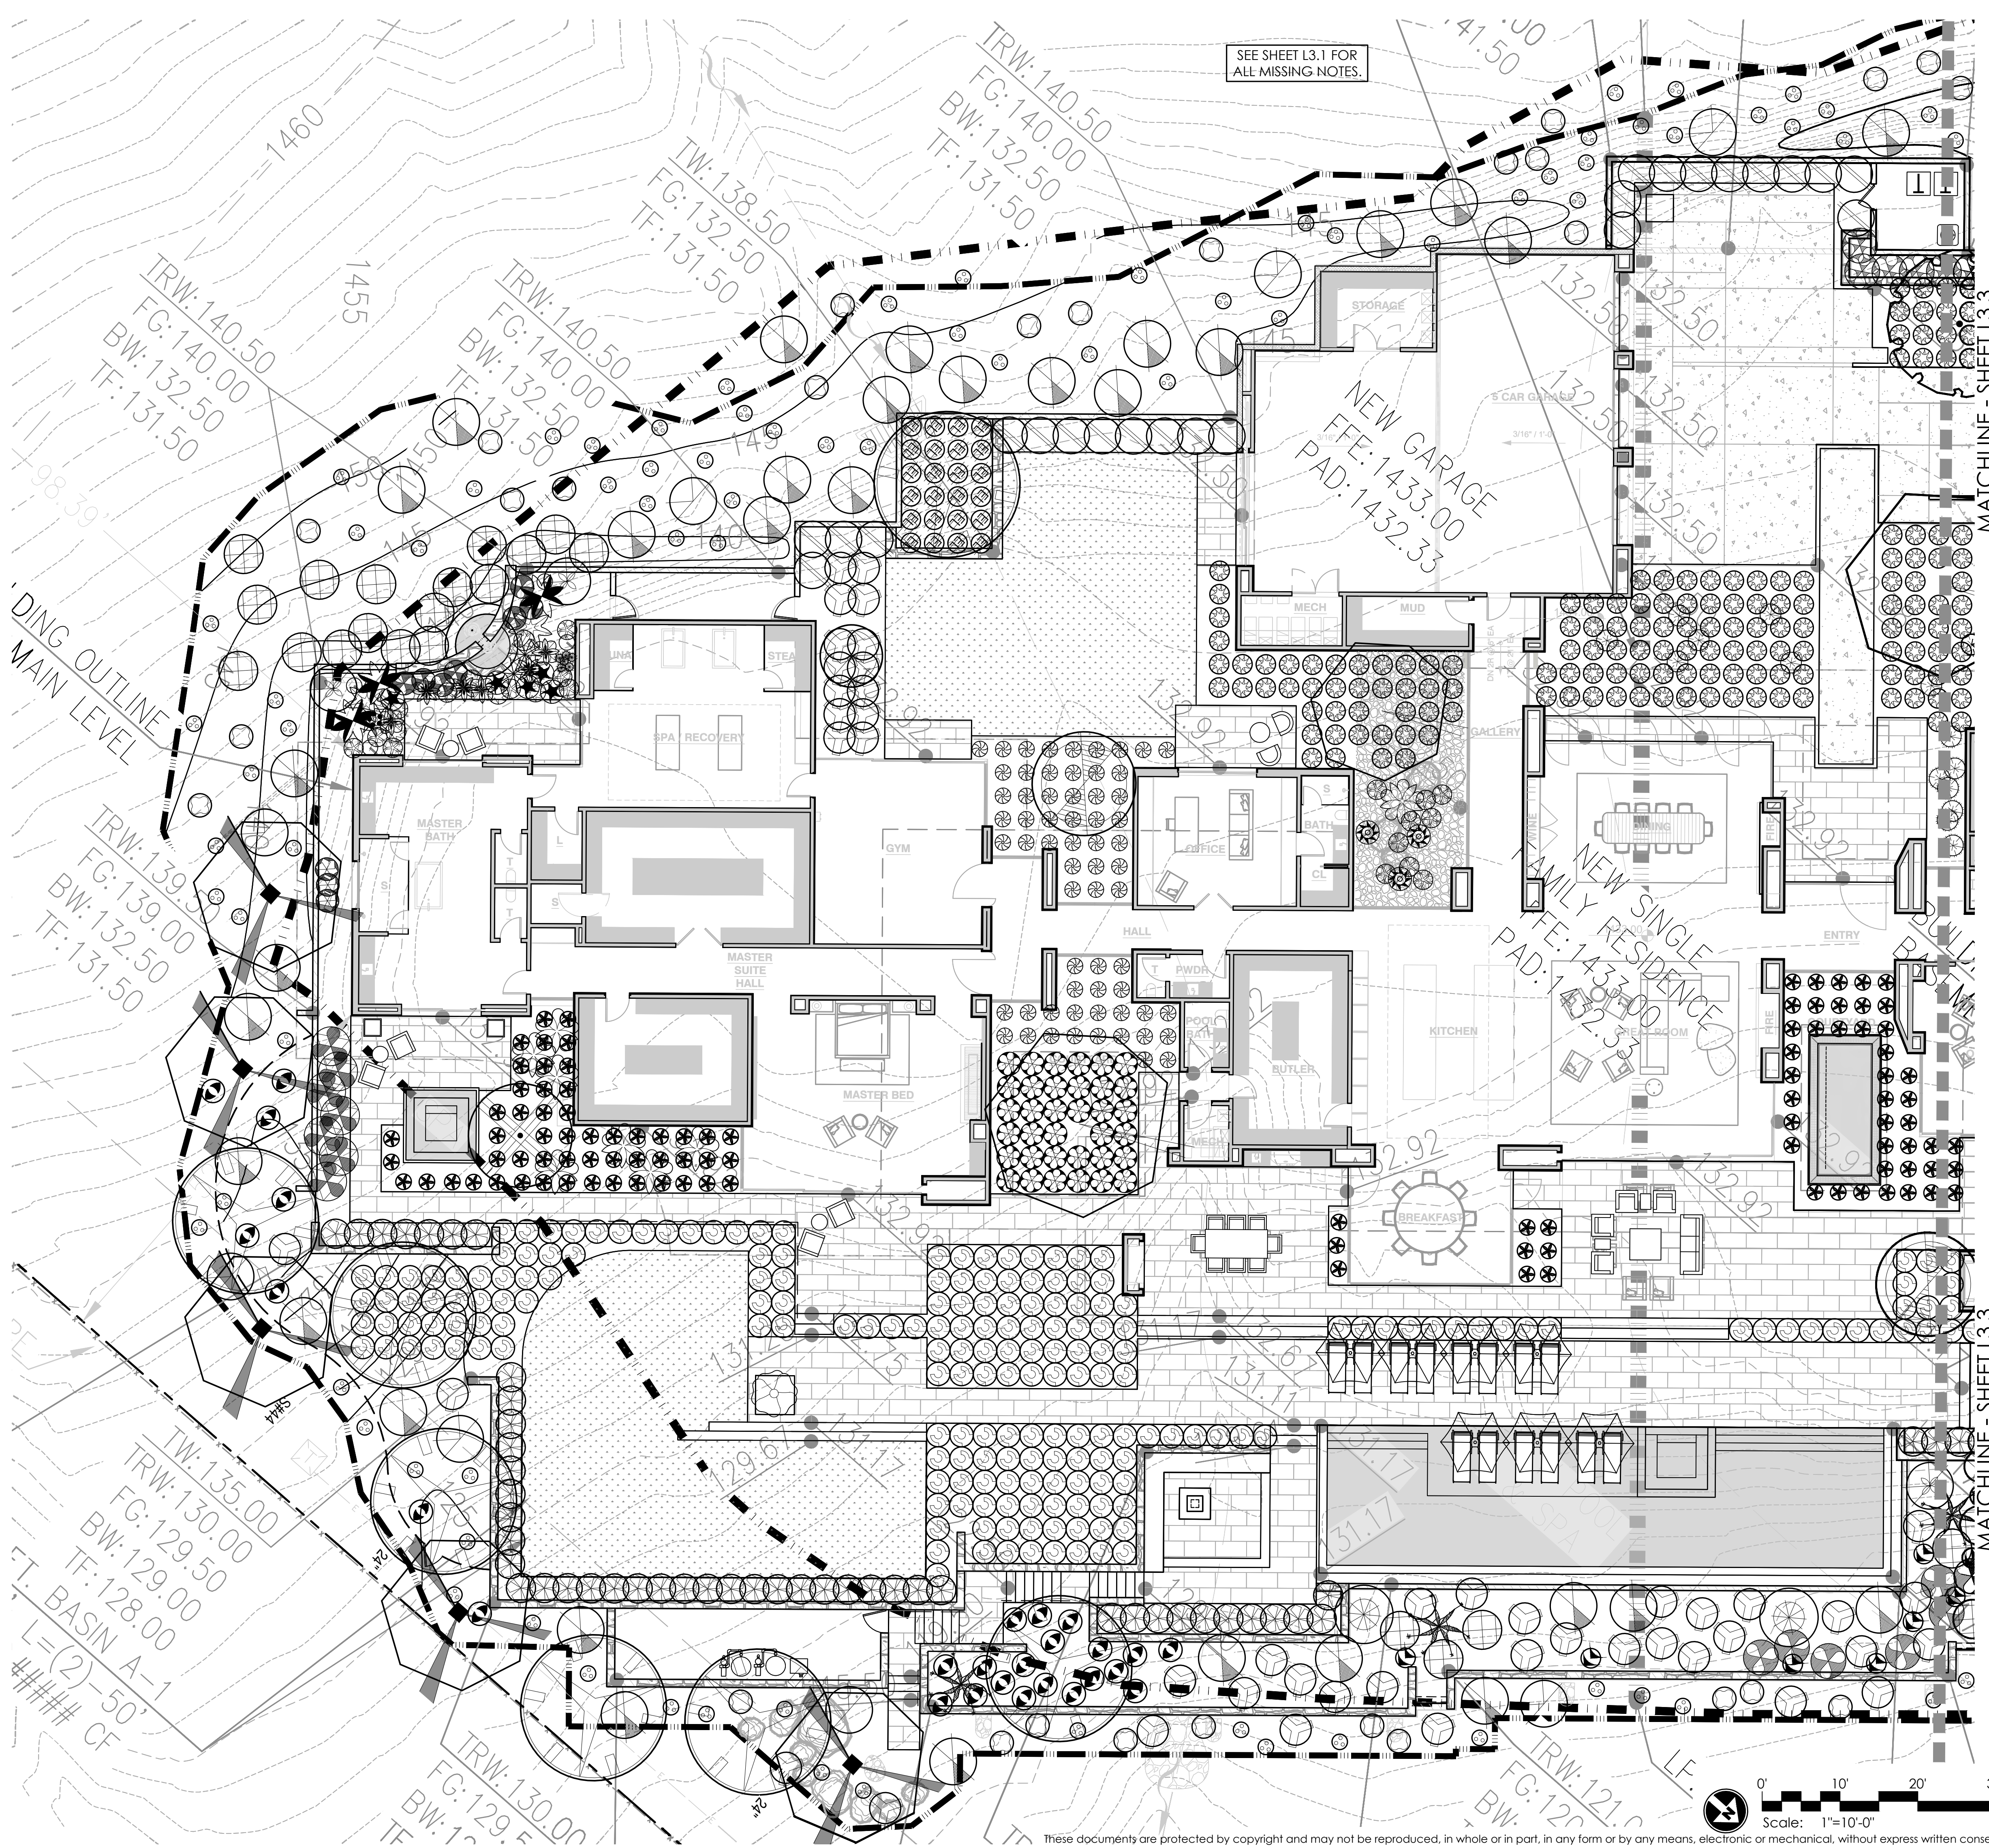

SEE SHEET L3.1 FOR ALL MISSING NOTES.

PLANT	MATERIALS	LEGEND			
Sym.	Plant Name	Size	Qty	Remarks	

	Trees				
	<i>Bauhinia lunarioides</i> Anacacho Orchid Tree	36" box	1	-	
	<i>Bursera fagaroides</i> Elephant Tree	36" box	2	-	
	<i>Chitalpa tashkentensis</i> Chitalpa	36" box	4	Multi-Trunk	
	<i>Olea europaea</i> 'Swan Hill' Swan Hill Olive	60" box	1	-	
	<i>Olneya tesota</i> Ironwood	(4)@ 66" 80" TO BE SELECTED BY L.A. SOURCE: Native Resources		Specimen	
	<i>Parkinsonia microphylla</i> Foothills Palo Verde	36" box	5	-	
	<i>Prosopis velutina</i> Native Mesquite	(13)@ 24" Box (32)@ 36" Box	37	multi-trunk	
	Shrubs				
	<i>Ambrosia deltoidea</i> Triangle Leaf Bursage	1 gal.	320	-	
	<i>Bouteloua gracilis</i> 'Blonde Ambition' Blonde Ambition Blue Grama	1 gal.	365	-	
	<i>Calliandra eriophylla</i> Pink Fairy Duster	1 gal.	17	-	
	<i>Dianella revoluta</i> 'Little Rev' Little Rev Flax Lily	1 gal.	104	-	
	<i>Dodonaea viscosa</i> Hop Bush	5 gal.	34	-	
	<i>Eriogonum fasciculatum</i> Flat Top Buckwheat	1 gal.	74	-	
	<i>Justicia californica</i> Chuparosa	5 gal.	96	-	
	<i>Larrea tridentata</i> Creosote	5 gal.	104	-	
	<i>Lavandula multifida</i> Femleaf Lavender	5 gal.	24	-	
	<i>Muhlenbergia rigens</i> Deer Grass	1 gal.	37	-	
	<i>Olea europaea</i> 'Montra' Little Ollie Dwarf Ollie	5 gal.	55	-	
	<i>Penstemon parryi</i> Perry's Penstemon	1 gal.	10	-	
	<i>Perovskia atriplicifolia</i> Russian Sage	1 gal.	200	-	
	<i>Salvia clevelandii</i> Chaparral Sage	5 gal.	16	-	
	<i>Simmondsia chinensis</i> Jojoba	5 gal.	43	-	
	<i>Sphaeralcea ambigua</i> Globe Mallow	5 gal.	108	-	
	<i>Vaqueria californica</i> Arizona Rosewood	5 gal.	3	-	
	<i>Viguiera deltoidea</i> Goldeneye	1 gal.	27	-	
	<i>Vitex trifolia</i> 'Purpurea' Arabian Lilac	5 gal.	9	-	
	Groundcovers				
	<i>Glandularia pulchella</i> Moss Verbena	1 gal.	25	-	
	<i>Melampodium leucanthum</i> Blackfoot Daisy	1 gal.	12	-	
	Accents Cactus				
	<i>Agave americana</i> Century Plant	15 gal.	3	-	
	<i>Agave bovicornuta</i> Cow Horn Agave	15 gal.	3	-	
	<i>Agave ovatifolia</i> Whale's Tongue Agave	15 gal.	3	-	
	<i>Agave tequilana</i> Weber Blue Agave	15 gal.	2	-	
	<i>Agave weberi</i> Blue Agave	5 gal.	8	-	
	<i>Agave x 'Blue Glow'</i> Blue Glow Agave	15 gal.	5	-	
	<i>Aloe barbadensis</i> Medicinal Aloe	5 gal.	17	-	
	<i>Aloe rudikoppae</i> Little Red Riding Hood Aloe	5 gal.	63	-	
	<i>Asclepias tuberosa</i> Desert Milkweed	5 gal.	4	-	
	<i>Dasylium wheeleri</i> Desert Spoon	5 gal.	2	-	
	<i>Euphorbia antisyphilitica</i> Candelilla	5 gal.	6	-	
	<i>Euphorbia ingens</i> 'Chocolate Drop' Chocolate Drop Cactus	15 gal.	6	-	
	<i>Euphorbia royleana</i> Churee	15 gal.	1	-	
	<i>Fouquieria splendens</i> Ocotillo	Large bare root	4	-	
	<i>Opuntia basilaris</i> 'Baby Rita' Baby Rita Prickly Pear	5 gal.	35	-	
	<i>Opuntia engelmannii</i> Engelmann's Prickly Pear	5 gal.	22	-	
	<i>Opuntia ficus-indica</i> Indian Fig	15 gal.	7	-	
	<i>Opuntia gomei</i> 'Old Mexico' Old Mexico Prickly Pear	5 gal.	31	-	
	<i>Opuntia violacea</i> 'Santa Rita' Purple Prickly Pear	5 gal.	54	-	
	<i>Pachycereus pringlei</i> Cardon	(5)@ 6" (2)@ 8" (1)@ 10"	(2)@ 8" (4)@ 8" (3)@ 5"	17 total	
	<i>Pachycereus schottii</i> f. <i>monstrosus</i> Totem Pole Cactus	(4)@ 2" (2)@ 3"		6 total	
	<i>Stenocereus marginatus</i> Mexican Fence Post	15 gal.	3	-	
	<i>Yucca baccata</i> Banana Yucca	5 gal.	36	-	
	<i>Yucca filifera</i> Tree Yucca	15 gal.	5	-	
	<i>Yucca rostrata</i> Beaked Yucca	48" box	1	specimen	
	Revisions				
	project #:				
	SAA112				
	scale:				
	1"=10'-0"				
	issued for:				
	drawn by:				
	TEAM				
	date:				
	03/19/2026				
	drawing:				
	Enlarged Planting Plan				

GREY PICKETT

landscape architecture community design

7144 e session drive suite 205

paradise valley, az 85253

480.609.0009p 480.609.0068t

28418

RUSSELL E. GREY

LANDSCAPE ARCHITECT

SEAL

EXPIRES 12/31/26

CALL TWO WORKING DAYS BEFORE YOU DIG

(602) 262-1100

1-800-STAKE-IT

(DO NOT ACCEPT COUNTY)

ROADRUNNER RESIDENCE

5611 E. Roadrunner Ln.

Paradise Valley, AZ. 85253

revisions:

project #:

SAA112

scale:

1"=10'-0"

issued for:

drawn by:

TEAM

date:

03/19/2026

drawing:


Enlarged Planting Plan

L3.2

of

Copyright © 2014 by

Greedy Pickett Professional Corp.




	Trees				
	<i>Baubinia lunarioides</i>	36" box	1	-	
	<i>Anacacho Orchid Tree</i>				
	<i>Bursera fagaroides</i>	36" box	2	-	
	Elephant Tree				
	<i>Chitalpa tashkentensis</i>	36" box	4	Multi-Trunk	
	Chitalpa				
	<i>Olea europaea 'Swan Hill'</i>	60" box	1		
	Swan Hill Olive				
	<i>Olney tesota</i>	(4)@ 65"-80" TO BE SELECTED BY L.A. SOURCE: Native Resources		Specimen	
	Ironwood	36" box	5	-	
	<i>Parkinsonia microphylla</i>				
	Foothills Palo Verde				
	<i>Prosopis velutina</i>	(13)@24" Box (32)@36" Box	37	multi-trunk	
Native Mesquite					
	Shrubs				
	<i>Ambrosia deltoidea</i>	1 gal.	320	-	
	Triangle Leaf Bursage				
	<i>Bouteloua gracilis 'Blonde Ambition'</i>		365	-	
	Blonde Ambition Blue Grama	1 gal.			
	<i>Calliandra eriophylla</i>	1 gal.	17	-	
	Pink Fairy Duster				
	<i>Dianella revoluta 'Little Rev'</i>	1 gal.	104	-	
	Little Rev Flax Lily				
	<i>Dodonaea viscosa</i>	5 gal.	34	-	
	Hop Bush				
	<i>Eriogonum fasciculatum</i>	1 gal.	74	-	
	Flat Top Buckwheat				
	<i>Justicia californica</i>	5 gal.	96	-	
	Chuparosa				
	<i>Larrea tridentata</i>	5 gal.	104	-	
	Creosote				
	<i>Lavandula multifida</i>	5 gal.	24	-	
	Fernleaf Lavender				
	<i>Muhlenbergia rigens</i>	1 gal.	37	-	
	Deer Grass				
	<i>Olea europaea 'Montra'</i>	5 gal.	55	-	
	Little Ollie Dwarf Ollie				
	<i>Penstemon parryi</i>	1 gal.	10	-	
	Perry's Penstemon				
	<i>Perovskia atriplicifolia</i>	1 gal.	200	-	
	Russian Sage				
	<i>Salvia clevelandii</i>	5 gal.	16	-	
	Chaparral Sage				
	<i>Simmondsia chinensis</i>	5 gal.	43	-	
Jojoba					
<i>Sphaeralcea ambigua</i>	5 gal.	108	-		
Globe Mallow					
<i>Vaquelinia californica</i>	5 gal.	3	-		
Arizona Rosewood					
<i>Viguiiera deltoidea</i>	1 gal.	27	-		
Goldeneye					
<i>Vitex trifolia 'Purpurea'</i>	5 gal.	9	-		
Arabian Lilac					
	Groundcovers				
	<i>Glandularia pulchella</i>	1 gal.	25	-	
	Moss Verbena				
	<i>Melampodium leucanthum</i>	1 gal.	12	-	
Blackfoot Daisy					
	Accents Cactus				
	<i>Agave americana</i>	15 gal.	3	-	
	Century Plant				
	<i>Agave bovicornuta</i>	15 gal.	3	-	
	Cow Horn Agave				
	<i>Agave ovatifolia</i>	15 gal.	3	-	
	Whale's Tongue Agave				
	<i>Agave tequilana</i>	15 gal.	2	-	
	Weber Blue Agave				
	<i>Agave weberi</i>	5 gal.	8	-	
	Blue Agave				
	<i>Agave x 'Blue Glow'</i>	15 gal.	5	-	
	Blue Glow Agave				
	<i>Aloe barbadensis</i>	5 gal.	17	-	
	Medicinal Aloe				
	<i>Aloe rudikoppe</i>	5 gal.	63	-	
	Little Red Riding Hood Aloe				
	<i>Asclepias subulata</i>	5 gal.	4	-	
	Desert Milkweed				
	<i>Dasylirion wheeleri</i>	5 gal.	2	-	
	Desert Spoon				
	<i>Euphorbia antisyphilitica</i>	5 gal.	6	-	
	Candellilla				
	<i>Euphorbia ingens 'Chocolate Drop'</i>	15 gal.	6	-	
	Chocolate Drop Cactus				
	<i>Euphorbia royleana</i>	15 gal.	1	-	
	Churee				
	<i>Fouquieria splendens</i>	Large bare root	4	-	
	Ocotillo				
	<i>Opuntia basilaris 'Baby Rita'</i>	5 gal.	35	-	
Baby Rita Prickly Pear					
<i>Opuntia engelmannii</i>	5 gal.	22	-		
Engelmann's Prickly Pear					
<i>Opuntia ficus-indica</i>	15 gal.	7	-		
Indian Fig					
<i>Opuntia gomei 'Old Mexico'</i>	5 gal.	31	-		
Old Mexico Prickly Pear					
<i>Opuntia violacea santa-rita</i>	5 gal.	54	-		
Purple Prickly Pear					
<i>Pachycereus pringlei</i>	(5)@5" (2)@6" (1)@10"	(2)@3" (4)@4" (3)@5"	17 total		
Cardon					
<i>Pachycereus schottii f. monstrosus</i>	(4) @ 2" (2) @ 3"		6 total		
Totem Pole Cactus					
<i>Stenocereus marginatus</i>	15 gal.	3	-		
Mexican Fence Post					
<i>Yucca baccata</i>	5 gal.	36	-		
Banana Yucca					
<i>Yucca filifera</i>	15 gal.	5	-		
Tree Yucca					
<i>Yucca rostrata</i>	48" box	1	specimen		
Beaked Yucca			"natural trunk		

L3.3
of

IRRIGATION GENERAL NOTES

1. THE SYSTEM DESIGN ASSUMES A MINIMUM DYNAMIC PRESSURE FOR THE IRRIGATION SYSTEM OF 65 PSI, AT A MINIMUM DISCHARGE OF 50 GPM AT MAINLINE POINT-OF-CONNECTION. VERIFY PRESSURE AND FLOW ON SITE AND NOTIFY LANDSCAPE ARCHITECT OF ANY DIFFERENCES PRIOR TO INSTALLATION OR ORDERING OF ANY MATERIALS OR STARTING CONSTRUCTION. IF CONTRACTOR FAILS TO NOTIFY LANDSCAPE ARCHITECT, HE ASSUMES FULL RESPONSIBILITY FOR ANY NECESSARY SYSTEM ALTERATIONS AND ADDITIONAL COST THAT RESULT. FIELD MODIFICATIONS MAY OCCUR IN ORDER TO FULFILL THE DESIGN INTENT OF THE DRAWINGS. CONTRACTOR SHALL CONSULT WITH IRRIGATION DESIGNER AND PREPARE AS-BUILT PLANS SHOULD FIELD MODIFICATIONS BE NECESSARY.
2. READ THOROUGHLY AND BECOME FAMILIAR WITH THE SPECIFICATIONS AND INSTALLATION DETAILS FOR THIS AND RELATED WORK PRIOR TO CONSTRUCTION.
3. COORDINATE UTILITY LOCATES ("CALL BEFORE YOU DIG") OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
4. DO NOT PROCEED WITH THE INSTALLATION OF THE IRRIGATION SYSTEM WHEN IT IS OBVIOUS IN THE FIELD THAT OBSTRUCTIONS OR GRADE DIFFERENCES EXIST THAT MIGHT NOT HAVE BEEN CONSIDERED IN THE ENGINEERING. IF DISCREPANCIES IN CONSTRUCTION DETAILS, LEGEND, NOTES, OR SPECIFICATIONS ARE DISCOVERED, BRING ALL SUCH OBSTRUCTIONS OR DISCREPANCIES TO THE ATTENTION OF THE OWNER'S REPRESENTATIVE.
5. THESE IRRIGATION CONSTRUCTION DOCUMENTS, INCLUDING ALL PLANS, NOTES, DETAILS AND SPECIFICATIONS ARE INTENDED TO FACILITATE THE INSTALLATION CONTRACTOR BY PROVIDING GENERAL GUIDELINES FOR DESIGN INTENT. THEREFORE, ALL IRRIGATION ELEMENTS GRAPHICALLY REPRESENTED IN THESE CONSTRUCTION DOCUMENTS ARE SCHEMATIC.
- A. ALTHOUGH IRRIGATION COMPONENTS MAY BE SHOWN OUTSIDE PLANTING AREAS FOR CLARITY, INSTALL IRRIGATION PIPE AND WIRING IN LANDSCAPED AREAS WHENEVER POSSIBLE. PROVED 18" DEEP, ROCK FREE COVER OVER MAINLINE AND WIRE, AND COVER 12" DEEP OVER LATERALS, 6" OVER POLY PIPE AND 1/4" PIPE, BASED ON FINISHED GRADE.
- B. TREE AND SHRUB LOCATIONS AS SHOWN ON LANDSCAPE PLANS TAKE PRECEDENCE OVER IRRIGATION EQUIPMENT LOCATIONS. AVOID CONFLICTS BETWEEN THE IRRIGATION SYSTEM, PLANTING MATERIALS, AND ARCHITECTURAL FEATURES.
- C. USE ONLY STANDARD TEES AND ELBOW FITTINGS. USE OF CROSS TYPE FITTINGS IS NOT ALLOWED.
6. PROVIDE THE FOLLOWING COMPONENTS TO THE OWNER PRIOR TO THE COMPLETION OF THE PROJECT:
- A. TWO (2) OPERATING KEYS FOR EACH TYPE OF MANUALLY OPERATED VALVES.
- B. TWO (2) OF EACH SERVICING WRENCH OR TOOL NEEDED FOR COMPLETE ACCESS, ADJUSTMENT, AND REPAIR OF ALL ROTARY SPRINKLERS.
7. SELECT NOZZLES FOR SPRAY AND ROTARY SPRINKLERS WITH ARCS WHICH PROVIDE COMPLETE AND ADEQUATE COVERAGE WITH MINIMUM OVERSPRAY FOR THE SITE CONDITIONS. CAREFULLY ADJUST THE RADIUS OF THROW AND ARC OF COVERAGE OF EACH ROTARY SPRINKLER TO PROVIDE THE BEST PERFORMANCE.
8. THE IRRIGATION CONTRACTOR IS RESPONSIBLE FOR THE INSTALLATION OF IRRIGATION SLEEVING. SLEEVES ARE REQUIRED FOR BOTH PIPING AND ELECTRICAL WIRING AT EACH HARDSCAPE CROSSING. ALL PIPE AND WIRING UNDER PAVED SURFACES SHALL BE IN CLASS 200 MINIMUM PVC SLEEVES. WHETHER OR NOT SHOWN, PIPING IN SLEEVES UNDER ROADWAYS SHALL BE A MINIMUM DEPTH OF 24". PIPING IN SLEEVES UNDER SIDEWALKS SHALL BE A MINIMUM DEPTH OF 18". EXTEND SLEEVES 12" BEYOND EDGE OF PAVEMENT.
9. COORDINATE INSTALLATION OF SLEEVING WITH OTHER TRADES. ANY PIPE OR WIRE WHICH PASSES BENEATH EXISTING HARDSCAPE WHERE SLEEVING WAS NOT INSTALLED WILL REQUIRE HORIZONTAL BORING BY THE IRRIGATION CONTRACTOR.
10. INSTALL ALL ELECTRICAL POWER TO THE IRRIGATION CONTROL SYSTEM IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE AND ALL APPLICABLE LOCAL ELECTRIC UTILITY CODES. ALL 24-VOLT WIRING SHALL BE #14 UFUL DIRECT-BURIAL, SOLID COPPER.
11. THE FOLLOWING SHOULD BE NOTED REGARDING PIPE SIZING: IF A SECTION OF UNSIZED PIPE IS LOCATED BETWEEN THE IDENTICALLY SIZED SECTIONS, THE UNSIZED PIPE IS THE SAME NOMINAL SIZE AS THE TWO SIZED SECTIONS. THE UNSIZED PIPE SHOULD NOT BE CONFUSED WITH THE DEFAULT PIPE SIZE NOTED IN THE LEGEND.
12. INSTALL TWO (2) #14 AWG CONTROL WIRES FROM CONTROLLER LOCATION TO EACH DEAD-END OF MAINLINE FOR USE AS SPARES IN CASE OF CONTROL WIRE FAILURE. COIL 3 FEET OF WIRE IN VALVE BOX.
13. SYSTEM SCHEMATIC SHALL BE AS FOLLOWS:

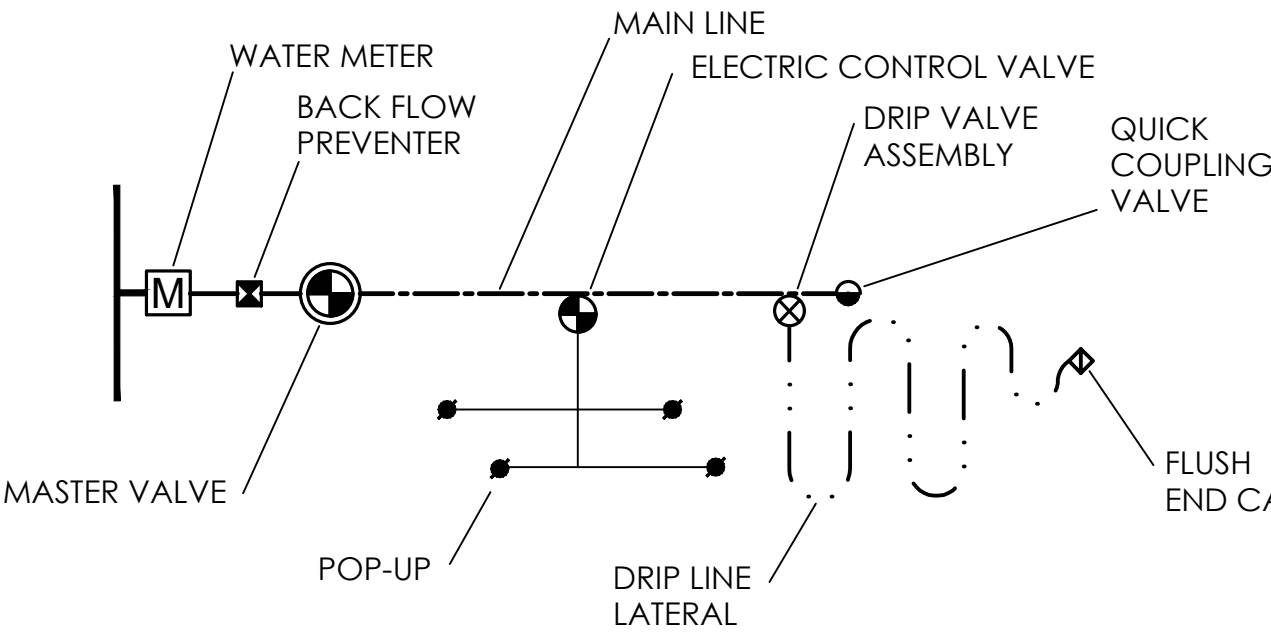

EMITTER SCHEDULE


INSTALL PRESSURE COMPENSATING EMITTERS AS FOLLOWS:					
Plant type	Plant size	Emitters per Plant	GPH Outlet	# of Outlets	Total GPH/Plant
TREES	15 gal.	1 Multi-Outlet	2 GPH	3	6 GPH
	24" Box	1 Multi-Outlet	2 GPH	4	8 GPH
	36" Box	1 Multi-Outlet	2 GPH	5	10 GPH
	48" Box	1 Multi-Outlet	2 GPH	6	12 GPH

INSTALL PRESSURE COMPENSATING EMITTERS AS FOLLOWS:					
SHRUBS	1 gallon	2 Single per Plant	1/2 GPH	2	1 GPH
	5 gallon	2 Single per Plant	2 GPH	2	4 GPH

NOTES:
ALL SHRUBS SPACED 18 INCHES OR CLOSER SHALL RECEIVE ONLY ONE DRIP EMITTER. SHRUBS SPACED GREATER THAN 18 INCHES TO RECEIVE EMITTERS PER THE ABOVE SCHEDULE.

ALL EMISSION POINTS TO BE LOCATED ON THE UPHILL SIDE OF PLANT MATERIAL. ONE EMISSION POINT TO BE LOCATED AT THE PLANT BALL, WITH THE ADDITIONAL POINTS WITHIN PLANT PIT PERIMETER.

ALL PIPING SHALL BE THOROUGHLY FLUSHED PRIOR TO EMITTER INSTALLATION. CONTRACTOR IS RESPONSIBLE FOR ANY NECESSARY FLUSHING OF EMITTERS DUE TO CLOGGING FOR THE DURATION OF THE MAINTENANCE PERIOD. ANY PLANT MATERIAL THAT DIES DUE TO EMITTER CLOGGING SHALL BE REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST.

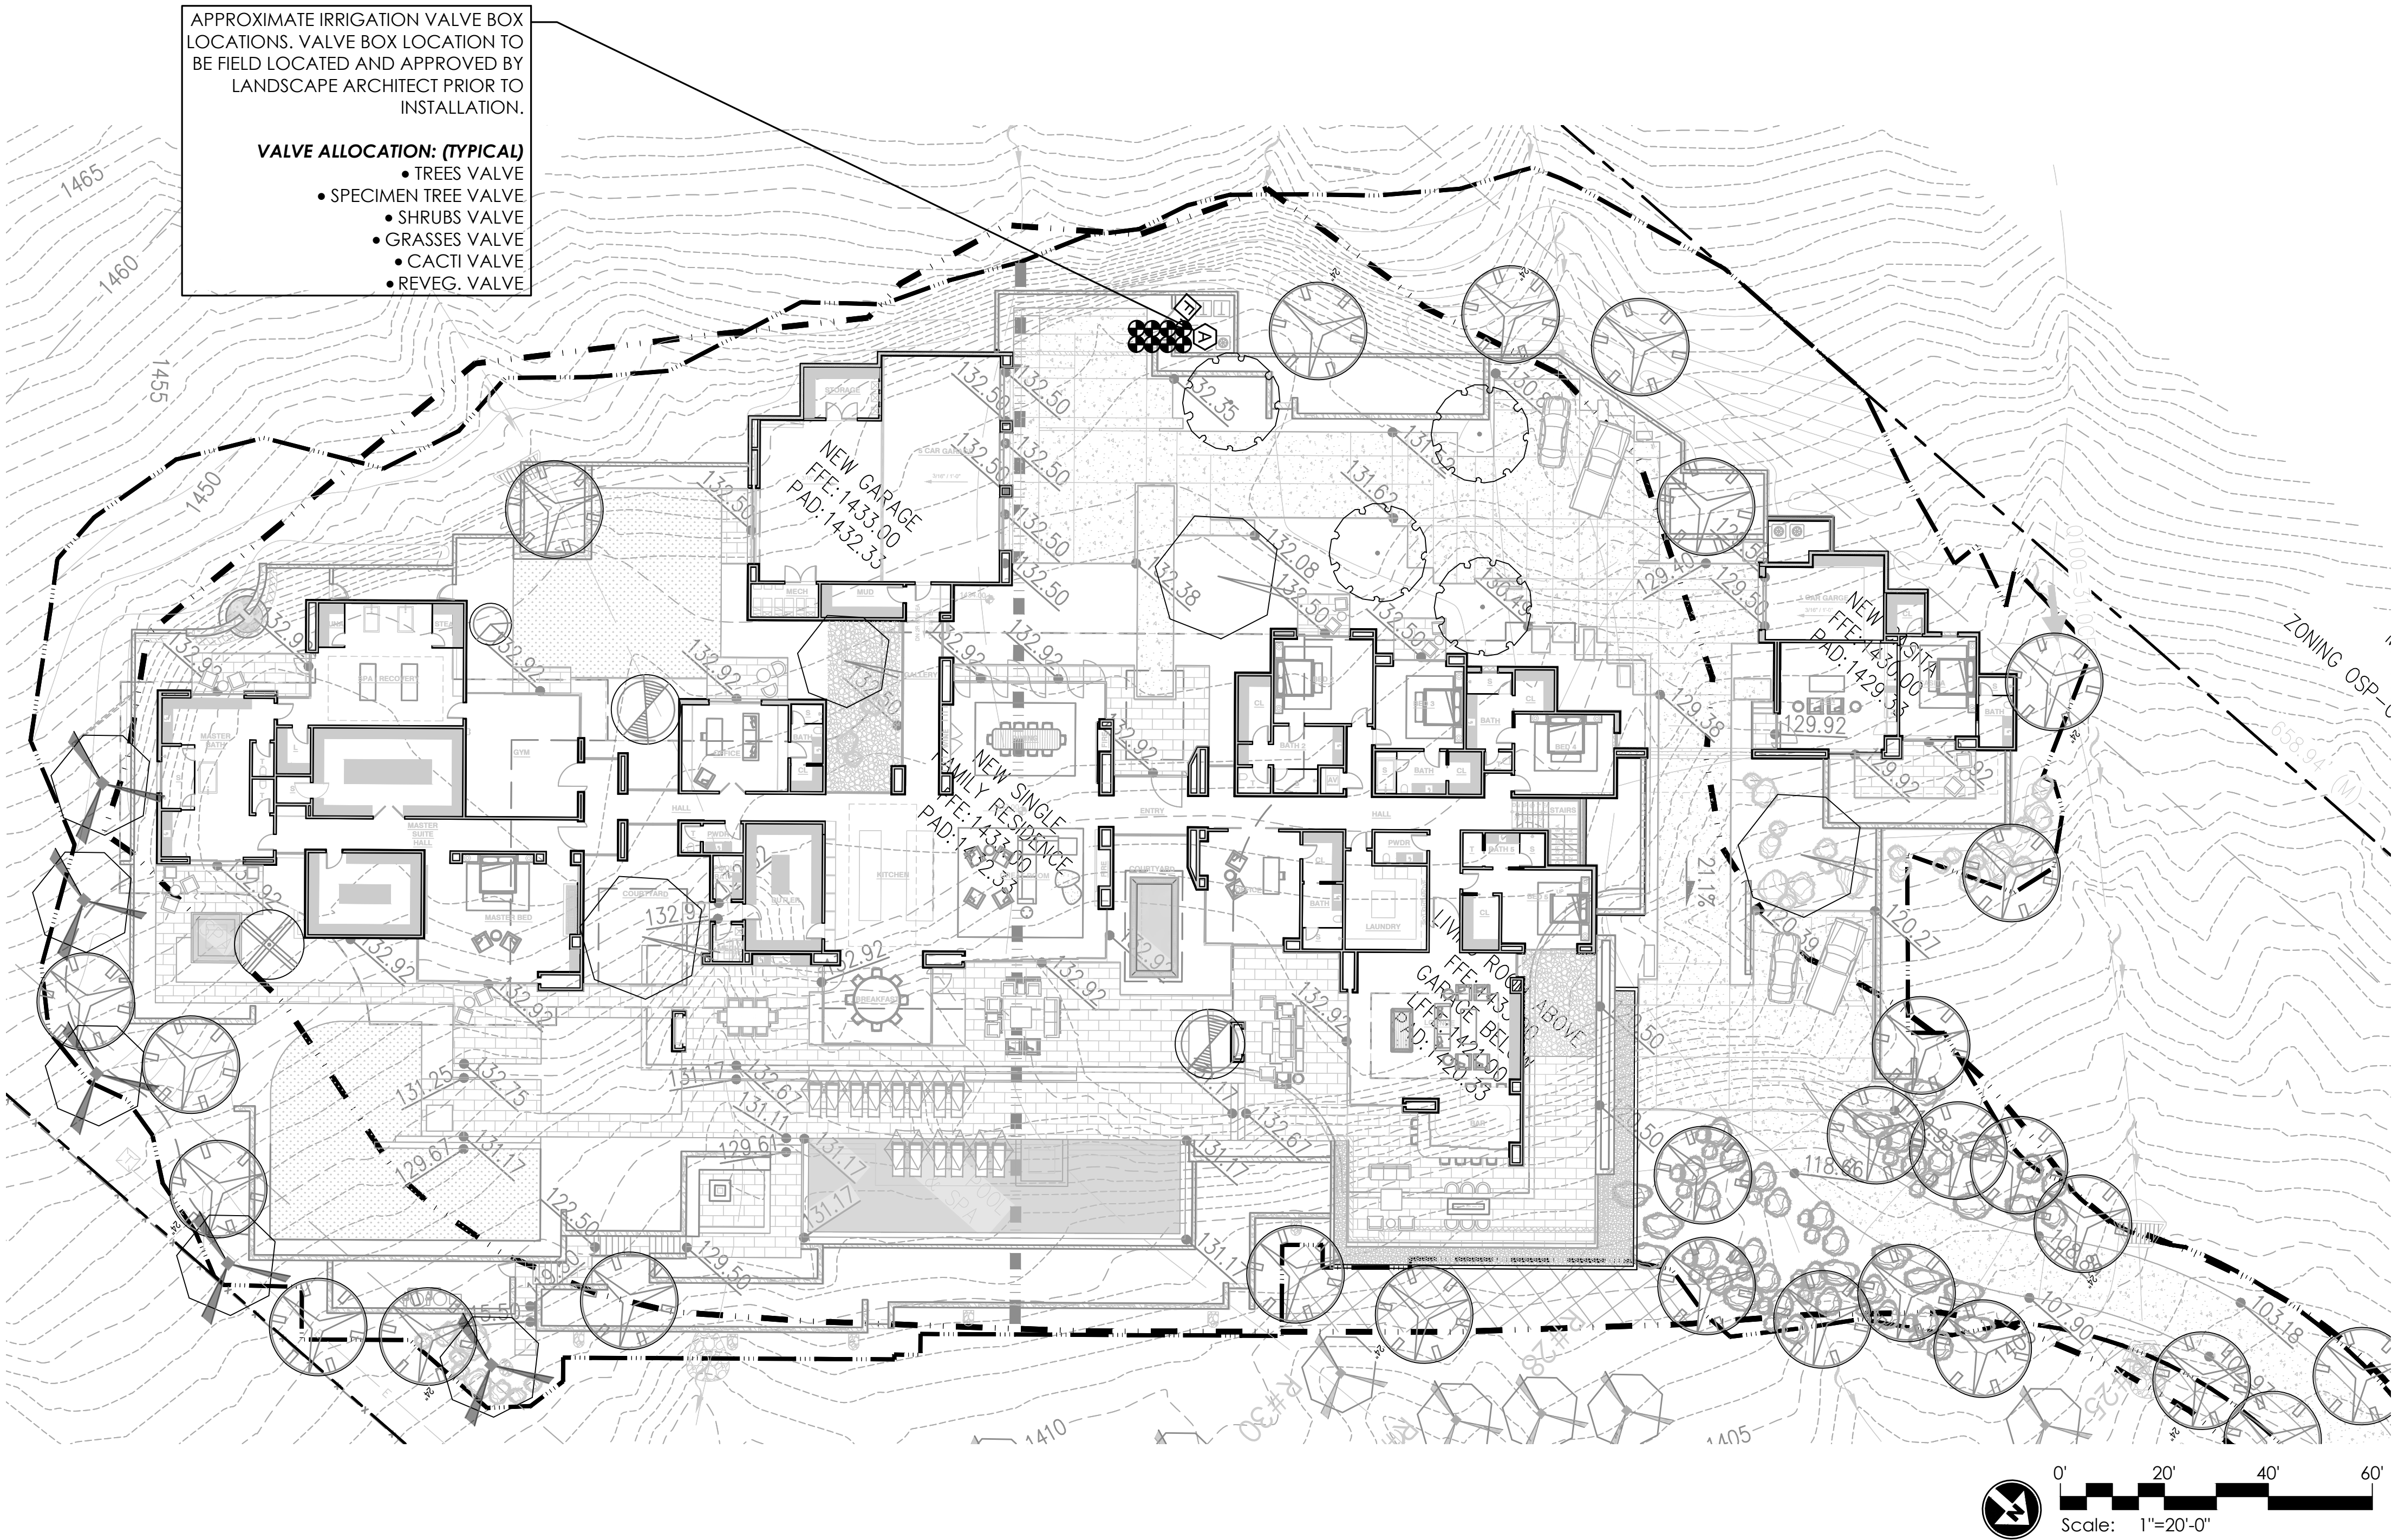

IRRIGATION LEGEND

SYMBOL	DESCRIPTION	NOTES
	WATER METER. ALSO PROVIDE REDUCED PRESSURE BACKFLOW PREVENTOR TO MATCH METER	-
	CONTROLLER	WALL-MOUNTED, PAINT TO MATCH WALL. SPEC HUNTER 'HPC' CONTROLLER OR EQUIVALENT.
	CONTROL VALVE QTY. TBD	FLUSH MOUNTED, BOX COLOR TO MATCH GROUND PLANE
	MAINLINE	CLASS 200 PVC
	FERTIGATION SYSTEM	EZ-FLOW INLINE 5 GALLON

THE INSTALLATION CONTRACTOR SHALL PROGRAM THE CONTROLLER, IN ORDER TO MANAGE THE DURATION OF THE IRRIGATION CYCLE TO AVOID RUNOFF CONDITIONS

SLEEVING SCHEDULE

PIPE OR WIRE BUNDLE	REQUIRED SLEEVE
3/4", 1", 1-1/4" PIPE	1-2" PVC SLEEVE PER PIPE
1-1/2", 2" PIPE	1-4" PVC SLEEVE PER PIPE
1-25 CONTROL WIRES	1-2" PVC SLEEVE
26-55 CONTROL WIRES	2-2" PVC SLEEVE

NOTE:
1. IRRIGATION MAINLINES TO BE ALL HARD PIPE PVC, SCH 40.
2. DIRECT PUNCTURE INLINE EMITTERS INTO LATERALS, THEN RUN SPAGHETTI TO PLANT. NO FLAG EMITTERS.
3. CONTRACTOR TO SUBMIT SHOP DRAWINGS OR CONTACT LANDSCAPE ARCHITECT FOR PROPOSED IRRIGATION SYSTEM FOR APPROVAL PRIOR TO CONSTRUCTION.
4. ALL LATERAL LINES TO BE COMMERCIAL GRADE THICK WALL POLYPIPE WITH COLOR CODING ON PIPE. *NO SPRAY PAINT* SHADE PIPE WHERE ROCKY.
5. **VALVES SHOWN ON PLAN TO SERVE AS A GUIDE. CONTRACTOR TO ADD VALVES AS NECESSARY TO ZONE THE YARD AND MEET IRRIGATION NEEDS OF ALL PLANT MATERIAL.**

CALL TWO WORKING DAYS BEFORE YOU DIG
(602) 262-1100
1-800-STAKE-IT
(DODGE/MARICOPA COUNTY)

ROADRUNNER RESIDENCE

project #:
SAA112

drawn by:
TEAM

date:
03/19/2026

drawing:
Irrigation Plan

L4.1
of

Copyright © 2014 by
Greedy | Pickett Professional Corp.

GREEDY | PICKETT
landscape architecture community design
7144 E. Mission Drive, Suite 205
Phoenix, AZ 85032
480.609.0009p 480.609.0068t



revisions:

Scale: 1"=20'-0"

issued for:

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"

Scale: 1"=20'-0"



LIGHTING FIXTURE SCHEDULE

SYMBOL	QTY	MANUFACTURER	MODEL #	COLOR	DESCRIPTION	LUMENS
	52	FX LUMINAIRE	FB-1LED-FB	BLACK	LOW VOLTAGE UPLIGHT	114
	56	FX LUMINAIRE	RP-32-1LED-W-18R-FB	BLACK	LOW VOLTAGE PATHLIGHT	55
	12	FX LUMINAIRE	RH-3LED-W-RB-FB	BLACK	LOW VOLTAGE WALL LIGHT	86
	300 L.F.	FX LUMINAIRE	SRP-10-W	-	LED WEATHERPROOF LIGHT STRIP	28/FT
	TBD	-	-	-	LOW VOLTAGE TRANSFORMER (CONTRACTOR TO DETERMINE QUANTITY REQUIRED)	-

LIGHTING NOTES

1. CONTRACTOR SHALL VERIFY ALL SPECIFICATIONS, COLORS, AND FINISHES WITH OWNER PRIOR TO ORDERING OR INSTALLING.
2. LANDSCAPE ARCHITECT TO FIELD APPROVE ALL LIGHTS.
3. ALL LIGHTS TO BE FIELD LOCATED BY LANDSCAPE ARCHITECT.
4. ALL LIGHTS TO BE 2,700K COLOR TEMPERATURE.

HILLSIDE OUTDOOR LIGHTING REQUIREMENTS:

AREA OF LOT: 221,685 S.F.
ALLOWABLE DISTURBED AREA: (24.46%) 54,224 S.F.

LANDSCAPE UP-LIGHTING: LIMITED TO ONE (1) FIXTURE PER 1000 S.F. OF ALLOWABLE DISTURBED AREA.
UP-LIGHTS PERMITTED: 54
UP-LIGHTS PROVIDED: 52

NOTE: ALL OTHER LIGHTING (LUMINAIRE) IS CONSIDERED 'SAFETY LIGHTING' USED TO ILLUMINATE VEHICULAR AND PEDESTRIAN CIRCULATION AND DOES NOT EMIT LIGHT RAYS ABOVE A HORIZONTAL PLANE.

FXLuminaire

Runa™ RP-32 and RP-33 Path Lights **PATHLIGHT**

1

Bring precise illumination to any pathway with the Runa RP-32 and RP-33 Path Lights. Featuring a sleek, modern design, these innovative fixtures include an easily adjustable, adjustable head that allows light exactly where it's needed. The RP-32 also offers compatibility with Luxe® technology, ensuring quality, performance, and functionality to ensure optimal lighting control for every angle.

QUICK FACTS:

- Sleek, contemporary design with modern, adjustable head.
- Sleek design, available in black and white, and an LED using for maximum efficiency and long life.
- Compatible with Luxe® technology for dimming, and 0-10V dimming, and 0-10V dimming.
- Available in black and white, and an LED using for maximum efficiency and long life.

PROJECT: _____
CATEGORY: _____
TYPE: _____
NOTES: _____

FXLuminaire

FB LED Up Light **UPLIGHT**

1

Similar in style to its bigger brother the RP-32, the FB fits nicely into smaller landscapes and tight spaces. Accommodating up to 3 LED heads, the FB offers all the same top light benefits of the RP-32 in a more compact package.

QUICK FACTS:

- Sleek design, available in black and white, and an LED using for maximum efficiency and long life.
- Compatible with Luxe® technology for dimming, and 0-10V dimming, and 0-10V dimming.
- Available in black and white, and an LED using for maximum efficiency and long life.

PROJECT: _____
CATEGORY: _____
TYPE: _____
NOTES: _____

FXLuminaire

RH Recessed Wall/Step Light **RECESSED WALL**

1

Designed for sleek, seamless installation, the fully recessed RH Recessed Wall/Step Light is a modern upgrade to lighting outdoors and indoors. The fixtures are available with LED, SL-LED, and CDC configurations. The recessed design allows for easy installation and maintenance, and the recessed design allows for easy installation and maintenance.

QUICK FACTS:

- Sleek design, available in black and white, and an LED using for maximum efficiency and long life.
- Compatible with Luxe® technology for dimming, and 0-10V dimming, and 0-10V dimming.
- Available in black and white, and an LED using for maximum efficiency and long life.

PROJECT: _____
CATEGORY: _____
TYPE: _____
NOTES: _____

GREY PICKETT
landscape architecture community design
7144 E. Mission Drive, Suite 205
Paradise Valley, AZ 85253
480.609.0009p 480.609.0068t

28448
RUSSELL E.
GREY
Landscape Architect
No. 12831766
Expires 12/31/26

CALL TWO WORKING DAYS
BEFORE YOU DIG
(602) 762-1100
1-800-STAKE-IT
(TOLL FREE IN ARIZONA)

project #:
SAA112

scale:
1"=30'-0"

issued for:


drawn by:
TEAM

date:
03/19/2026


drawing:
Lighting Plan

L5.1
of


Copyright © 2014 by
Greedy | Pickett Professional Corp.

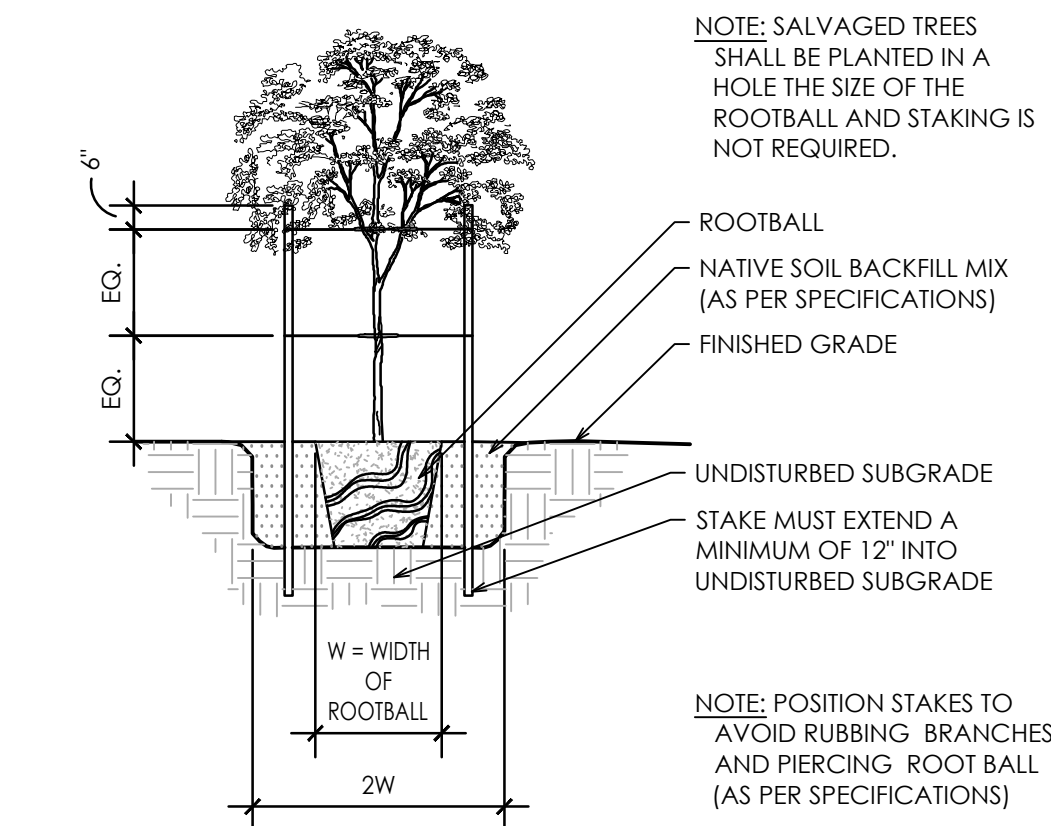


01 Tree Planting Detail
SCALE: NTS

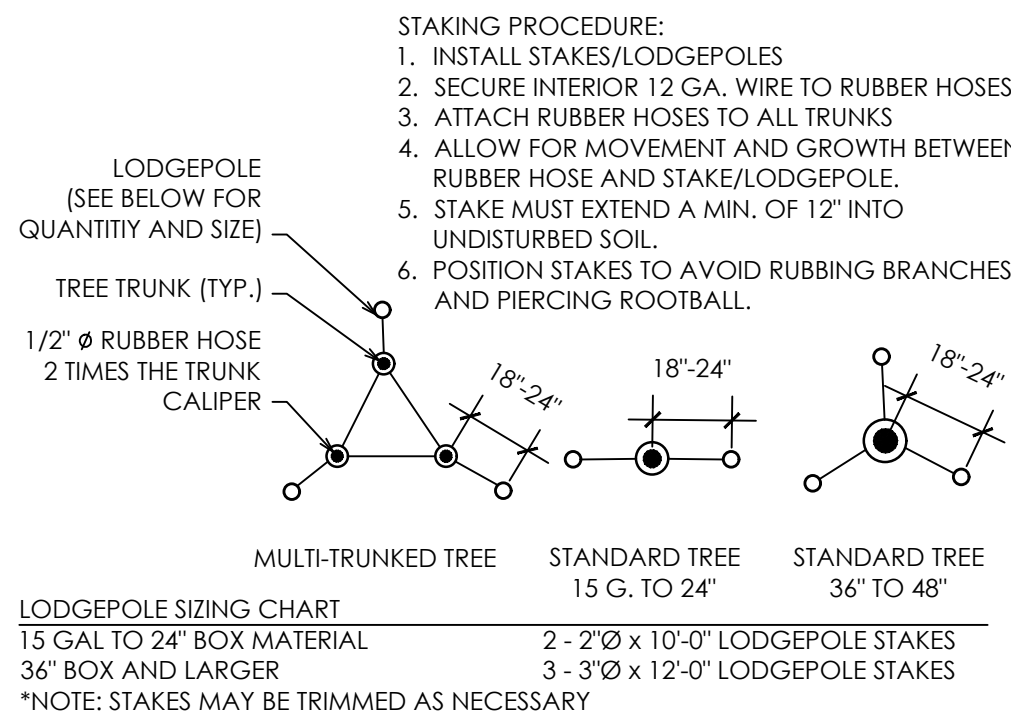


02 Tree Staking Detail
SCALE: NTS

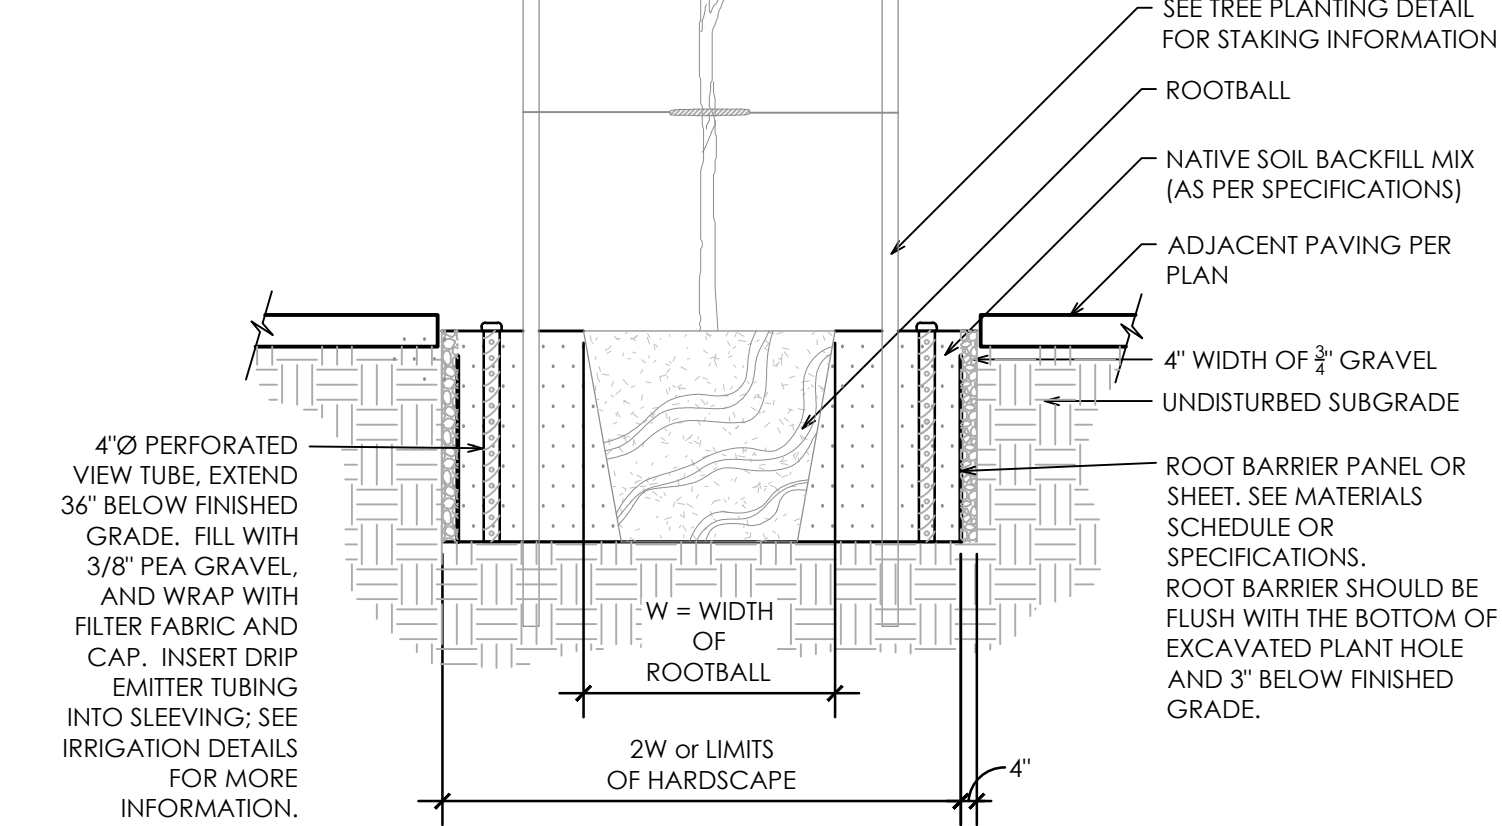


03 Deep Watering Detail
SCALE: NTS

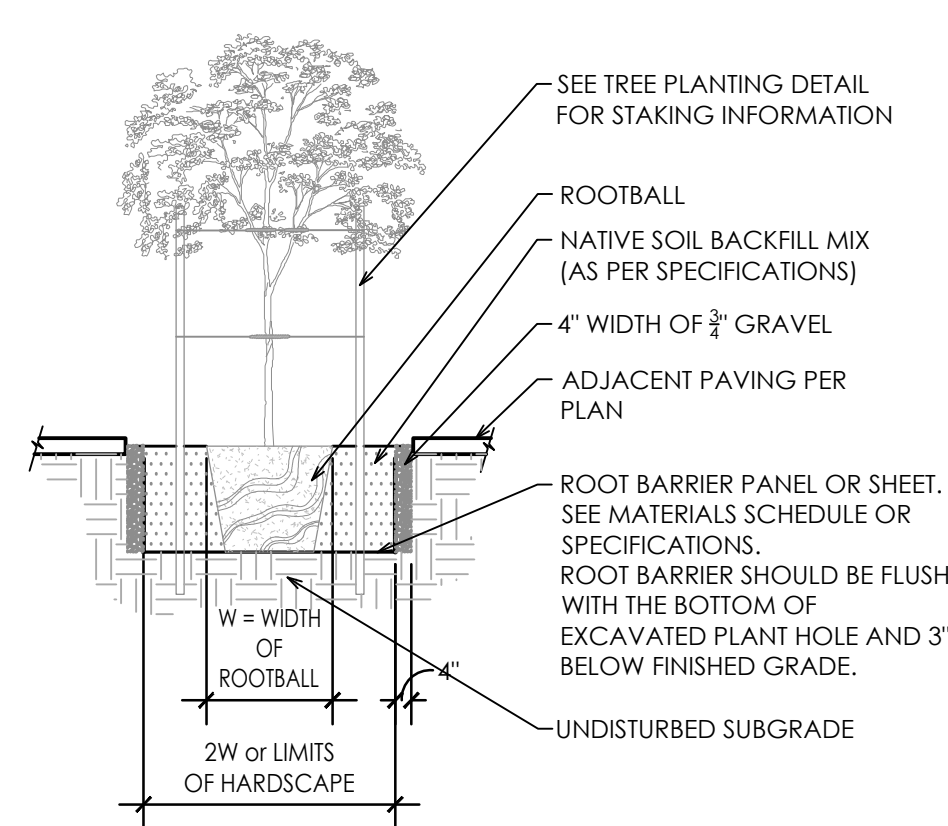


04 Root Barrier Detail
SCALE: NTS

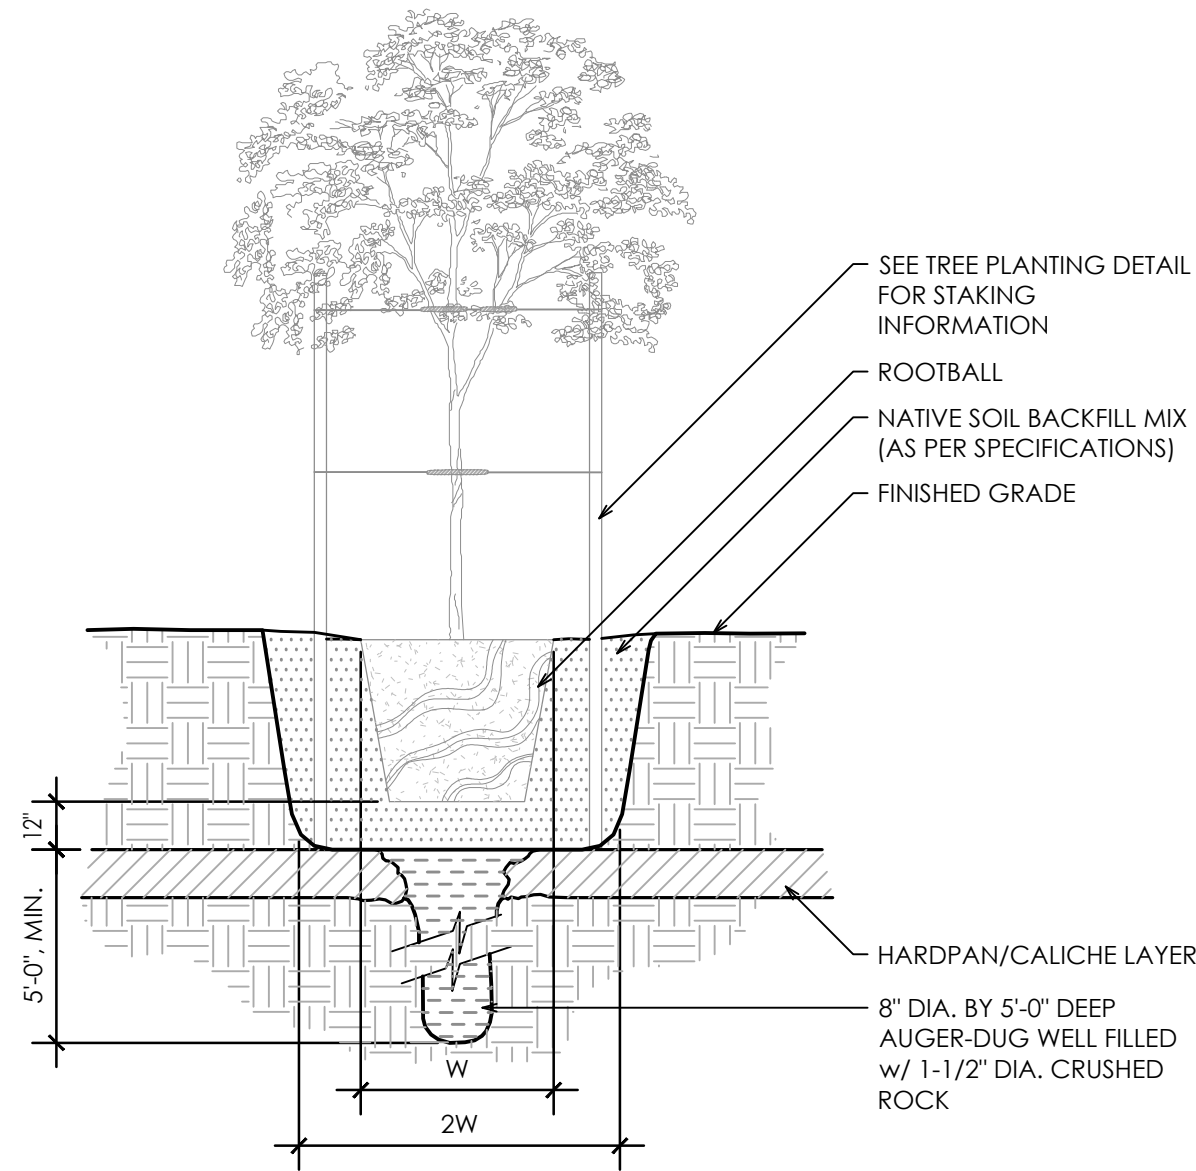


05 Hardpan Planting Detail
SCALE: NTS

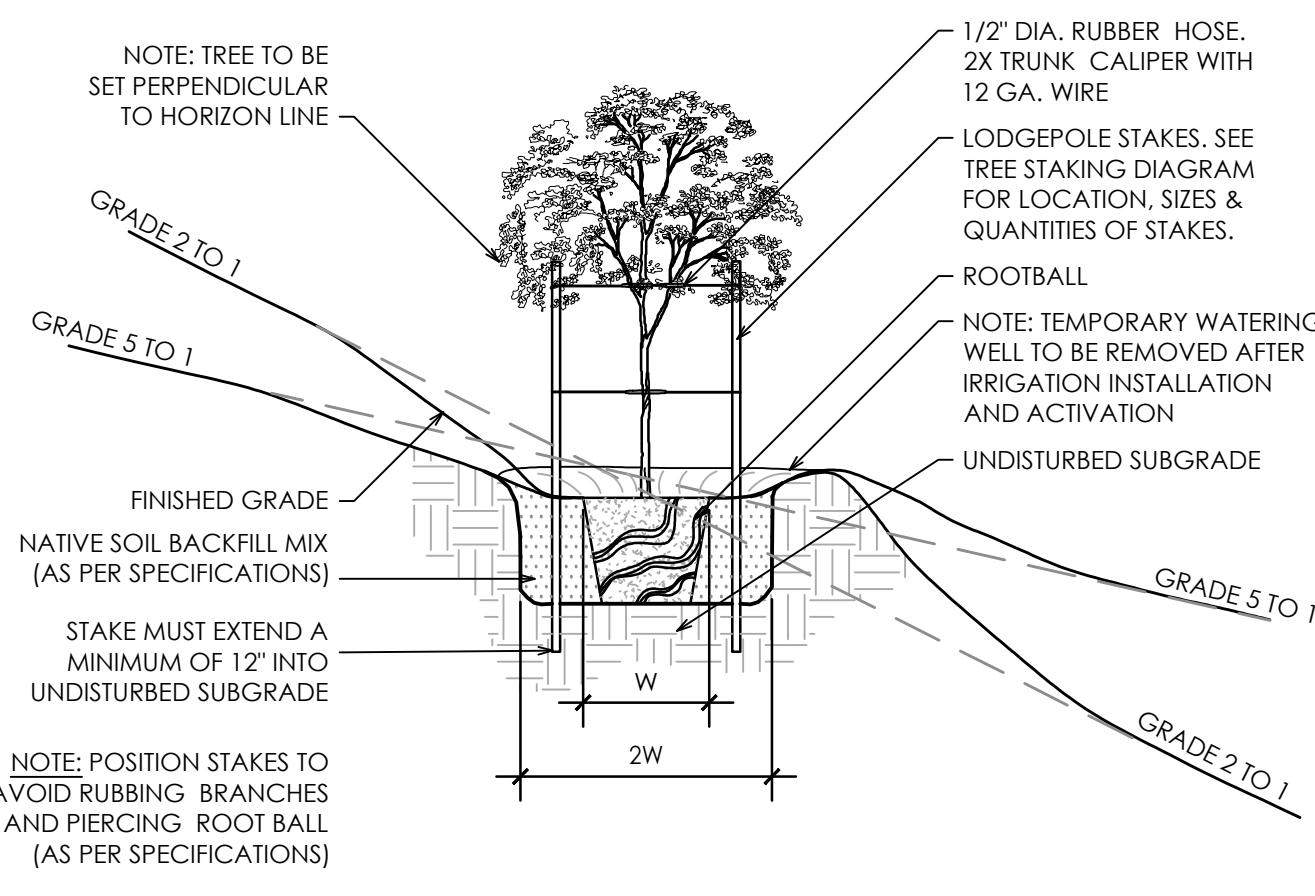


06 Tree Planting on a Slope Detail
SCALE: NTS

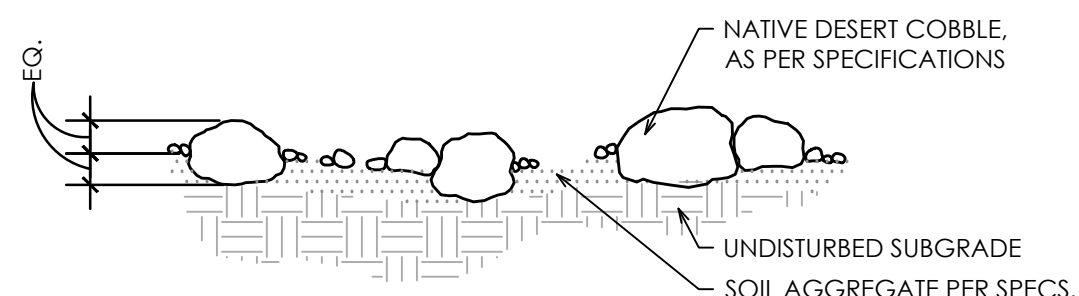


07 Desert Cobble Mix
SCALE: NTS

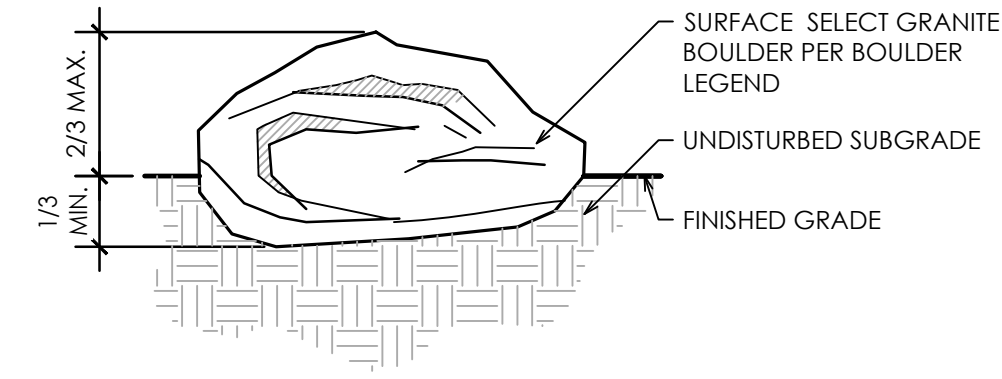


08 Boulder Laying detail
SCALE: NTS

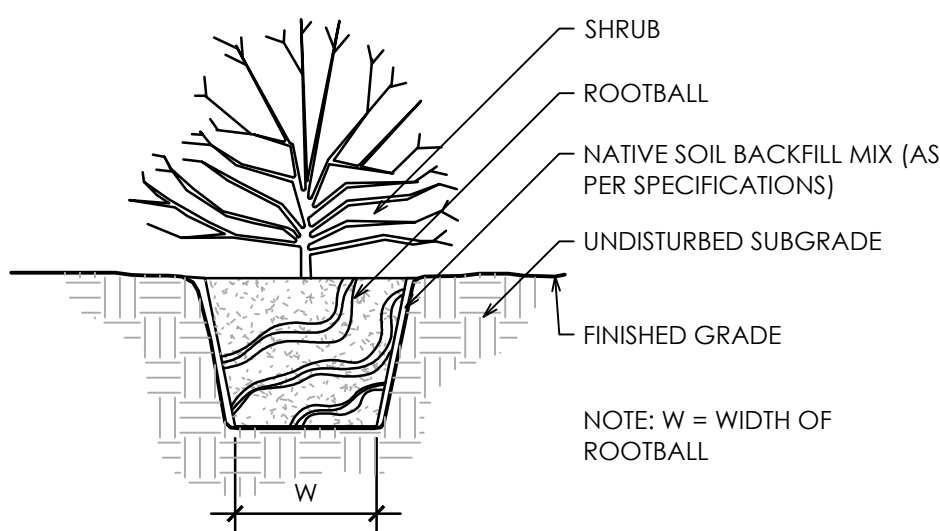


09 Shrub Planting Detail
SCALE: NTS

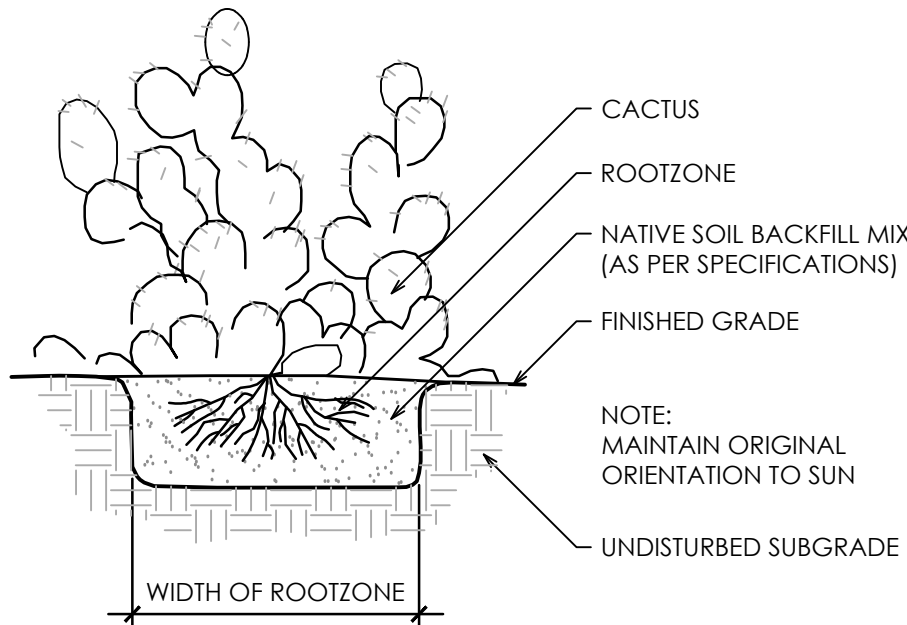

10 Cacti Planting Detail
SCALE: NTS

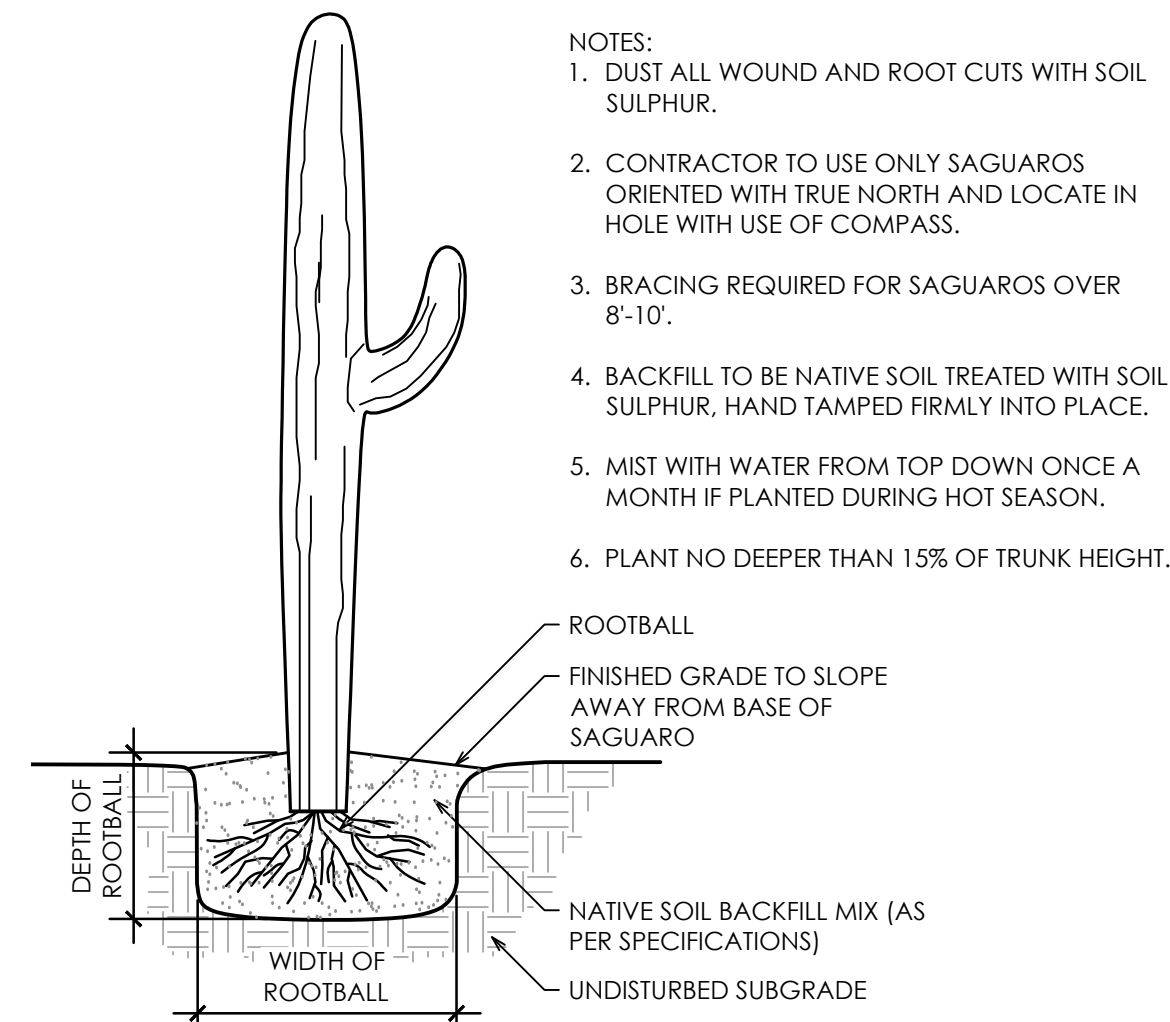

11 Saguaro/ Cardon Planting Detail
SCALE: NTS

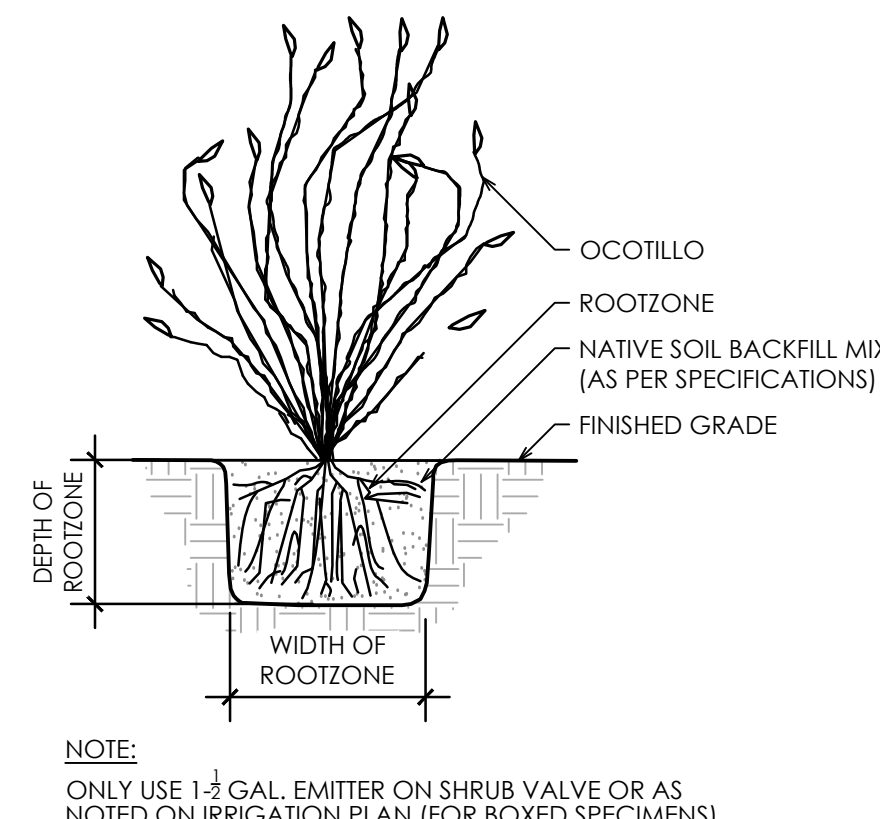

12 Ocotillo Planting Detail
SCALE: NTS

SECTION - 02900 LANDSCAPE

PART 1 - GENERAL

1.01 WORK INCLUDED

*Landscape finish grading.

* Soil preparation

*Tree supports

*Planting

*Watering

*Maintenance

Definitions:

Owner's representative - an authorized agent determined by owner to act on their behalf, in some cases the Landscape Architect may be the owner representative as outlined in these specs.

Plants - all shrubs and cacti other than trees, saguaros, ocotillos, palms and turf.

Plant Material - all trees, saguaros, ocotillos, palms, shrubs, cacti, ground cover, and other plants.

1.02 RELATED WORK

Contractor : Minimum 5 years experience in supply and installation of landscape materials. A Foreman with a minimum of 5 years experience in related work shall be on site at all times.

1.03 SOURCE QUALITY CONTROL

Provide certificates of inspection for all materials as required by law or regulation.

Package standard materials with manufacturers certified analysis. Provide analysis by recognized laboratory made in accordance with methods established by the Association of Official Chemists for all other material.

Provide trees and shrubs grown in a recognized nursery in accordance with good horticultural practice. Provide healthy, undamaged, vigorous stock grown under climatic conditions similar to conditions at project site and free of disease, insects, eggs, larvae and defects such as sun-scald, knots, injuries, abrasions or disfigurements. Provide trees and shrubs of the sizes indicated. Trees and shrubs of sizes larger than those indicated may be used provided roots, root ball, staking and planting pits are increased proportionately.

1.04 REFERENCE STANDARDS

ANSI 60.1 - American Standards for Nursery Stock.

1.05 SAMPLES

Submit the following material samples to Owner's Representative a minimum of 48 hours prior to start of work.

- a. Topsoil for backfill mix (trees and shrubs).
- b. Wood Shavings/Mulch.
- c. Tree supports.
- d. Decomposed granite.
- e. Boulders.

The Owner's Representative reserves the right to take and analyze samples of materials for conformity to Specification of any time. Furnish samples upon request by Owner's Representative. Rejected materials shall be immediately removed from the site and replaced at the contractors additional expense.

Submit samples of decomposed granite for approval of gradation and color. Sample shall be representative of variations within size and color to be provided.

1.06 PRODUCT DATA

Submit to Owner's Representative a minimum of 48 hours prior to start of work manufacturers comprehensive product description, including specifications and installation instructions.

1.07 CERTIFICATES AND TEST REPORTS

Provide and pay for all materials testing. Testing agency shall be acceptable to the Landscape Architect. Submit to Owner's Representative a minimum of 48 hours prior to start of work 2 copies of certificates of inspection as required by governmental authorities, and manufacturers' vendors certified analysis for soil amendments, fertilizer materials, and chemicals. Submit other data substantiation that materials comply with specified requirements. Certificates are required to determine the quality and quantity of all specified soil amendments.

Materials certification to be submitted include, but are not limited to: Topsoil source and nutrient analysis, mulch, fertilizers/soil amendments/chemicals. Test representative material samples proposed for use. Provide the following data:

- a. Topsoil and planting backfill.
- b. Soil PH.
- c. Particle size, percentage soil texture.
- d. Percentage organic material.
- e. Percolation rate.
- f. Nutrient level analysis.
- g. All macro, secondary and micro nutrient salinity.
- h. ESP.
- i. Free lime.

Recommendations on type and quantity of amendments required to bring levels into acceptable ranges as detailed in Part 2 - Products of Materials of these specifications.

Separate recommendations to be submitted for each crop. Crop to be identified as:

- a. Irrigated trees and shrubs.
- b. Turf.

1.08 MAINTENANCE DATA

Submit to Owner's Representative 2 copies of typewritten instructions, prior to expiration of the initial maintenance period, recommending procedures to be followed by the Owner for the maintenance of landscape work for one full year.

1.09 PRODUCT DELIVERY, STORAGE AND HANDLING

Deliver packaged material in containers showing weight, analysis and identification of manufacturer. Protect materials from deterioration at all times.

Provide protective covers to plant life and trees during delivery. Do not prune trees prior to delivery. Do not bend-lie trees or shrubs in such a manner as to cause damage or destroy shape. Deliver materials after preparation for planting have been completed. Plant immediately. If planting is delayed for more than 6 hours after delivery, set plant material in shade, protect from weather and mechanical damage and keep roots moist.

Do not remove container grown stock including ground cover, from containers until planting time.

1.10 SITE CONDITIONS

Determine location of underground utilities. Execute work as required to prevent damage.

Maintain grade stakes set by others until directed otherwise.

Protect all existing plant life not scheduled for removal. If any plant material that is to remain is damaged, the Contractor, at his expense, will pay for a replacement plant of the same size and species (to be approved by Owner's Representative).

Protect existing utilities, paving and other facilities from damage during landscaping operation.

Coordinate with other contractors.

1.11 WARRANTY

Submit warranty to Owner's Representative.

Trees, Palm Trees, Saguaros and Ocotillos: Warrant that trees, palm trees, saguaros and ocotillos will be alive and in good health for a period of 1 year after acceptance except for defects resulting from neglect by Owner, abuse or damage by others.

Owner must follow Contractors maintenance schedule and provide current maintenance log to Owner's Representative.

Remove and replace dead, unhealthy or gridled trees, palm trees, saguaros and ocotillos that lose original form and size during warranty period with material equal to that specified. Replace any material which does not meet requirements within fifteen days of notification. All replacement trees, palm trees, saguaros and ocotillos shall be subject to an additional one year maintenance period.

Shrubs and Other Plantings: Guarantee all other planting will be alive and in satisfactory condition for a period of 90 days from date of acceptance or will be replaced at no additional cost to the Owner. All plant material shall be maintained in a healthy, sturdy condition during the warranty period by the Contractor.

All replacement plants, including shrubs, cacti, groundcovers, vines and perennials shall be subject to an additional 90 day maintenance period.

PART 2 - PRODUCTS AND MATERIALS

2.01 FILL MATERIALS

Provide dry, loose material for fill, backfill, planting backfill and topsoil for planter beds. Frozen or muddy soils are not acceptable. Salts not to exceed 1500 ppm, and material shall be free of debris, noxious weeds, ingredients or objects detrimental to healthy plant growth. Topsoil: Screened, fertile, friable, from well drained arable land, free of nut grass, refuse, roots, heavy clay, noxious weeds or any material toxic to plant growth; contents as follows:

- a. Silt: 20-45 %
- b. Clay: 15-20 %
- c. Sand: 30-60 %
- d. Organic Material (natural or otherwise): 2 % minimum
- e. pH: 7.0-8.3
- f. Soluble salts: 1,500 ppm.
- g. Nutrients: enough to bring levels up to acceptable plant growth.

Percolation rate shall be between 3 to 4 inches per hour. Existing top soil may be used provided it meets these requirements.

2.02 COMMERCIAL GRADE FERTILIZERS

Agri-Sul, Dispersul - use only for sulfur
Agriculture grade gypsum

2.03 SOIL AMENDMENTS

Wood shavings: nitrogen stabilized fir or pine shavings containing 0.75% total nitrogen and 0.1 to 0.15% total iron, and under 60 ppm total manganese; composted, leached and aged for a minimum of 10 to 12 months; pH factor, 4.0 to 4.5, no soil amendments are required for salvaged plant material and cacti unless otherwise specified.

2.04 TREE SUPPORTS

Tree Stakes: Copper naphthenate impregnated lodge pole 10 feet in length for 5 gallon and 15 gallon, and 12 feet in length for 24 inch box and larger. No tree stakes are required for salvaged plant material.

Tree Ties: Provide a minimum of two per tree; No. 10, 30 gauge, pliable, zinc coated iron wire. Cover wire with hose, cover as specified, where it contacts tree.

Hose Covering: 1/2 inch minimum diameter; 2-ply reinforced rubber, new garden hose.

Tree Guards: "Arbor-Gard" by Deep Root, or equal.

Tree Guys: Minimum 3 per tree; No. 10 galvanized wire. Cover wire with hose where it contacts tree for 24, 30 and 36 box tree.

Anchor (Deadmen): 2 inch x 4 inch x 3 feet long; construction grade redwood.

Signals (Flags): For guy wires, 1/2 inch diameter, white or orange plastic tubing 5 feet long over each guy used.

2.05 HERBICIDES

Pre-emergent and contact Herbicides:

Pre-emergent herbicide shall be Surflan as manufactured by Dow/Elanco Chemical Company.

Contact herbicide shall be Round-up as manufactured by Monsanto.

2.06 PLANTING MATERIAL

Plant Material: Healthy, shapely and well rooted. Roots shall show no evidence of having been restricted or deformed at any time. All plants shall be representative of their normal species and variety. They shall have normally developed branch systems. Plants shall be free from disfiguring knots, sun scald injuries and abrasions of bark. Plants not meeting these requirements shall be considered defective and shall be replaced immediately. All plants shall be true to name and shall be tagged, one of each variety. All plant material shall be grown in nurseries inspected by the State Department of Agriculture unless otherwise approved by the Owner's Representative.

Provide "Specimen" plants with a special height, shape or character. Tag at the source of supply prior to notifying Landscape Architect for inspection. The Landscape Architect shall inspect selections at source of supply for suitability and adaptability to selected location. When specimen plants cannot be purchased locally, provide sufficient photographs of proposed material for approval.

Plants may be inspected and approved at place of growth for compliance with specification requirements for quality, size, and variety. Such approval shall not impair the right of inspection and rejection upon delivery at the site or during the progress of the work.

2.07 TURF SOD

As noted on plans.

2.08 DECOMPOSED GRANITE

Decomposed granite coverage shall be a minimum 2-inch thickness unless noted otherwise on plans. Decomposed granite shall be the size and color as specified on plans, and shall be taken from a single quarry.

2.09 BOULDERS

Boulders are to be Surface Select or as noted on the plans. Boulder size as noted on the plans and approved by the Owner's Representative. Boulders are to be harvested, delivered and placed in a manner to avoid marking, scraping or damaging the natural condition of the boulder. All scarred boulders are to be treated with Permeon (or equal) to provide a natural appearance of the desert vornish.

2.09 SEED MIXTURE

As noted on plans.

PART 3 - EXECUTION

3.01 GENERAL

Install in accordance with the methods, techniques and specifications of each representative manufacturer. If a conflict occurs between manufacturers and these specifications, consult with Owner's Representative for a decision.

Do not begin planting until the irrigation system is completely installed, is adjusted for full coverage and is completely operational.

3.02 BACKFILL, IMPORTED FILL OR ARTIFICIAL SOIL AND GRAVEL

Inspect the integrity of all damp-proofing and water-proofing membranes which occur over, on or against any construction to be fully or partially concealed by earthwork prior to the placement of any imported soil, backfill, gravel fill or sub-base.

Correct defects prior to proceeding with the work.

3.03 TOPSOIL

Import additional topsoil only as required to bring planting areas up to finish grade. Spread and cultivate soil so that no settling takes place at any time.

3.04 LANDSCAPE FINE GRADING

Allow for the addition of soil amendments, conditioners and any specified top dressing when determining and executing finish grade.

Set finish grade 1-1/2 inches below adjacent paving, curb and headers for shrubs and ground cover beds and areas or as required for installation of decomposed granite or turf sod.

At all planting areas, make entire area smooth and even to finish grade. Cultivate all areas so that there are no bumps or hollows, and the area drains as indicated. Grade and maintain all flow lines, designated or not, to allow free flow of surface water. Cultivate entire areas to a depth of 6 inches minimum and remove all rock in excess of 1-1/2 inches diameter, all building rubble, building construction material, waste and any other material that will impair satisfactory growth.

3.05 DECOMPOSED GRANITE

Place 2-inches unless otherwise noted, in all planting areas. Decomposed granite shall extend below all plant material, trees, and cactus. Decomposed granite finish grade 1-1/4-inch below adjacent paving, curbs, and headers.

3.06 HERBICIDE APPLICATION

Apply pre-emergent herbicides in accordance with manufacturer's instructions.

Apply contact herbicides in accordance with manufacturer's recommendations. Prior to application, moisten areas for fourteen days to encourage weed germination and growth. Apply before weeds attain a height of 6 inches. Remove taller weeds manually.

Areas to be landscaped shall be maintained in a weed-free condition at all times during construction and maintenance period.

Do not apply pre-emergent herbicides at locations of revegetation seeding. The contractor shall manually remove invasive weeds within these areas.

3.07 TREE SUPPORT

Guyed Trees: Guy trees as shown immediately after planting as shown on the drawings.
Staked Trees: Stake trees as shown on the drawings within 48-hours of planting.

Tree supports shall be installed to prevent lodging, yet allow for trunk movement. Hoses that anchor tree trunks shall be large enough to allow for normal growth of the trunk during the first year without girdling.

3.08 TREES, SHRUBS, AND VINES

Layout locations with stakes or gypsum. Coordinate with Owner's Representative to assure appropriate location, prior to installation.

Test drainage of plant beds and pits by filling with water. Notify Owner's Representative of areas where water is retained more than 24 hours.

Where rock, underground construction or other detrimental conditions are encountered at plant pits, Owner's Representative may select alternate location.

Do not expose roots to air except during transplanting. Set up of plants at same level when planted as in the container. Cut plant containers on 2 sides without injuring root ball and carefully remove plant. Do not cut container with spade. Damaged plants will be rejected.

Dig pits with perpendicular sides to a minimum of 2 to 3 times the width (see details) of the root ball for containerized trees and shrubs. Dig pits only as deep as the root ball to prevent settling of the tree or shrub.

Place rootball of vines as close to structure or support system as possible. If rootball can't be placed closer than 12" notify Owner's Representative of situation for inspection and remedy.

Tie vines to trellis supports if applicable with green plant tape and remove any staking supplied with plant material.

Planting Mixture: One part wood shavings Two parts excavated soil amended to meet standards in Part 2.

Mix thoroughly outside the hole before start of backfilling.

Tree Guard: Install tree guard on all trees located in turf areas per manufacturer's recommendations.

3.09 BACKFILLING

Backfill plant pits and form shallow basin around the plant to hold enough water to saturate the root ball and backfill (only form basins if specified on detail). Water plants immediately after planting and allow backfill to settle in plant pit. Do not water saguaros after planting. Do not raise basin rim above surrounding grade.

Puddle planting mixture when pit is 2/3 full of plant mix. Continue back filling to within 1 inch of surrounding grade.

Finish grade to 2 inches below headers or concrete work.

Top dress planting areas with 2 inches of top dressing after planting.

Treat all planting areas with a pre-emergent.

3.10 GROUND COVER

At time of transplanting, soil in flats shall be sufficient so as not to fall apart when lifting plants. Plant each plant with its proportionate amount of the flat soil in a manner that will ensure a minimum disturbance to the root structure.

Plant flat material sufficiently deep to cover all roots. Firmly tamp the earth around each plant to force out large air pockets.

3.11 TURF SOD

Soil Preparation: Provide soil with an organic matter content of 25-percent to 30-percent. Cultivate entire area to a depth of 6" minimum and remove all rock in excess of 1 1/2", all building rubble, building construction material waste and any other material that will impair satisfactory growth. This top 6" must meet the topsoil requirements noted in Section 2.01.

Soil Amendments: Prior to rototilling, apply gypsum at a rate of 100 lbs per 1,000 sf, phosphate at a rate of 2 lbs per 1,000 sf., and soil sulfur at 5 lbs per 1,000 sf. Rototill into soil.

Install sod along the straightest edge of turf area. Stagger joints in a brick-like pattern. Avoid gaps and overlapping. Place sod diagonally across, to avoid sliding. Water sod at least every 30 min. during installation. Finish by watering lightly and roll in two directions w/sod roller.

3.11b TURF ARTIFICIAL

1.1 SUMMARY

- A. Provide all labor, materials, equipment, and tools necessary for the complete installation of synthetic grass surface. The system shall consist of, but not necessarily be limited to, the following:
 - a) Synthetic grass consisting of fibers that are a minimum of 1.54 inch long, Turf fiber construction consisting of polyethylene monofilament and either texturized monofilament fibers tufted to a 3-layer stabilized woven polypropylene fabric (primary backing), with a non-urethane, 100% recyclable secondary backing.
 - b) Synthetic Grass Infill, consisting of anti-microbial acrylic coated round silica particles, designed to provide the look, feel, and performance of optimally maintained natural grass. Envirofill or equivalent.

1.3 SUBMITTALS

- A. Comply with Section 01 33 00, Submittals Procedures.
- B. Product Data: Submit manufacturer's product data, including installation instructions and subsurface instructions.
- C. Warranty: Submit manufacturer's standard 10 year warranty.

PART 2 - PRODUCTS

2.1 SYNTHETIC GRASS SURFACE

- A. Aggregate Base - Gushed angular hard stone, 1/2" minus compactible stone [not clean]. (Refer to Section 3.2-8)
 - Synthetic grass: Artificial Lawns Co., "Coronado" 1180 S. 7th Ave, Phoenix AZ (623) 584-1456
 - a) Face Weight: 80 oz.
 - b) Face Yarn Type: Polyethylene
 - c) Pile Height: 2"
 - d) Tufting Gauge: 3/8"
 - e) Backing: Stabilized triple layered woven polypropylene
 - f) Total Product Weight 107 oz.
 - g) Warranty: 15 year fade
- C. Synthetic Grass Infill: Envirofill from Pioneer, 310 N. Pasadena St., Gilbert, AZ 85233 Phone (480) 926-8200 or approved equal. Coating: Primarily acrylic, iron oxide and chromium oxide.
- D. Splicing Material: 1000 denier coated nylon (Cordura®) 12" wide minimum. E. Adhesive: Synthetic Turf Adhesive

PART 3 - EXECUTION

3.1 GROUND PREPARATION

- A. General: The ground area to receive synthetic grass surface is indicated on the Drawings.
- B. Leveling and Site Preparation: All organic material and organic debris to be removed. Soil to be graded level and stabilized (compacted). Compaction shall be done with mechanical compactors, including vibratory compactors, and/or powered tampers, and rollers.

3.2 BASE AND SYNTHETIC GRASS CONSTRUCTION

- A. General: The area to be smooth and graded to allow proper drainage. Refer to grading plan.
- B. Compacted Aggregate Base: Place 4 inches of aggregate base as leveling layer compacted to 90% of max density per AASHTO 199. Compaction shall be done with mechanical compactors, including vibratory compactors, and/or powered tampers, and rollers. Aggregate size should be 1/4" minus (compactible).
- C. Synthetic Grass: Place turf and cut to fit configuration as shown on Drawings. Splice seams. All seams must be attached with splicing film/fabric and adhesive as approved by the manufacturer for this type of installation of their product.
- D. Infill: Apply layers of synthetic grass infill evenly with a spreader and broom the turf fibers with stiff bristle broom to stand fibers up and allow infill to settle into the bottom. Broom in infill round quartz silica sand approximately 3 pounds per square foot.
- E. Anchoring/Edging: Edges of turf will be secured to ground with mechanical fasteners, stakes or edging.

3.12 WATERING

Water all plants immediately after planting, except for saguaros, with hose in planting hole until material about the roots is completely saturated from the bottom of the hole to the top of the ground to avoid drying out until the entire planted area is thoroughly watered and the soil soaked to the full depth of each plant hole. Water stream shall not cause damage to planting hole or plant. Keep exposed roots wet by means of moist sawdust, peat moss or burlap at all times during planting operation. Repeat watering as often as necessary to keep the ground moist but not soaked, well below the root system of the plants.

3.13 CLEAN UP

Keep all areas clean and orderly during and after execution of work. Burning of trash is not permitted.

3.14 ADJUSTMENT

Prune each tree and shrub to preserve the natural character of the plant per American Standards for Nursery stock, as published by the American Association of Nurserymen. Prune only as directed by Owner's Representative and Landscape Architect to remove deadwood, suckers, or broken or badly bruised branches. Replace all plants damaged by excessive pruning, planting operations or construction damage.

3.15 MAINTENANCE PERIOD

When the Owner's Representative and Landscape Architect determine the work to be substantially complete in accordance with the Conditions of the Contract, Contractor will be advised, in writing, that the maintenance period is to begin.

Landscape contractor shall be responsible for maintenance of landscaped areas for a period of 90 days. Maintenance includes watering, trimming, weeding and cultivating of beds.


Landscape contractor, in order to protect his guarantee, shall give typewritten to Owner, a complete maintenance instruction booklet on the care and feeding of the landscape.

Contractor shall request, in writing, a Final Inspection with Landscape Architect at the completion of the maintenance period. If the Owner's Representative determines the work is satisfactory, the maintenance period will end on the date of the Final Inspection. If the maintenance is unsatisfactory, the maintenance period will be extended, at the Contractors expense, until such time as all corrections are made and the work is inspected and approved by the Owner's Representative and Landscape Architect. Retention will not be released until Final inspection is made and approval issued by the Owner's Representative.

3.16 FIELD QUALITY CONTROL

Notify Owner's Representative of the requirement for inspection at least 48 hours in advance. Inspections are required, but not limited to, the following:

- Inspection and acceptance of plant material prior to shipping.
- At completion of rough grade and boulder placement
- At completion of landscape finish grading and soil preparation, prior to planting.
- At installation of irrigation system, prior to backfilling trenches and planting.
- During installation of specimen tree, or other specimen plant material.
- After staking locations for plant holes, but prior to planting; for approval.
- During the planting process.
- During the placement and ciming of all light fixtures.
- At Substantial Completion of the Work.
- During warranty period to observe maintenance procedures.
- At final Completion of the Work.

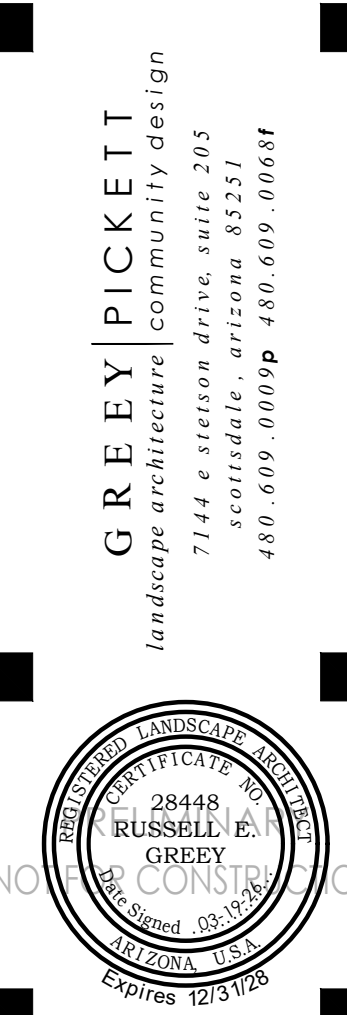

ROADRUNNER RESIDENCE

5611 E. Roadrunner Ln.
Paradise Valley, AZ. 85253



project #:
SAA112

scale:
N/A

issued for:

drawn by:
TEAM

date:
03/19/2026

drawing:
Planting Specifications

L8.1

of

SECTION - 02810 IRRIGATION

PART I - GENERAL

1.01 WORK INCLUDED

Work of this Section generally includes a provision of an underground irrigation system including the following:

- *Trenching, stockpiling excavation materials, and refilling trenches.
- *Complete systems including but not limited to piping, backflow preventer assemblies, valves, fittings, heads, controller wiring and final adjustments to ensure efficient coverage as determined by Consultant.
- *Water connections.
- *Replacements of unsatisfactory materials.
- *Clean-up, inspection, and approval.
- *Tests.

1.02 REFERENCES

Perform Work in accordance with requirement of Conditions of the Contract and division 01 - General Requirements as well as provisions of all applicable laws, codes, ordinances, rules and regulations. Conform to requirements of reference information listed below except where more stringent requirements are shown or specified in Contract Documents.

- American Society for Testing and Materials (ASTM) - Specifications and Test Methods specifically referenced in this Section.
- Underwriters Laboratories (UL) - UL Wires and Cables.

1.03 QUALITY ASSURANCE

Installer Qualifications - Installer shall have had considerable experience and demonstrated ability in the installation of irrigation system(s) of specified type(s) in a neat, orderly and responsible manner in accordance with recognized standards of workmanship. To demonstrate ability, experience and financial stability necessary for this Project, submit if requested by Consultant, prior to contract award the following:

- List of 3 projects completed in the last 2 years of similar complexity to this Project. Description of projects shall include:
 - a. Name of project.
 - b. Location.
 - c. Owner.
 - d. Brief description of work and project budget.
- Current company financial statement.

Special Requirements:

- Tolerances - Specified depths of pressure supply lines and laterals and pitch of pipes are minimums. Settlement of trenches is cause for removal of finish grade treatment, refilling, recompaction, and repair of finish grade treatment.
- Coordination with Other Contracts - Protect, maintain, and coordinate Work with Work under other Sections.
- Damage to Other Improvements - Contractor shall replace or repair damage to grading, soil preparation, seeding, sodding, or planting done under other Sections during work associated with installation of irrigation system at no additional cost to Owner.
- Work involving substantial plumbing for installation of backflow preventers, copper service and related work shall be executed by licensed and bonded plumber(s), performed in accordance with prevailing codes and regulations.
- Work involving connection to, installation, or extension of 120 volt or greater electrical service, shall be executed by a licensed and bonded electrician, performed in accordance with prevailing codes and regulations.

1.04 SUBMITTALS

Prepare and make submittals in accordance with conditions of the Contract.

Records Drawings (As-Builts):

- At onset of irrigation installation contractor shall secure mylar sepia of site plan from Landscape Architect. Make blue-line or black-line prints for every week on Project. At end of every day, revise prints for Work accomplished that day in red ink. As-built sepia shall be brought up-to-date at close of working day on every Friday by a qualified drafts person. One up-to-date print shall be mailed to Consultant on Monday of each week. An additional print of record plan(s) shall be available at Project Site. Upon completion of Project submit for review, prior to final acceptance, final set of as-built mylar sepia. Dimension from two permanent points of reference (building corners, sidewalk, road intersections or permanent structures), location of the following items:
 - a. Connection to existing water lines.
 - b. Routing of pressure supply lines (dimension every 100 feet along routing).
 - c. Electric control valves.
 - d. Quick coupling valves.
 - e. Drip line blow-out stubs.
 - f. Control wire routing (if not with pressure supply line).
 - g. Other related equipment as directed by Consultant.

- Consultant will not certify any pay request submitted by the Contractor if the as-built drawings are not current, and processing of pay request will not occur until as-builts are updated.
- Prior to scheduling walk-through for substantial completion, contractor to submit all as-builts information to consultant for approval.

Controller Drawings - Do not prepare controller drawings until record (as-built) drawings have been approved by Consultant.

- Provide controller drawing, automatic controller.
 - a. Controller drawing may be same size reproduction of record drawing, if scale permits fitting inside controller door without folding drawing. If photo reduction prints are required, keep reduction to maximum size possible to retain full legibility.
 - b. Controller drawing shall be blue-line print of actual as-built system, showing area covered by that controller.
 - c. Identify area of coverage of each remote control valve, using a distinctly different pastel color for each zone. Highlight heads, lateral piping, and control valves.
 - d. Following review of controller drawings by Consultant, hermetically seal each drawing between two layers of 20 mm thick clear plastic.
 - e. Controller drawing shall be completed and approved by Consultant prior to final completion walk-through of irrigation system.
 - f. Attach approved controller drawing to inside of each controller door using self adhesive Velcro strips.

Operation Manual: Submit 3 sets of operations manual to Consultant for approval or prior to scheduling final completion walk-through. Manual to include the following in 1 x 3 ring binder:

- Index sheet stating project name, and listing contractor name, address, phone number and contract person including Primary Sub-Contractors.
- Manufacturer cut sheets for all material components of irrigation system. Highlight or circle specific model or item.

1.05 DELIVERY, STORAGE & HANDLING

Deliver, unload, store and handle materials, packaging, bundling, products, in dry, weatherproof condition in manner to prevent damage, breakage, deterioration, intrusion, ignition, and vandalism. Deliver in original unopened packaging containers prominently displaying manufacturer name, volume, quantity, contents, instructions, and conformance to local, state and federal law.

1.05 DELIVERY, STORAGE & HANDLING (CONT.)

Remove and replace cracked, broken, or contaminated items or elements prematurely exposed to moisture, inclement weather, snow, ice, temperature extremes, fire or job site damage.

Handling of PVC Pipe - Exercise care in handling, loading and storing of PVC pipe. All PVC pipe shall be transported in a vehicle which allows length of pipe to lie flat so as not to subject it to undue bending or concentrated external loads. All sections of pipe that have been dented or damaged shall be discarded, and if installed, shall be removed and replaced with new piping.

1.06 JOBSITE CONDITIONS

Protection of Property:

- Preserve and protect all trees, plants, monuments, structures, and paved areas from damage due to Work of this Section. In the event damage does occur, all damage to inanimate items shall be completely repaired or replaced to satisfaction of Owner. All injury to living plants shall be repaired by Owner, and all costs of such repairs shall be charged to and paid by Contractor.
- Protect buildings, walks, walls, and other property from damage. Flare and barricade open ditches. Damage caused to asphalt, concrete, or other building material surfaces shall be repaired or replaced at no cost to Owner. Restore disturbed areas to original condition.

Existing Trees:

- All trenching or other Work under limb spread of any and all evergreens or low branching deciduous material shall be done by hand or by other methods so as to prevent damage to limbs or branches.
- Where it is necessary to excavate adjacent to existing trees, use all possible care to avoid injury to tress and tree roots. Excavation, in areas where 2 inches and larger roots occur, shall be done by hand. Roots 2 inches or larger in diameter, except directly in the path of pipe conduit, shall be tunneled under and shall be heavily wrapped with burlap to prevent scarring or excessive drying. Where a trenching machine is operated close to trees having roots smaller than 2 inches in diameter, wall of trench adjacent to tree shall be hand rimmed, making clean cuts through roots. Roots 1 inch and larger in diameter shall be painted with two coats of Tree Seal. Trenches adjacent to trees shall be closed within 24 hours, and when this is not possible, side of trench adjacent to tree shall be kept shaded with moistened burlap or canvas.

Protection and Repair of Underground Lines:

- Request proper utility company to stake exact location (including depth) of all underground electric, gas, or telephone lines. Take whatever precautions are necessary to protect these underground lines from damage. In the event damage does occur, all damage shall be repaired by Contractor unless other arrangements have been made.
- Replacement of Paving and Curbs - Where trenches and lines cross existing roadways, paths, curbing, etc., damage to these shall be kept to a minimum and shall be restored to original condition.

1.07 WARRANTY / GUARANTY

Remove and replace cracked, broken, or contaminated items or elements prematurely exposed to moisture, inclement weather, snow, ice, temperature extremes, fire or job site damage.

Handling of PVC Pipe - Exercise care in handling, loading and storing of PVC pipe. All PVC pipe shall be transported in a vehicle which allows length of pipe to lie flat so as not to subject it to undue bending or concentrated external loads. All sections of pipe that have been dented or damaged shall be discarded, and if installed, shall be removed and replaced with new piping.

1.08 MAINTENANCE

Furnish the following maintenance items to Owner prior to final Acceptance:

- 2 sets of special tools required for moving, disassembling, and adjusting each type of sprinkler head and valve supplied on this Project.
- 2 keys for each automatic controller.
- 1 quick coupler key and matching hose swivel.

1.09 EXTRA STOCK

In addition to the installed system, furnish the following items to Owner: A 4 per 100 installed drip emitters of each type used.

PART II - PRODUCTS

2.01 MATERIALS

General Piping:

- Pressure Supply Lines (downstream of backflow prevention units) - Class 200 BE (1)
- Non-pressure lines - Class 200 BE -
- Drip Tubing - Hardie EHD 2057-050 DURA-POL Blue Stripe Hose.
- Emitter Tubing - by emitter manufacturer.

Plastic pipe and Fittings:

1. Identification Markings:

- All pipe to be identified with following indelible markings:
 - 1) Manufacturers Name.
 - 2) Nominal pipe size.
 - 3) Schedule of class.
 - 4) Pressure Rating.
 - 5) NSF (National Sanitation Foundation) seal of approval.
 - 6) Date of extrusion.
- Solvent Weld Pipe - Manufactured from virgin polyvinyl chloride (PVC) compound in accordance with ASTM D2241 and ASTM D1784; cell classification 12245-B, Type 1, Grade 1.

- Fittings - Standard weight, Schedule 40, injection molded PVC; complying with ASTM D1784 and D2466, cell classification 12454-B.
 - 1) Threads - Injection molded type (where required).
 - 2) Tees and ells - Side gated.
 3. Threaded Nipples - ASTM D2464, Schedule 80 with molded threads.
 - c. Joint Cement and Primer - Type as recommended by manufacturer of pipe and fittings.

Low Pressure/Volume Systems:

- Emitters as indicated on drawings.

- Drip Tubing - manufactured of flexible vinyl chloride compound conforming to ASTM D1248, Type 1, Class C, Category 4, P14 and ASTM D3350 for PE 1221110.
- Fittings - As recommended by tubing manufacturer.
- Drip Valve Assembly - Type and size shown on drawings.

- a. Wye Strainer - Plastic/Fiberglass construction with 150 mesh nylon screen and blow out assembly,

2.01 MATERIALS (CONT.)

- Control Valve - 2 way, solenoid pilot operated type made of synthetic, non-corrosive material; diaphragm actuated and slow closing. Include freely pivoted seat seal retained (mounted) without attachment to diaphragm.
- Pressure Reducing Valve - Plastic/Fiberglass construction with adjusting nut.

Copper Pipe and Fittings:

- Copper Pipe - Type K hard tempered.
- Fittings - Wrought copper, solder joint type.
- Joints - Soldered with solder, 45% silver, 15% copper, 16% zinc, and 24% cadmium and solids at 1125 F and liquids at 1145F.

Brass Pipe and Fittings:

- Brass Pipe - 85% red brass, AMSI Schedule 40 screwed pipe.
- Fittings - Medium brass, screwed 125 pound class.

Quick Coupling Valves - Brass two-piece body designed for working pressure of 150 psi; operable with quick coupler. Equip quick coupler with locking rubber cover.

Valve Boxes:

- Drip Line Blow-out Stubs, and Wire Stub Box - Carson #910-12.
- 3/4 inch through 2 inch Control Valves - Carson #1419-138.
- Drip Valve Assemblies - Carson #1419-138.
- Control Wiring Splices - Carson #910-12.

Electrical Control Wiring:

- Low Voltage:
 - a. Electrical Control Wire - AWG UF UL approved No.14 gauge direct burial copper wire for all control wires, and No.12 gauge direct burial copper wire for all common wires.
 - b. Wire Colors:
 - 1) Control Wires - Red.
 - 2) Common Wires - White.
 - 3) Master Valve Wires - Blue.
 - 4) Future Wires - Same as control and common wire (labeled at terminations).
 - c. If multiple controllers are utilized, and wire paths of different controllers cross each other, both common and control wires from each controller shall be different colors approved by Consultant.
 - d. Control wire connections and splices shall be made with 3M direct bury splice, Rain Bird Penlite connectors, or similar dry splice method.
- High Voltage - Type required by local codes and ordinances, of proper size to accommodate needs of equipment serviced.

Electric Control Valves - As noted on drawings

Pipe bedding material - Construction grade sand approved by Consultant.

Automatic Controller - As shown on drawings.

Backflow Preventer - As shown on drawings.

PART III - EXECUTION

3.01 INSPECTION:

Examine areas and conditions under which Work of this Section is to be performed. Do not proceed with Work until unsatisfactory conditions have been corrected.

Grading operations, with the exception of final grading, shall be completed and approved by Owner prior to staking or installation of any portion of irrigation system except sleeving.

3.02 PREPARATION

Staking shall Occur as Follows:

- Mark with powdered lime or marking paint, routing of pressure supply line and flag heads and control valve locations for first series of zones as directed by Consultant. Contact Consultant 48 hours in advance and request review of staking. Consultant will review staking and direct changes if required. Staking review does not relieve installer from coverage problems due to improper placement of heads after staking.

Install sleeving under all asphalt paving and concrete walks, prior to concreting and paving operations, to accommodate piping and wiring. Compact backfill around sleeves to 95% Standard Proctor Density within 2% of optimum moisture content in accordance with ASTM D1557.

Trenching - Trench excavation shall follow, as much as possible, layout shown on Drawing. Dig trenches straight and support pipe continuously on bottom of trench. Trench bottom shall be clean and smooth with all rock and organic debris removed. Pressure supply line trenches shall be over-excavated as required to allow for bedding material. Trench depth shall be uniform as required to meet minimum depth requirements for type of piping.

1. Clearances:

- a. Piping smaller than 3 inches - Trenches shall have a minimum width of 7 inches.
- b. Line clearance - Provide not less than 6 inches of clearance between each line, and not less than 12 inches of clearance between lines of other trades.

2. Pipe and Wire Depth:

- a. Pressure Supply Piping - 24 inches from top of pipe.
- b. Non-pressure piping (pop-up) - 18 inches from top of pipe.
- c. Control Wiring - Side and bottom of pressure supply line.
- d. Drip Tubing - 12 inches from top of pipe.
- e. Emitter tubing - 12 inches from top of pipe (non slope plantings). 4 inches from top of pipe (slopes 2:1 or greater).
3. Boring will be permitted only where pipe must pass under obstruction(s) which cannot be removed, and must be approved by consultant if not specifically indicated on construction drawings. Final density of backfill shall match that of surrounding soil. Use of sleeves of suitable diameter is acceptable if installed first by jacking or boring, and pipe laid through sleeves. Observe some precautions as though pipe were installed in open trench.

3.03 INSTALLATION

Locate other equipment as near as possible to location designated on construction drawings. Deviations shall be approved by Consultant prior to installation.

PVC Piping:

- Snake pipe in trench as much as possible to allow for expansion and contraction.
- When pipe laying is not in progress, or at end of each day, close pipe ends with tight plug or cap. (Perform work in accordance with good practices prevailing in piping trades).
- Coordinate pressure supply line installation with required bedding operations.
- Stake all above grade PVC piping per details.

3.03 INSTALLATION (CONT.)

- Use 45 degree ells when making perpendicular crossings of above grade PVC piping, to depress bottom pipe.
- Lay pipe and make all plastic to plastic joints in accordance with manufacturers recommendations.

Drip Tubing:

- Install fitting connections per manufacturers recommendations.
- Use only manufacturer provided or recommended hole punch when making penetrations in drip tubing for insert fittings. Use of other hole punch shall be cause for immediate removal and replacement of all installed drip tubing.
- Install drip line blow-out stubs at all dead ends of drip tubing.
- Any deviations from drip tube routing shown on drawings must be approved by consultant prior to installation.

Control Wiring:

- Low Voltage Wiring:
 - a. Bury control wiring between controller and electric valves in pressure supply line trenches, with wires consistently located below and to one side of pipe, on top of initial pipe bedding, or in separate trenches.
 - b. Bundle all 24 volt wires at 10 foot intervals with electrical or duct tape.
 - c. Provide an expansion loop at pressure supply line angle fittings, every electric control valve location (in valve box), and at minimum 500 feet intervals. From expansion loop by wrapping wire at least 8 times around an inch pipe and with drawing pipe.
 - d. Make splices and electric control valve connections using Rainbird Penlite connectors or similar dry splice method.
 - e. Install control wire splices not occurring at control valve in a separate splice valve box.
 - f. Install one control wire for each control valve.
 - g. Run 2 spare #14-1 control wires from controller pedestal to last electric control valve operated by controller on each and every leg of pressure supply line. Label spare wires at controller and wire stub box. Loop a minimum of 24 inches from all spare wires inside every control valve box operated by controller.
 - h. Run all future control wires from controller pedestal to point indicated on drawings. Call a minimum of ten (10) feet at termination and install in 10 inch round valve box. Label all wires at termination.
- High Voltage Wiring for Automatic Controller:
 - a. Provide 120 volt power connection to automatic controller.

Automatic Controller:

- Install controller in accordance with manufacturers instructions as detailed and where shown on Drawings.
- Connect remote control valves to controller in numerical sequence as shown on Drawings.
- Final location of controller shall be approved by Consultant prior to installation.
- Each controller shall have a dedicated separate ground wire.
- Above ground conduit shall be rigid galvanized with appropriate fittings. Below ground conduit shall be Schedule 40 PVC.

Quick Coupling Valves:

Install quick couplers on double swing-joint assemblies of Schedule 80 PVC pipe; flush to grade. Angled nipple relative to pressure supply line shall be no more than 45 degrees and no less than 10 degrees. Install quick coupling as detailed.

Drip Valve Assemblies - Install drip valve assembly as detailed.

Drip Emitters - Install drip emitters as detailed.

Valve Boxes:

- Install one valve box for each type of valve installed as detailed, flush with grade for all sodded areas and above grade for all planted areas.
- Valve box extensions are not acceptable except for master valve.
- Install gravel sump after compaction of all trenches. Valve box to rest on gravel sump. Place final portion of gravel inside valve box after valve box is backfilled and compacted.
- Brand all valve box lids. Letter and number size shall be no smaller than 1 inch and no greater in size than 1- inches. Depth of branding shall be no more than 1/8 inch into valve box lid as follows:
 - a. Control valves - Brand controller letter and station number on lid of each control valve box.
 - b. Quick Coupling Valves - Brand quick coupling valve box lids with letter Q.C..
 - c. Wire Splices - Brand all wire splice box lids with letters W.S.
 - d. Drip Tubing Blow-out Stubs - Brand controller letter and station number on lid of each drip tubing blow-out box lid.

Backflow Preventer - Install as detailed Drawings.

Control Wiring:

- All control wiring to be laid to bottom and side of pressure supply line trench. Separate wire trenches will not be allowed unless approved by Consultant prior to installation.

Backfilling - Do not begin backfilling operation until required system tests have been completed. Backfill shall not be done in freezing weather except with prior approval by Consultant. Leave trenches slightly mounded to allow for settlement after backfilling is completed. Trenches shall be finish graded prior to walk-through of system by Consultant.

- All pressure supply lines shall be bedded with construction grade sand 4 inches below invert of pipe, to 6 inches above top of pipe and width of trench when site conditions are rocky or otherwise unfavorable.
- Materials - Excavated material is generally considered satisfactory for backfill purposes after completing bedding requirements. Backfill material shall be free of rubbish, vegetable matter, frozen materials, and stones larger than 2 inches in maximum dimension. Do not mix subsoil with topsoil. Material not suitable for backfill shall be hauled away. Contractor shall be responsible for providing suitable backfill if excavated material is unacceptable or not sufficient to meet backfill, compaction, and final grade requirements.
- Do not leave trenches open for a period of more than 48 hours. Open excavations shall be protected in accordance with OSHA regulations.
- Compact backfill to 90% maximum density in 6 lifts, determined in accordance with ASTM D155-7 utilizing the following methods:
 - a. Mechanical tampering.
 - b. Puddling or ponding. Puddling or ponding and/or jetting is prohibited within 10'-0" of building or foundation walls.

Piping Under Paving:

- Provide for a minimum cover of 24 inches between the top of the pipe and the bottom of the aggregate base for all pressure and non-pressure piping installed under asphalt concrete or concrete paving.
- Piping shall be bedded with construction grade sand or squeegee - 6 inches below pipe to 6 inches above pipe and width of excavation.

3.03 INSTALLATION (CONT.)

- Compact backfill material in 6 inch lifts at 95% maximum density determined in accordance with ASTM D1557 using manual or mechanical tamping devices.
- Set in place, cap, and pressure test all piping under paving, in presence of Consultant or Owner prior to backfilling and paving operations.
- Piping under existing walk or concrete pavement shall be done by jacking, boring, or hydraulic driving, but where cutting or breaking of walks and/or concrete is necessary, it shall be done and replaced at no cost to Owner. Obtain permission and prior approval to cut or break walks and/or concrete from Owner.

3.04 FIELD QUALITY CONTROL

Flushing - After piping, risers, and valves are in place and connected, but prior to installation of sprinkler heads, quick coupling valves, and air release valves, thoroughly flush piping system under full head of water pressure from dead end fittings. Maintain flushing for 5 minutes through furthestmost valves. Cap riser after flushing.

Testing - Conduct tests in presence of Consultant. Arrange for presence of Consultant a minimum of 48 hours in advance of testing. Supply force pump and all other test equipment.

- After backfilling, and installation of all control valves, quick coupling valves, fill pressure supply line with water, and pressurize to 40 PSI over the designated static pressure or 120 PSI, whichever is greater, for a period of 2 hours.
- Leakage, Pressure Loss - Test is acceptable if no leakage or loss of pressure is evident during test period.
- Leaks - Detect and repair leaks.
- Retest system until pressure can be maintained for duration of test.
- Before final acceptance, pressure supply line shall remain under pressure for a period of 48 hours.

Walk Through for Substantial Completion:

- Arrange for Consultants presence a minimum of 48 hours in advance of walk-through.
- Entire System shall be completely installed and operational prior to scheduling of walk-through. All sodded areas are to be complete with head height and valve boxes adjusted accordingly.
- Operate each zone in its entirety for Consultant at time of walk through and open all valve boxes.
- Consultant shall generate a list of items to be corrected prior to Final Completion.
- Furnish all materials and perform all Work required to correct all inadequacies due to deviations from Contract Documents, and as directed by Consultant.
- During walk-through, expose all drip emitters under operations for observation by Consultant to demonstrate that they are performing and installed as designed; prior to placing of all mulch material. Schedule separate walk-through if necessary.

Walk-Through for Final Completion:

- Arrange for Consultants presence a minimum of 48 hours in advance of walk through.
- Show evidence to Consultant that Owner has received all accessories, charts, record drawings, and equipment as required before Final Completion walk-through is scheduled.
- Operate each zone identified as deficient at substantial completion walk-through for Consultant at time of final completion walk-through to ensure correction of all incomplete items.
- Items deemed not acceptable by Consultant shall be reworked to complete satisfaction of Consultant.
- If after request to Consultant for walk-through for Final Completion of irrigation system, Consultant finds items during walk through, Contractor shall be charged for all subsequent walkthroughs. Funds will be withheld from final payment and/or retained to Contractor, in amount equal to additional time and expenses required by Consultant to conduct and document further walk-through as deemed necessary to ensure compliance with Contract Documents.

3.05 ADJUSTING

Upon substantial completion of installation, fine-tune entire system by regulating valves, adjusting patterns and break-up arms/screws, and setting pressure reducing valves or throttling control valve flow controls at proper pressure to provide optimum and efficient coverage. Flush and adjust all sprinkler heads for optimum performance and to prevent overspray onto walks, roadways, and buildings as much as possible. Heads of same type shall be operating at same pressure +/- 7%.

If it is determined that irrigation adjustments will provide proper and more adequate coverage, make such adjustments prior to Final Acceptance, as directed, at no additional cost to Owner. Adjustments may also include changes in nozzle sizes, degrees of arc, and control valve throttling.

All sprinkler heads shall be set perpendicular to finish grade unless otherwise designated.

Areas which do not conform to designated operation requirements due to unauthorized changes or poor installation practices shall be immediately corrected at no additional cost to the Owner.

3.06 CLEANING

Maintaining continuous cleaning operation throughout duration of Work. Dispose of off-site at no additional cost to Owner, all trash or debris generated by installation of irrigation system.



ROADRUNNER RESIDENCE

5617 E. Roadrunner Ln,
Paradise Valley, AZ. 85253



project #:
SAA112

scale:
N/A

issued for:

drawn by:
TEAM

date:
03/19/2026

drawing:
Irrigation Specifications

L8.2

of