

# Water Flow Test Record

**Input information in non-shaded areas only.**

## Test Hydrant Number

## Location

NW Corner of Jack Rabbit and Casa Blanca Rd, Paradise Valley

Flow Hydrant #1

Flow Hydrant #2

Flow Hydrant #3

Flow Hydrant #4

Flow Hydrant #5


Flow Hydrant #6

## Test Data Information

Date	29-Apr-16			
Static Pressure (psig)	76			
Residual Pressure (psig)	70			
Outlet Size (inches)	2.5			
Coefficient	0.9			
Pitot Pressure	65			
Test Flow (gpm)	1353	0	0	A
Flow (gpm) available @ 20 psi	4519	0	0	#VALUE!
Flow (gpm) available @ 10 psi	4938	0	0	0

Column heading color correlates to line color on the chart

### Water Flow Test Chart

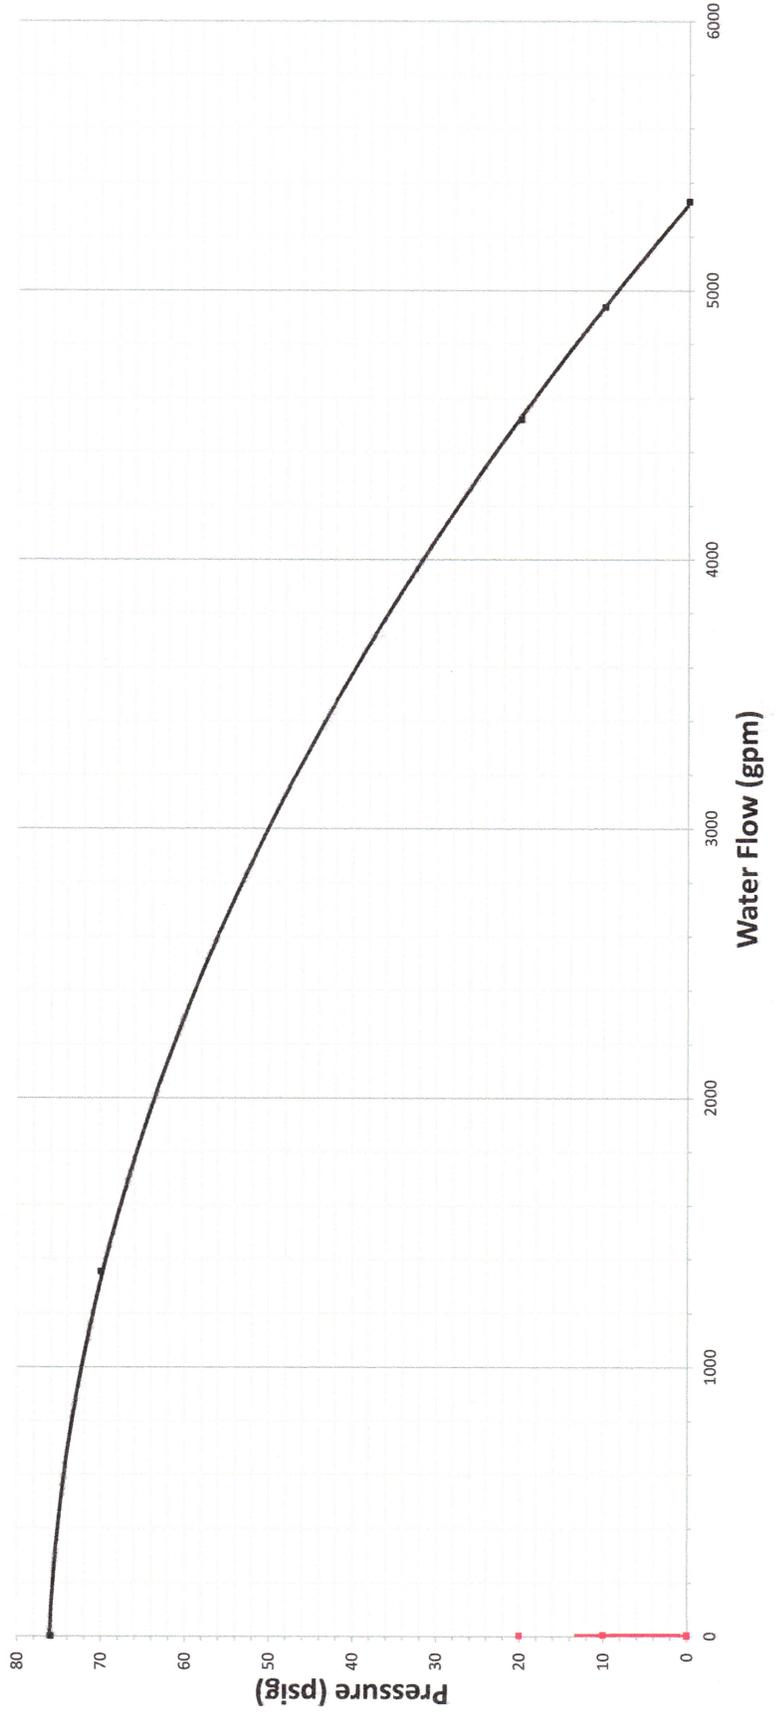

(For multiple test information printed on one chart, color printer required)