

mountain view medical center, LLC
Mountain View Medical Center Redevelopment
10555, 10565, 10575, 10585, 10595, 10599 N. Tatum Blvd.,
Paradise Valley, Arizona 85253

CLIENT CONTACT
mountain view medical center
8014 N. 14th St
Phoenix, AZ 85018

602.802.8106 t

PROJECT NO.	DATE OF ISSUE
2018_041	11.01.2018
REVISION NO.	DATE
1	09.26.2018
2	11.01.2018


PROJECT TEAM DRAWN BY
John Cantrell BD

PROJECT PHASE
SUP major amendment Review #3

SHEET CONTENTS
photometric site plan

SHEET NO.

E-1.1

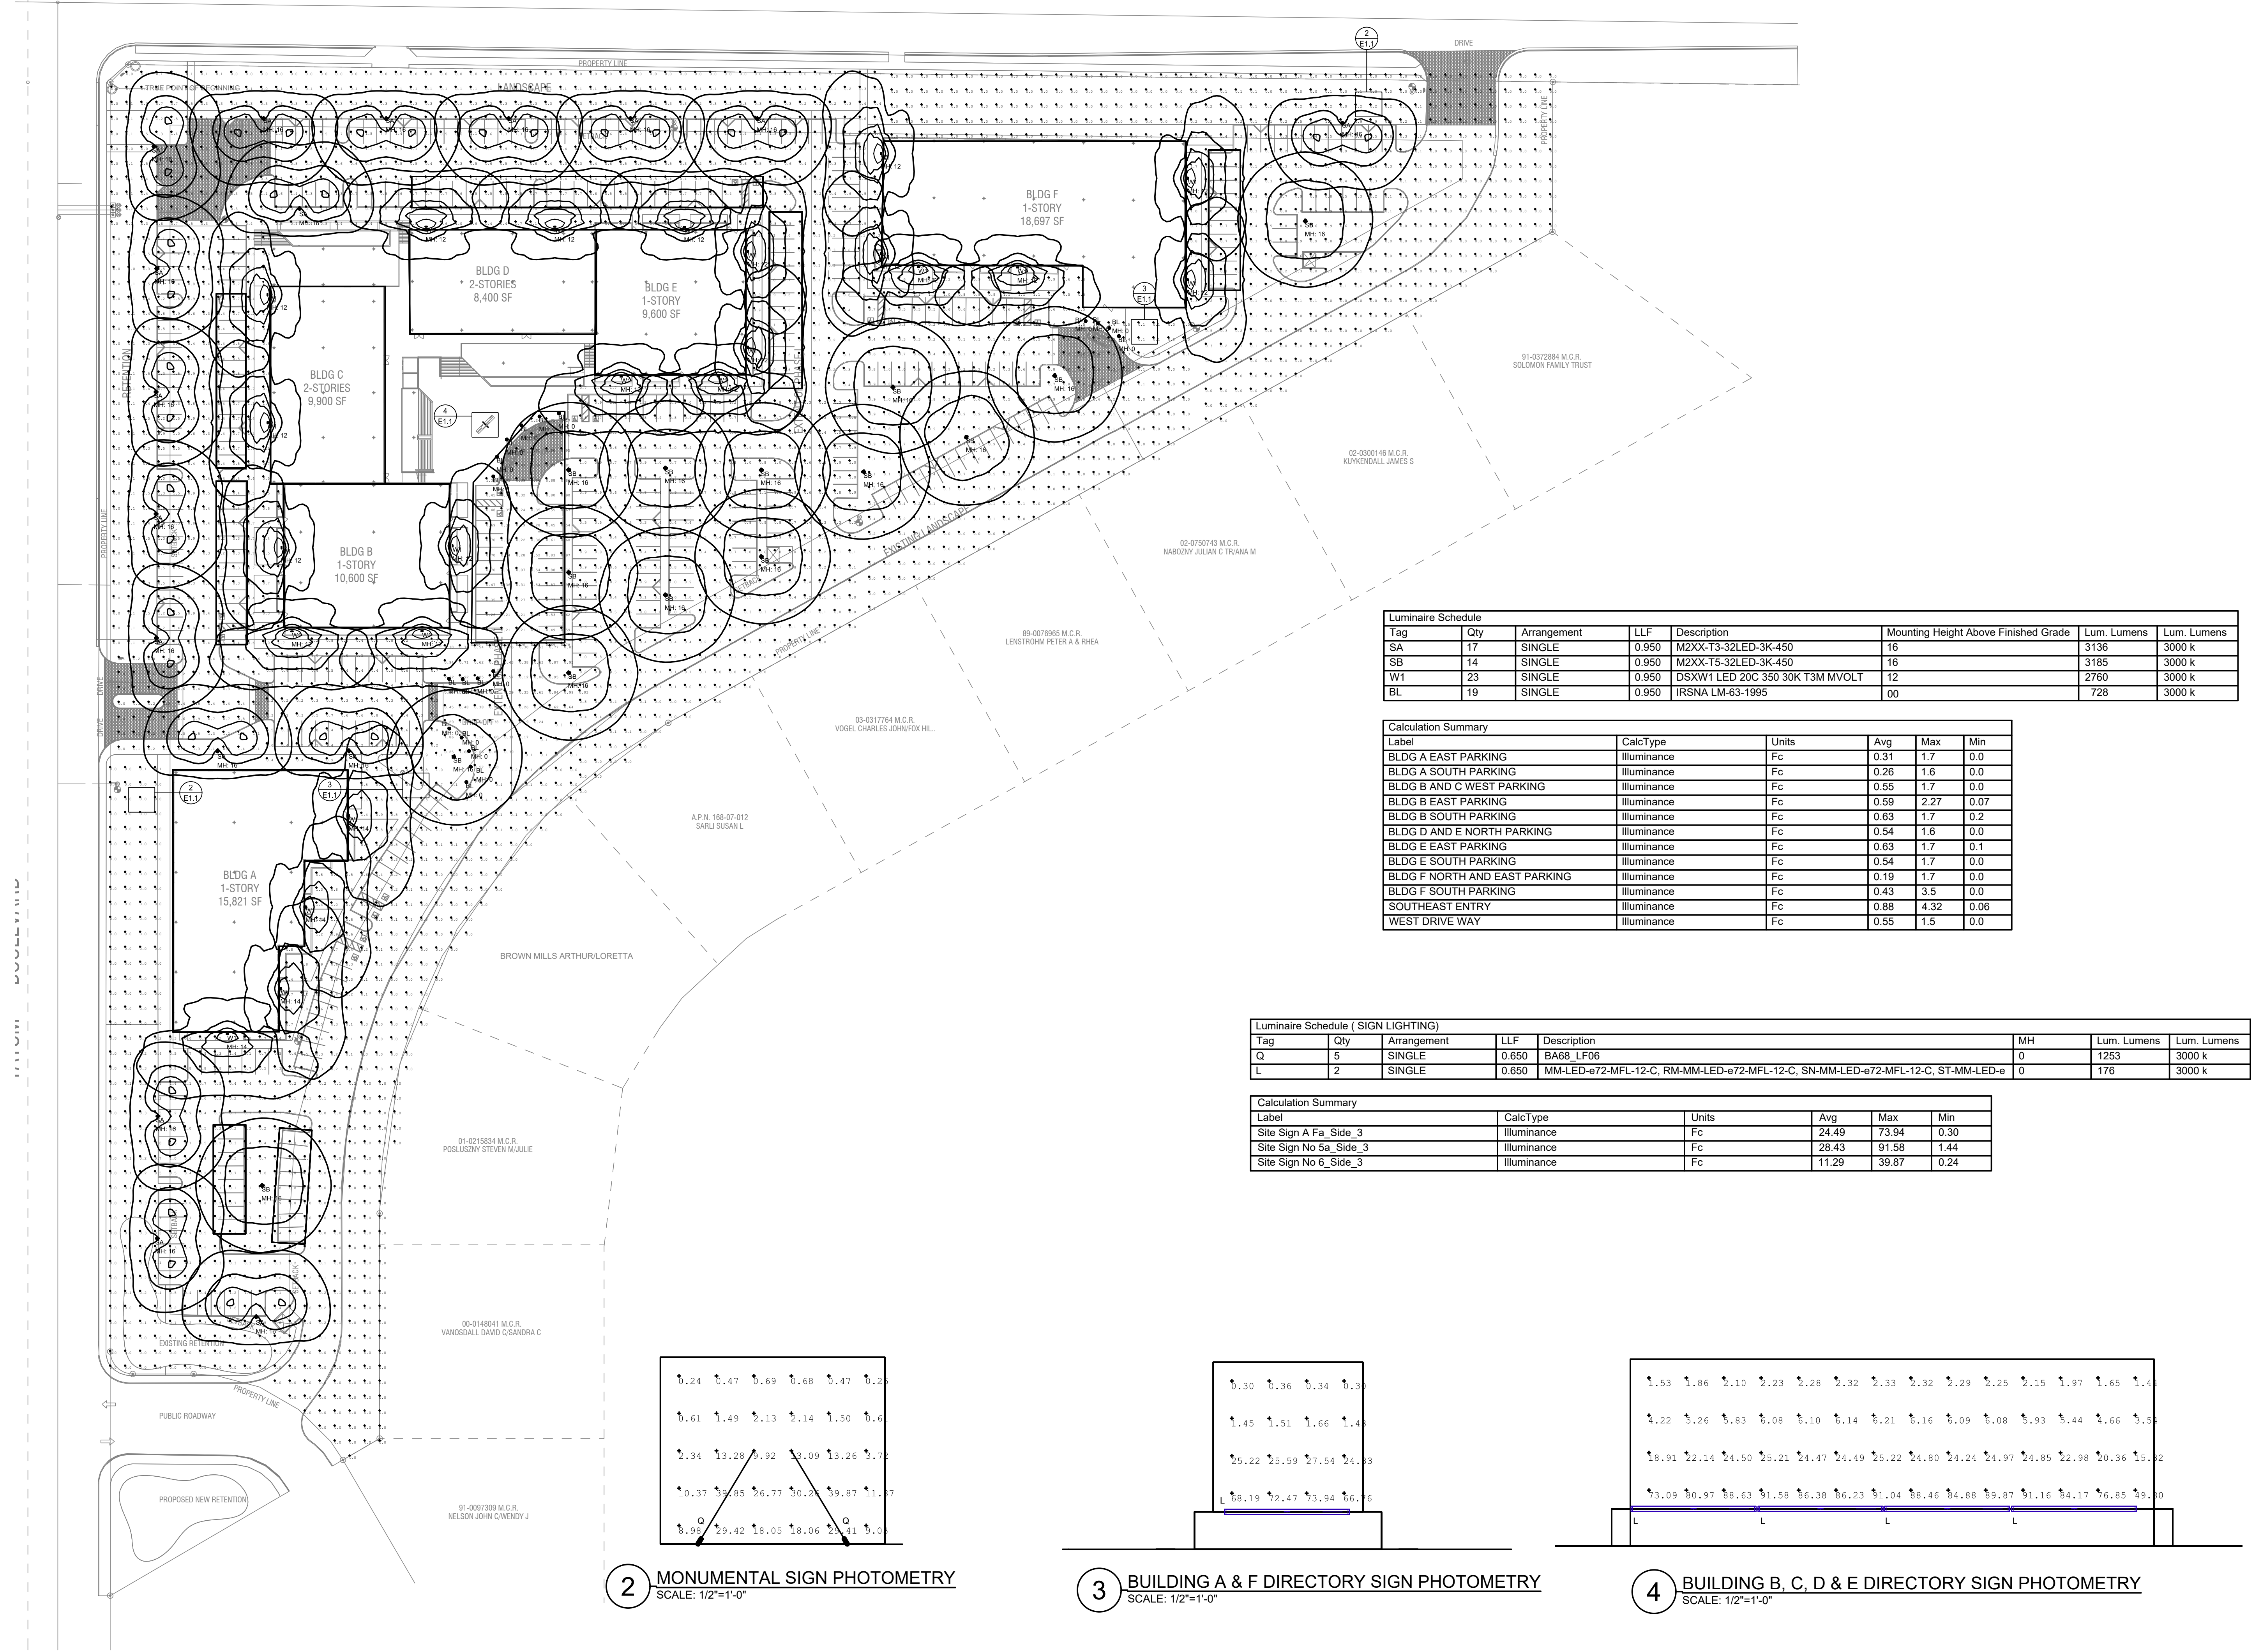

Luminaire Schedule

Tag	Qty	Arrangement	LLF	Description	Mounting Height Above Finished Grade	Lum. Lumens	Lum. Lumens
SA	17	SINGLE	0.950	M2XX-T3-32LED-3K-450	16	3136	3000 k
SB	14	SINGLE	0.950	M2XX-T5-32LED-3K-450	16	3185	3000 k
W1	23	SINGLE	0.950	DSXW1 LED 20C 350 30K T3M MVOLT	12	2760	3000 k
BL	19	SINGLE	0.950	IRSNA LM-63-1995	00	728	3000 k

Calculation Summary


Label	CalcType	Units	Avg	Max	Min
BLDG A EAST PARKING	Illuminance	Fc	0.31	1.7	0.0
BLDG A SOUTH PARKING	Illuminance	Fc	0.26	1.6	0.0
BLDG B AND C WEST PARKING	Illuminance	Fc	0.55	1.7	0.0
BLDG B EAST PARKING	Illuminance	Fc	0.59	2.27	0.07
BLDG B SOUTH PARKING	Illuminance	Fc	0.63	1.7	0.2
BLDG D AND E NORTH PARKING	Illuminance	Fc	0.54	1.6	0.0
BLDG E EAST PARKING	Illuminance	Fc	0.63	1.7	0.1
BLDG E SOUTH PARKING	Illuminance	Fc	0.54	1.7	0.0
BLDG F NORTH AND EAST PARKING	Illuminance	Fc	0.19	1.7	0.0
BLDG F SOUTH PARKING	Illuminance	Fc	0.43	3.5	0.0
SOUTHEAST ENTRY	Illuminance	Fc	0.88	4.32	0.06
WEST DRIVE WAY	Illuminance	Fc	0.55	1.5	0.0

Luminaire Schedule (SIGN LIGHTING)


Tag	Qty	Arrangement	LLF	Description	MH	Lum. Lumens	Lum. Lumens
Q	5	SINGLE	0.650	BA68_LF06	0	1253	3000 k
L	2	SINGLE	0.650	MM-LED-e72-MFL-12-C, RM-MM-LED-e72-MFL-12-C, SN-MM-LED-e72-MFL-12-C, ST-MM-LED-e	0	176	3000 k

Calculation Summary


Label	CalcType	Units	Avg	Max	Min
Site Sign A Fa_Side_3	Illuminance	Fc	24.49	73.94	0.30
Site Sign No 5a_Side_3	Illuminance	Fc	28.43	91.58	1.44
Site Sign No 6_Side_3	Illuminance	Fc	11.29	39.87	0.24

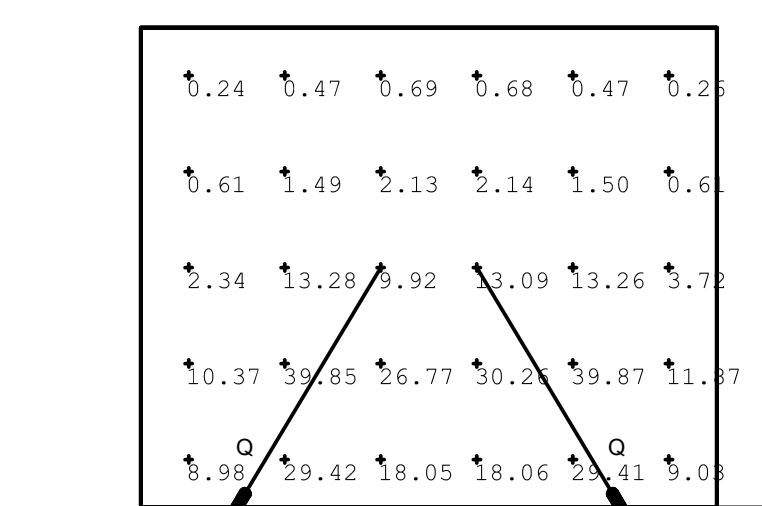

2 MONUMENTAL SIGN PHOTOMETRY
SCALE: 1/2"=1'-0"

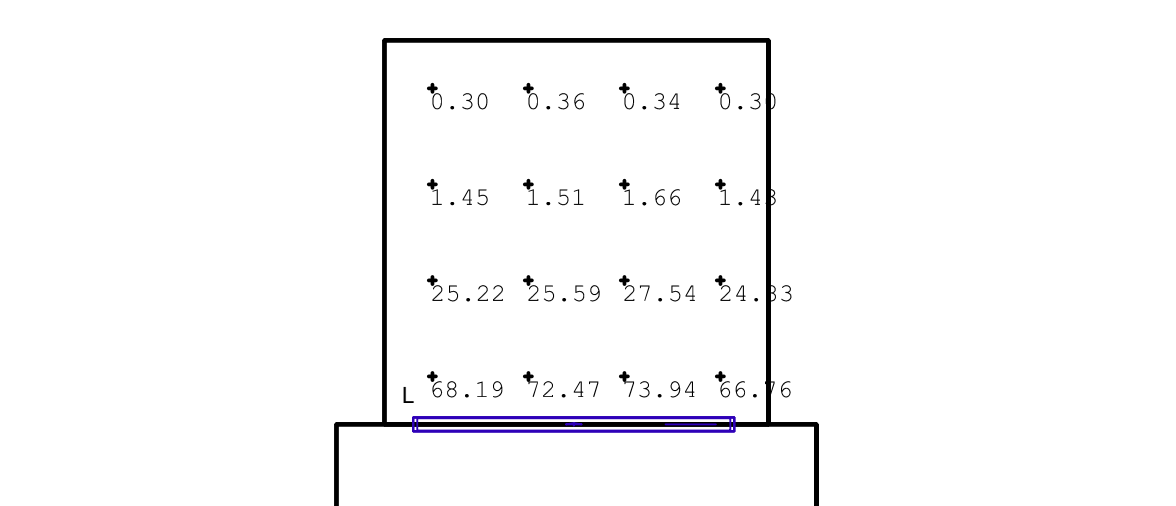

3 BUILDING A & F DIRECTORY SIGN PHOTOMETRY
SCALE: 1/2"=1'-0"

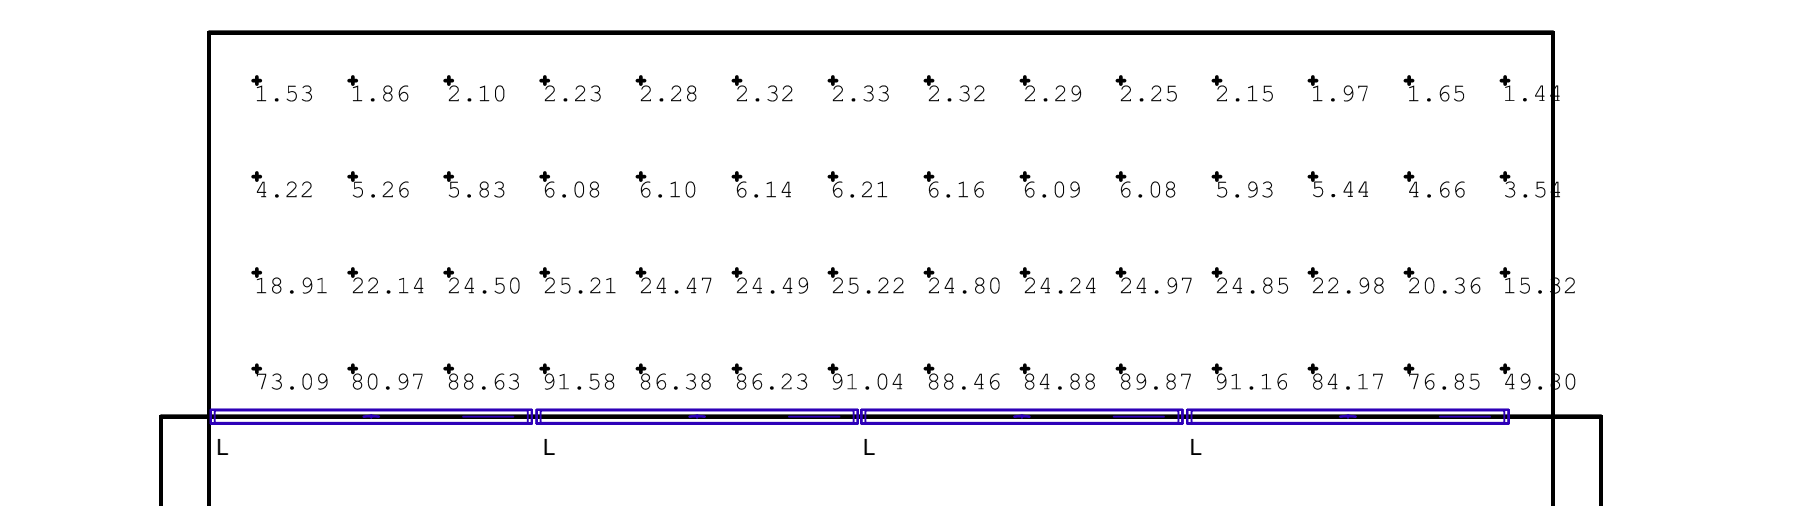

4 BUILDING B, C, D & E DIRECTORY SIGN PHOTOMETRY
SCALE: 1/2"=1'-0"

1 PHOTOMETRIC SITE PLAN
SCALE: 1"=40'-0"



D-Series Size 1 LED Wall Luminaire

Specifications Luminaire
 Width: 13.34" (34.4 cm) Weight: 12 lbs (5.4 kg)
 Depth: 10" (25.4 cm)
 Height: 6.38" (16.2 cm)

Back Box (BBW, ELCW)
 Width: 13.34" (34.4 cm) Weight: 5 lbs (2.3 kg)
 Depth: 4" (10.2 cm) Weight: 10 lbs (4.5 kg)
 Height: 6.38" (16.2 cm)

Introduction
 The D-Series Wall luminaire is a stylish, fully integrated LED solution for building-mount applications. It features a sleek, modern design and is carefully engineered to provide long-lasting, energy-efficient lighting with a variety of optical and control options for customized performance. With an expected service life of over 20 years of nighttime use and up to 74% in energy savings over comparable 250W metal halide luminaires, the D-Series Wall is a reliable, low-maintenance lighting solution that produces sites that are exceptionally illuminated.

Ordering Information EXAMPLE: DSXW1 LED 20C 1000 40K T3M MVOLT DBDXTD

DSXW1 LED	Series	LEDs	Drive Current	Color Temperature	Distribution	Voltage	Mounting	Control Options
DSXW1 LED	10C	10 LEDs	350 mA	3000K	T2M	120V	180°	None
DSXW1 LED	20C	20 LEDs	700 mA	4000K	T3M	120V	180°	None

Accessories
 DSXW1-10C: 10C LED luminaire
 DSXW1-20C: 20C LED luminaire
 DSXW1-30C: 30C LED luminaire
 DSXW1-40C: 40C LED luminaire


Notes
 1. 20C, 30C, 40C not available with PIR, PIR/PIR, PIR/PIR/PIR or PIR/PIR/PIR/PIR.
 2. MOCCT driver operates on any line voltage from 120V-277V (50/60Hz).

1 LUMINAIRE TYPE "W1/W2" NTS




Mitre™ LED- M2

FEATURES
 • Reliable, uniform, glare free illumination
 • Types II, III, IV, V and custom distributions
 • 3000K, 4000K, 5000K CCT
 • 0-10V dimming ready

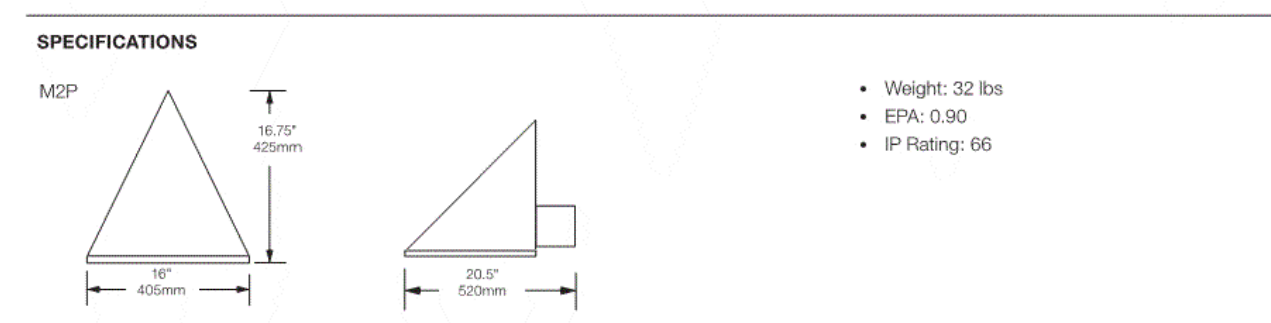

ORDERING CODE
 1. MODEL
 2. LIGHT ENGINE
 3. COLOR TEMPERATURE
 4. DRIVE CURRENT
 5. FINISH
 6. OPTIONS
 7. CONTROLS

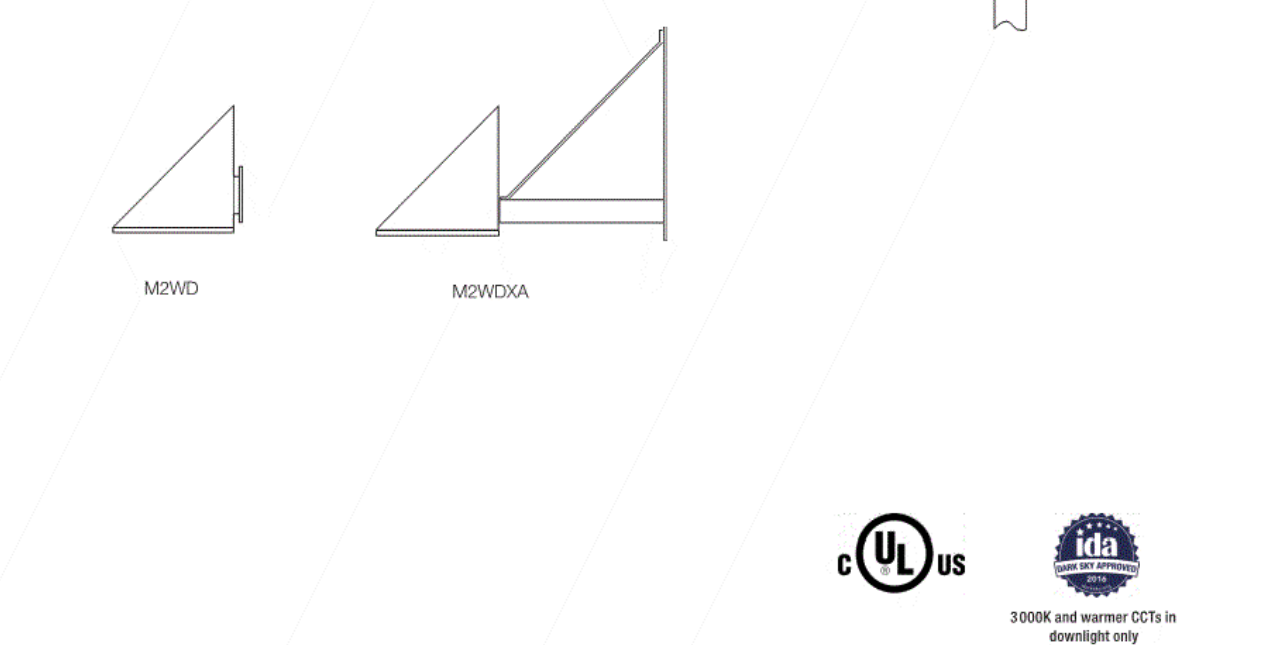

ARCHITECTURAL AREA LIGHTING
 17760 Rowland Street | City of Industry | CA 91748
 P: 626.968.6566 | F: 626.369.2695 | www.aal.net

JOB TYPE NOTES

Mitre™ LED- M2

Optimal System
 Secondary Lens
 Distribution
 Light Engine
 Delivered Lumens
 Efficacy (lm/w)
 Bug Rating
 Drive Current (mA)

Optimal System	Secondary Lens	Distribution	Light Engine	Delivered Lumens	Efficacy (lm/w)	Bug Rating	Drive Current (mA)	System Watts
MicroCore	No Lens (Standard)	TYPE 2	T2-3LED	4034	66	11.0	1.0	75

ELECTRICAL CHARACTERISTICS
 Optimal System
 Ordering Code
 LED Watts
 Line Voltage
 Amps AC
 Min. Power Factor
 Max THD (%)
 Operating Temp. Range
 Dimming Range
 Source current out of 0-10V purple wire
 Absolute voltage range on 0-10V purple wire

Optimal System	Ordering Code	LED Watts	Line Voltage	Amps AC	Min. Power Factor	Max THD (%)	Operating Temp. Range	Dimming Range	Source current out of 0-10V purple wire	Absolute voltage range on 0-10V purple wire
MicroCore	3LED	700	700	75	0.95	0.27	30°C TO +40°C	10% TO 100%	5mA	-4mA -20V -15V

LED COLOR
 CCT Average
 CRI Minimum

ARCHITECTURAL AREA LIGHTING
 17760 Rowland Street | City of Industry | CA 91748
 P: 626.968.6566 | F: 626.369.2695 | www.aal.net

JOB TYPE NOTES

Mitre™ LED- M2

HOUSING
 • All housing and mounting components shall be cast aluminum 356 alloy and sealed with continuous silicone rubber gaskets.
 • Standard configurations do not require a fan lens, optional lenses shall be pre-installed glass.
 • All internal and external hardware shall be stainless steel.
 • Optical bezel finish shall match the luminaire housing.

OPTICAL
 • Patent pending MicroCore™ LED modules shall independently aim each light emitting diode (LED) in both horizontal rotation and vertical tilt angles.
 • LED optics shall be clear injection molded PMMA acrylic.
 • MicroCore™ PCBs and optics shall be sealed to a die-cast anodized aluminum heat sink with an injection molded silicone rubber gasket. IP66.
 • Type 4 distribution with optional House Side Shield not available with clear or diffused glass lenses. Factory installed House Side Shield is optimized for Type 4 distribution and not recommended for use with Type 2 or 3 distribution and not available with Type 5 distribution.

ELECTRICAL
 • Luminaires shall have integral surge protection that shall be UL recognized and have a surge current rating of 10,000 Amps using the industry standard 8/20µSec wave and surge rating of 272A.
 • Drivers shall be UL recognized with an inrush current maximum of <200 Amps maximum at 230VAC.
 • Drivers shall not be compatible with current sourcing dimmers, consult factory for current list of known compatible dimming systems, approved dimmers include Lutron Diva A-TV, Lutron Nova N-TV and N-TV.
 • LifeShield™ shall be provided with all configurations for added protection in the event of abnormally excessive high ambient temperature conditions.

INSTALLATION AND MOUNTING (ARM MOUNTING)
 • The cast arm shall be configured to fit a four or five inch diameter pole.
 • The wall mounting plate shall be cast aluminum and fully gasketed and shall require mounting hardware by others.

CLIENT CONTACT
 mountain view medical center, LLC
 5343 North 16th Street, Suite 460
 Phoenix, AZ 85016
 TEL: 602.336.5200 FAX: 602.336.5201
 WWW.HENDERSONENGINEERS.COM

ARCHITECTURAL AREA LIGHTING
 17760 Rowland Street | City of Industry | CA 91748
 P: 626.968.6566 | F: 626.369.2695 | www.aal.net

JOB TYPE NOTES

2929 n central ave
 eleventh floor
 phoenix arizona 85012

602.257.1764 t
 602.257.9029 f

www.owp.com



HENDERSON ENGINEERS
 5343 NORTH 16TH STREET, SUITE 460
 PHOENIX, AZ 85016
 TEL: (602) 336-5200 FAX: (602) 336-5201
 WWW.HENDERSONENGINEERS.COM

1850003561
 AZ CORPORATE NUMBER: 10470-0
 EXPIRES 06/30/19

**mountain view medical center, LLC
 Mountain View Medical
 Center Redevelopment**

10555,10565,10575,10585,10595,10599 N. Tatum Blvd ,
 Paradise Valley, Arizona 85258

PROJECT NO. 2018_041
DATE OF ISSUE 11.01.2018

REVISION NO. 1
DATE 09.26.2018

PROJECT TEAM John Cantrell
DRAWN BY BD

PROJECT PHASE SUP major amendment Review #3

SHEET CONTENTS
 photometric light fixture cut sheets
 SHEET NO.

E-1.2

