

# Water Flow Test Record


Input information in non-shaded areas only.

## Test Data Information

<b>Test Hydrant Number</b>		Date	29-Apr-16
<b>Location</b>		Static Pressure (psig)	76
NW Corner of Jack Rabbit and Casa Blanca Rd, Paradise Valley		Residual Pressure (psig)	70
Flow Hydrant #1		Outlet Size (Inches)	2.5
Flow Hydrant #2		Coefficient	0.9
Flow Hydrant #3		Pitot Pressure	65
Flow Hydrant #4		Test Flow (gpm)	1353
Flow Hydrant #5		Flow (gpm) available @ 20 psi	4519
Flow Hydrant #6		Flow (gpm) available @ 10 psi	4938
		#VALUE!	0
		#VALUE!	0
		#VALUE!	0

Column heading color correlates to line color on the chart

Water Flow Test Chart

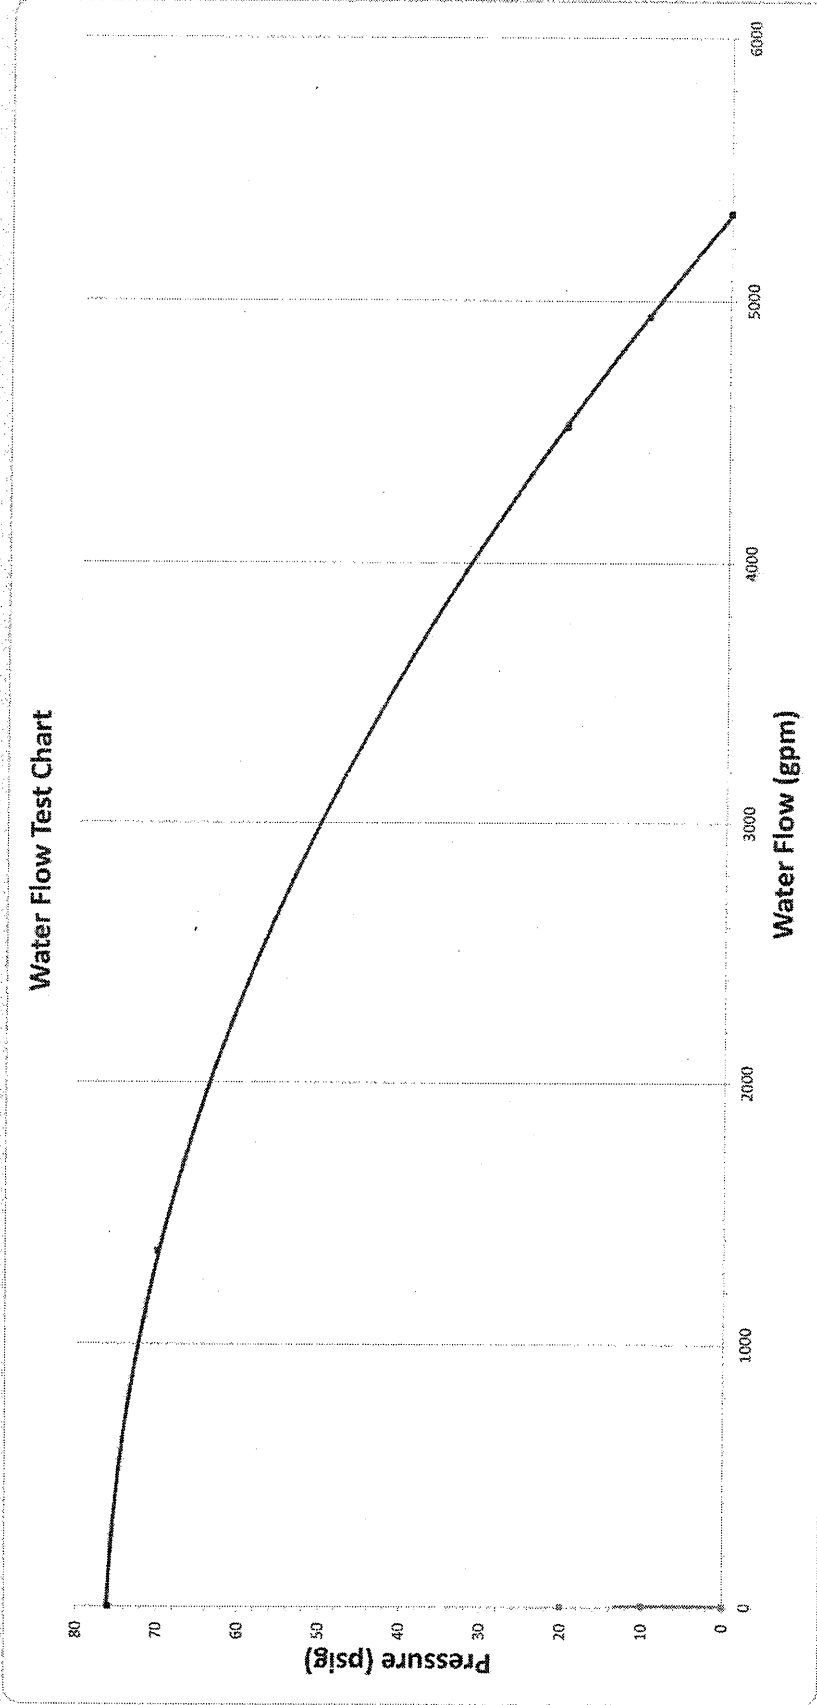

(For multiple test information printed on one chart, color printer required)